

Hoval TopVent® CH | CC | CHC | SH | SC | SHC

Design handbook

Recirculation units and supply air units configured as roof units with efficient air distribution for heating and cooling with central heat and cold generation



	Hoval Indoor Climate Systems Efficient. Flexible. Reliable.	3
	TopVent® CH Recirculation unit configured as roof unit for heating spaces up to 25 m in height with central heat supply	7
	TopVent® CC Recirculation unit configured as roof unit for heating and cooling spaces up to 25 m in height with central heat and cold supply (2-pipe-system)	23
	TopVent® CHC Recirculation unit configured as roof unit for heating and cooling spaces up to 25 m in height with central heat and cold supply (4-pipe-system)	41
	TopVent® SH Supply air unit configured as roof unit for ventilating and heating spaces up to 25 m in height with central heat supply	59
	TopVent® SC Supply air unit configured as roof unit for ventilating, heating and cooling spaces up to 25 m in height with central heat and cold supply (2-pipe-system)	77
	TopVent® SHC Supply air unit configured as roof unit for ventilating, heating and cooling spaces up to 25 m in height with central heat and cold supply (4-pipe-system)	95
	Options	113
	Transport and installation	129
	System design	141
	Control systems Hoval TopTronic® C → see "Control Systems for Hoval Indoor Climate Systems" manual	



Efficient. Flexible. Reliable.

Efficient. Flexible. Reliable.



Efficient. Flexible. Reliable.

Hoval indoor climate systems are decentralised systems for heating, cooling and ventilating halls for industrial, commercial and leisure applications. The systems have a modular structure. One system comprises several ventilation units which are spread around the room. These units are equipped with reversible heat pumps and gas-fired appliances for decentralised heat and cold generation, or they heat and cool with a connection to a central energy supply. Tailored control systems complete the system and ensure the effective combination and optimal use of all resources.

Diverse range of units ensures flexibility

Different types of ventilation units can be combined to create the perfect system for the project in question:

- RoofVent® supply and extract air handling units
- TopVent® supply air units
- TopVent® recirculation units

The number of supply and extract air handling units depends on how much fresh air is required in order to create a comfortable atmosphere for people in the building. Recirculation units cover additional heat or cool demand as required. A broad range of unit types and sizes with heating and cooling coils in various output levels means that the overall output of the system can be scaled to whatever level is required.

Specially designed unit versions are also available for halls with particularly humid or oily extract air.

Furthermore, there is a range of units available which have been expressly developed for very specific purposes. ProcessVent units, for example, are coupled with extract air purification systems in industrial halls and recover heat from process air.

Draught-free air distribution

A key feature of Hoval indoor climate units is the patented vortex air distributor, known as the Air-Injector. It is controlled automatically and changes the blowing angle of the air continuously between vertical and horizontal. The highly efficient air supply system has many advantages:

- It provides a high level of comfort during heating and cooling. No draughts develop in the hall.
- The efficient and even air distribution ensures that the indoor climate units cover a large area.
- The Air-Injector keeps the temperature stratification in the room low, thus minimising heat loss through the roof.

Control with specialist expertise


The TopTronic® C control system, which was specifically developed for Hoval indoor climate systems, regulates the separate units individually and controls them based on zones. This enables optimal adjustment to the local requirements of the different usage areas in the building. The patented control algorithm optimises energy use and ensures maximum comfort and hygiene levels. Clear interfaces make it easy to connect the system to the building management system.

Simpler control systems are also available for units that are only used for supply air or air recirculation.


Competent and reliable

Hoval will support you and provide expert knowledge throughout all project phases. You can rely on comprehensive technical advice when it comes to planning Hoval indoor climate systems and on the skills of the Hoval technicians during the installation, commissioning and maintenance of the system.


System with decentralised heat and cold generation with heat pump

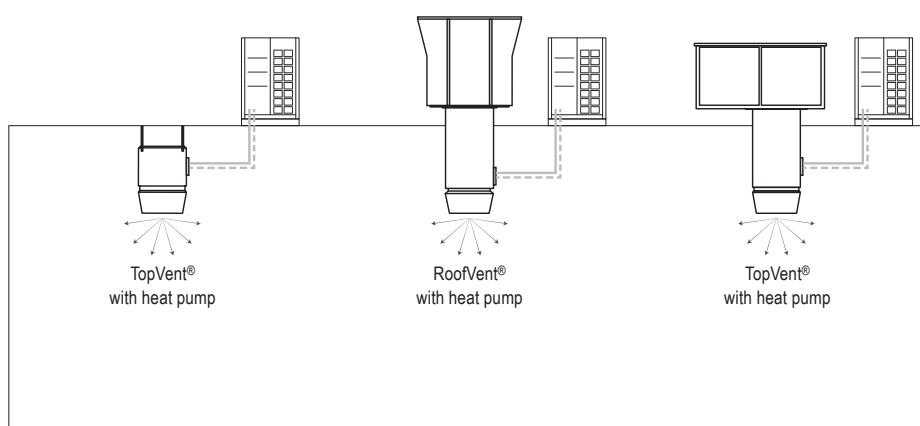

System with central heat and cold generation

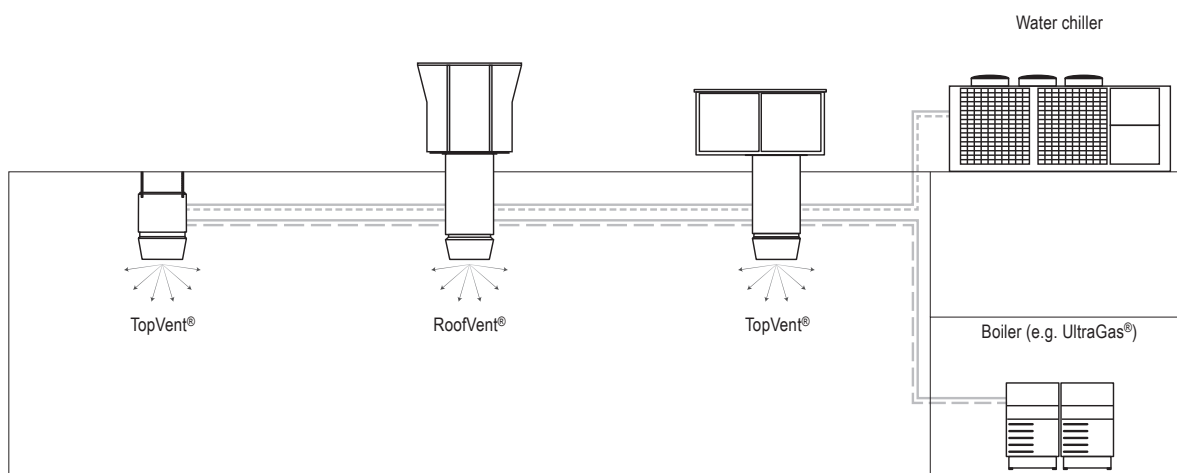

System with decentralised, gas-fired heat generation

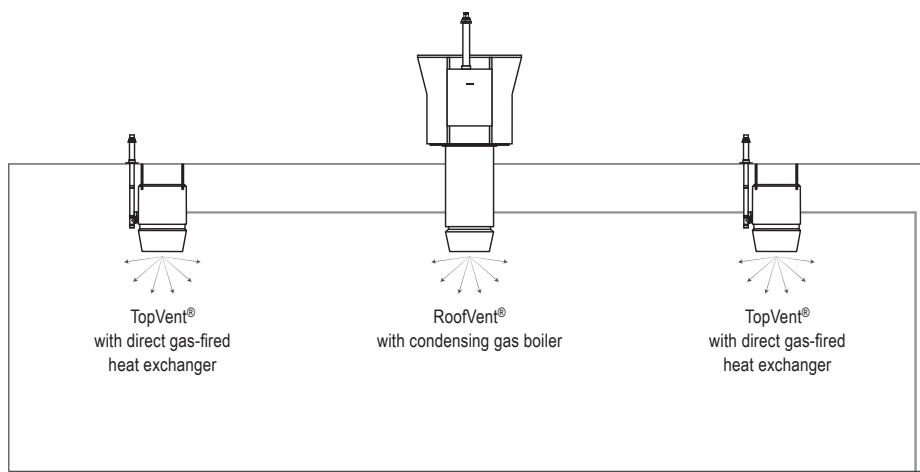



TopVent® CH

Recirculation unit configured as roof unit for heating spaces up to 25 m in height with central heat supply

1 Use	8
2 Construction and operation	8
3 Technical data	11
4 Specification texts	16

1 Use

1.1 Intended use

TopVent® CH is a recirculation unit for heating spaces up to 25 m in height with central heat supply. It fulfils the following functions:

- Heating (with connection to a hot water supply)
- Recirculation operation
- Air distribution and destratification with adjustable Air-Injector
- Air filtration

TopVent® CH is configured as a roof unit. It is installed in the roof to save space and does not protrude far into the room. Maintenance work is carried out from the roof without causing disruption to operations in the building.

The TopVent® CH unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of energy-related products. It is a system of the “fan coil unit” type, provided for in Commission Regulation (EU) 2016/2281.

The Hoval TopTronic® C integrated control system ensures energy-efficient, demand-based operation of Hoval indoor climate systems.

Intended use also includes compliance with the operating instructions. Any usage over and above this use is considered to be not as intended. The manufacturer can accept no liability for damage resulting from improper use.

1.2 User group

The units are only allowed to be installed, operated and maintained by authorised and instructed personnel who are well acquainted with the units and are informed about possible dangers.

2 Construction and operation

2.1 Construction

The TopVent® CH unit consists of the following components:

Roof unit

The self-supporting housing for mounting on the roof frame is of double-shell construction; this ensures good thermal insulation and high stability. The roof unit includes the following components:

- Fan
 - Heating section
 - Coil for heating the supply air with hot water
 - Extract air filter
 - Unit control box (part of the TopTronic® C control system)
- All components are easily accessible for maintenance work through large access openings.


Below-roof unit

The below-roof unit comprises the following components:

- Connection module:


The connection module serves as an air duct through the roof and for drawing in extract air from the hall through the extract air grille. To enable easy adaptation to local installation conditions, the connection module is available in 3 lengths.
- Air-Injector:

The Air-Injector is a patented, infinitely variable vortex air distributor for the draught-free introduction of air into the hall under changing operating conditions.

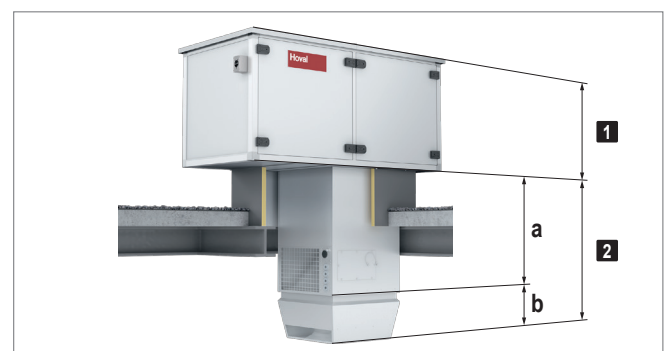

- 1 Roof unit
- 2 Below-roof unit
 - a Connection module
 - b Air-Injector


Fig. B1: TopVent® CH components

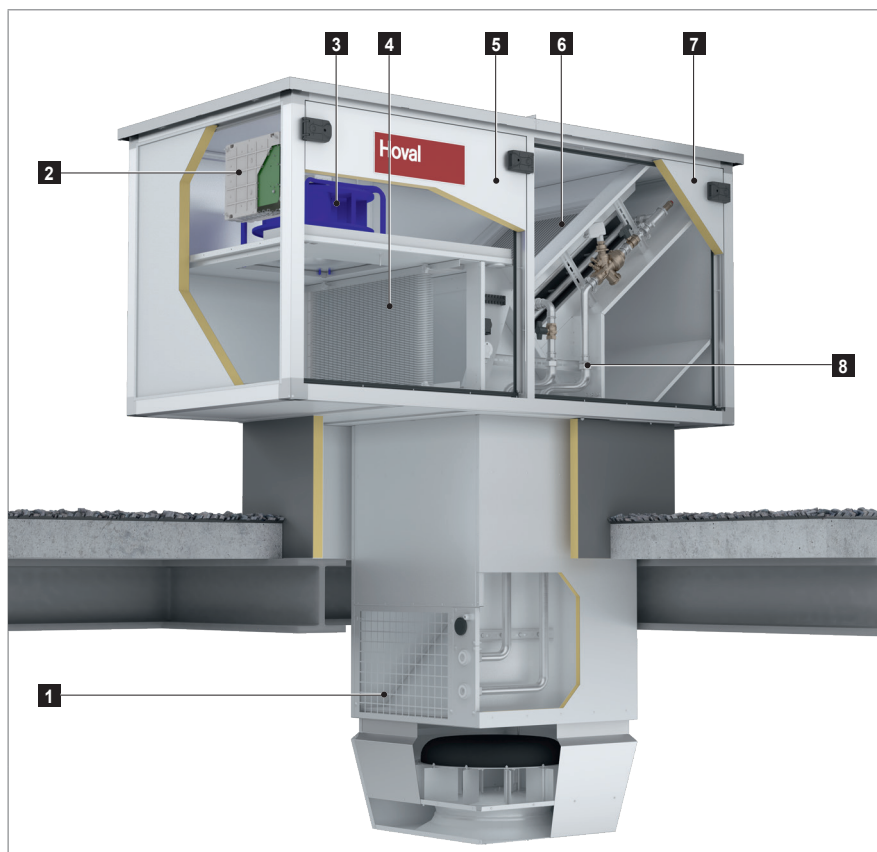

- | | |
|---|---------------------------------------|
| 1 | Extract air grille |
| 2 | Unit control box |
| 3 | Fan |
| 4 | Extract air filter |
| 5 | Fan access door |
| 6 | Heating coil |
| 7 | Hydraulic connection access door |
| 8 | Hydraulic assembly throttling circuit |

Fig. B2: TopVent® CH construction

2.2 Function diagram

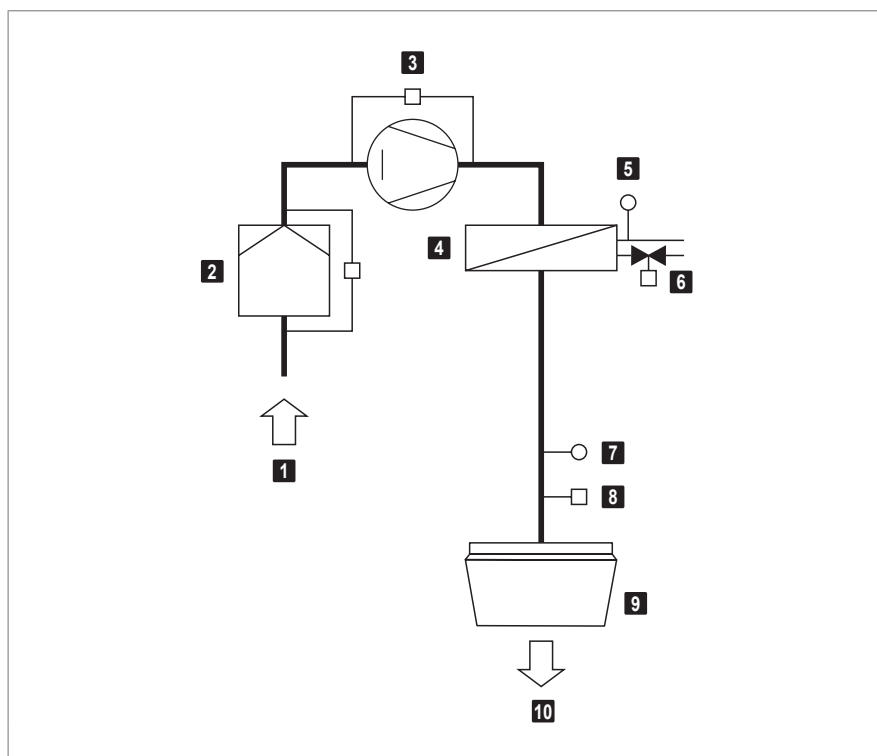

- | | |
|----|--|
| 1 | Extract air |
| 2 | Extract air filter with differential pressure switch |
| 3 | Fan with flow rate monitoring |
| 4 | Heating coil |
| 5 | Return temperature sensor |
| 6 | Control valve with actuator (option) |
| 7 | Supply air temperature sensor |
| 8 | Actuator Air-Injector |
| 9 | Air-Injector |
| 10 | Supply air |

Fig. B3: TopVent® CH function diagram

2.3 Operating modes

TopVent® CH operates in the following modes:

- Recirculation
- Recirculation speed 1
- Standby

The TopTronic® C control system regulates these operating modes automatically for each control zone in accordance with the specifications in the calendar. The following points also apply:

- The operating mode of a control zone can be switched over manually.
- Each TopVent® CH unit can operate individually in a local operating mode:
Off, Recirculation, Recirculation speed 1







Code	Operating mode		Description
REC	Recirculation On/off-operation: If heating is required, the unit draws in room air, heats it and blows it back into the room. The room temperature set value day is active.		Fan speed 1/2 ¹⁾ Heating on ¹⁾ 1) Depending on heat demand
DES	■ Destratification: To avoid heat build-up under the ceiling, it may be appropriate to switch on the fan when there is no heat demand (either in permanent operation or in on/off operation depending on the temperature stratification, as desired).		Fan speed 2 Heating off
REC1	Recirculation speed 1 The same as REC, but the unit operates only at speed 1 (low air flow rate)		Fan speed 1 Heating on ¹⁾ 1) Depending on heat demand
DES	■ Destratification: The same as for REC, but the unit operates only at speed 1		Fan speed 1 Heating off
ST	Standby The unit is ready for operation; the following operating modes are activated if required:		
CPR	■ Cooling protection: If the room temperature drops below the set value for cooling protection, the unit heats up the room in recirculation operation.		Fan speed 2 Heating on
L_OFF	Off (local operating mode) The unit is switched off; frost protection for the unit remains active.		Fan off Heating off
–	Forced heating The unit draws in room air, warms it and blows it back into the room. Forced heating is activated by connecting the unit to a power supply (only if there is no bus connection to the zone controller). For example, it is suitable for heating the hall before taking the control system into operation or if the controller fails during the heating period.		Fan speed 2 Heating on

Table B1: TopVent® CH operating modes

3.4 Air flow rate

Unit type		CH-6	CH-9
Nominal air flow rate	m³/h	6000	9000
Floor area covered			
■ for applications with higher comfort requirements (e.g. production halls, assembly halls, sports halls)	m²	537	946
■ for applications with low comfort requirements (e.g. warehouses, logistics centres)	m²	953	1674

Table B5: TopVent® CH air flow rate

3.5 Air filtration

Filter	Extract air
Class acc. to ISO 16890	ISO ePM ₁ 55 %
Class acc. to EN 779	F7
Factory setting of differential pressure switches	300 Pa

Table B6: TopVent® CH air filtration

3.6 Sound level

Unit type			CH-6C		CH-9C	
			Indoors	Outdoors	Indoors	Outdoors
Sound pressure level (at a distance of 5 m) ¹⁾		dB(A)	55	42	58	45
Total sound power level		dB(A)	77	64	80	67
Octave sound power level	63 Hz	dB	45	40	46	41
	125 Hz	dB	61	55	64	58
	250 Hz	dB	67	57	69	59
	500 Hz	dB	71	60	73	62
	1000 Hz	dB	74	57	77	60
	2000 Hz	dB	70	56	75	61
	4000 Hz	dB	66	47	71	52
	8000 Hz	dB	65	39	65	39

¹⁾ with a hemispherical radiation pattern in a low-reflection room

Table B7: TopVent® CH sound level

3.7 Heat output

Heating medium temperature			80/60 °C					60/40 °C				
Size	Type	t _{room}	Q	H _{max}	t _s	Δp _w	m _w	Q	H _{max}	t _s	Δp _w	m _w
		°C	kW	m	°C	kPa	l/h	kW	m	°C	kPa	l/h
CH-6	A	16	32.8	13.4	34.2	7	1410	18.8	16.8	27.3	2	807
		20	30.3	14.0	37.0	6	1301	16.2	17.9	30.0	2	697
	B	16	47.0	11.6	41.3	13	2020	26.9	14.6	31.3	4	1157
		20	43.4	12.0	43.5	11	1864	23.3	15.5	33.5	3	1001
	C	16	76.0	9.4	55.6	18	3267	45.0	11.8	40.3	6	1935
		20	70.3	9.8	56.8	16	3022	39.3	12.5	41.5	5	1690
CH-9	A	16	55.5	13.6	36.6	8	2386	31.7	17.0	28.5	3	1364
		20	51.2	14.1	38.9	7	2201	27.4	18.1	31.1	2	1179
	B	16	71.2	12.2	41.5	12	3060	40.6	15.4	31.4	4	1746
		20	65.7	12.7	43.7	10	2823	35.1	16.5	33.6	3	1509
	C	16	117.9	9.8	56.9	18	5066	69.9	12.3	41.1	6	3003
		20	109.1	10.2	58.0	15	4686	61.0	13.1	42.1	5	2622
Legend:	Type = Type of coil t _{room} = Room air temperature Q = Heat output H _{max} = Maximum mounting height t _s = Supply air temperature Δp _w = Water pressure drop m _w = Water quantity											
Reference:	■ At room air temperature 16 °C: extract air temperature 18 °C ■ At room air temperature 20 °C: extract air temperature 22 °C											

Table B8: TopVent® CH heat output

3.8 Product information according to ErP

Trademark / Model	Hoval TopVent® CH						Unit
	6A	6B	6C	9A	9B	9C	
Cooling capacity (sensible) (P _{rated,c})	–	–	–	–	–	–	kW
Cooling capacity (latent) (P _{rated,c})	–	–	–	–	–	–	kW
Heating capacity (P _{rated,h})	13.2	18.9	29.8	22.6	28.5	46.2	kW
Total electric power input (P _{elec})	0.88	0.91	0.99	1.57	1.64	1.77	kW
Sound power level (L _{WA})	64			67			dB(A)
Contact details	Hoval Aktiengesellschaft Austrasse 70, 9490 Vaduz, Liechtenstein www.hoval.com						

Table B9: Product information according to Commission Regulation (EU) 2016/2281, Table 13

3.9 Dimensions and weights

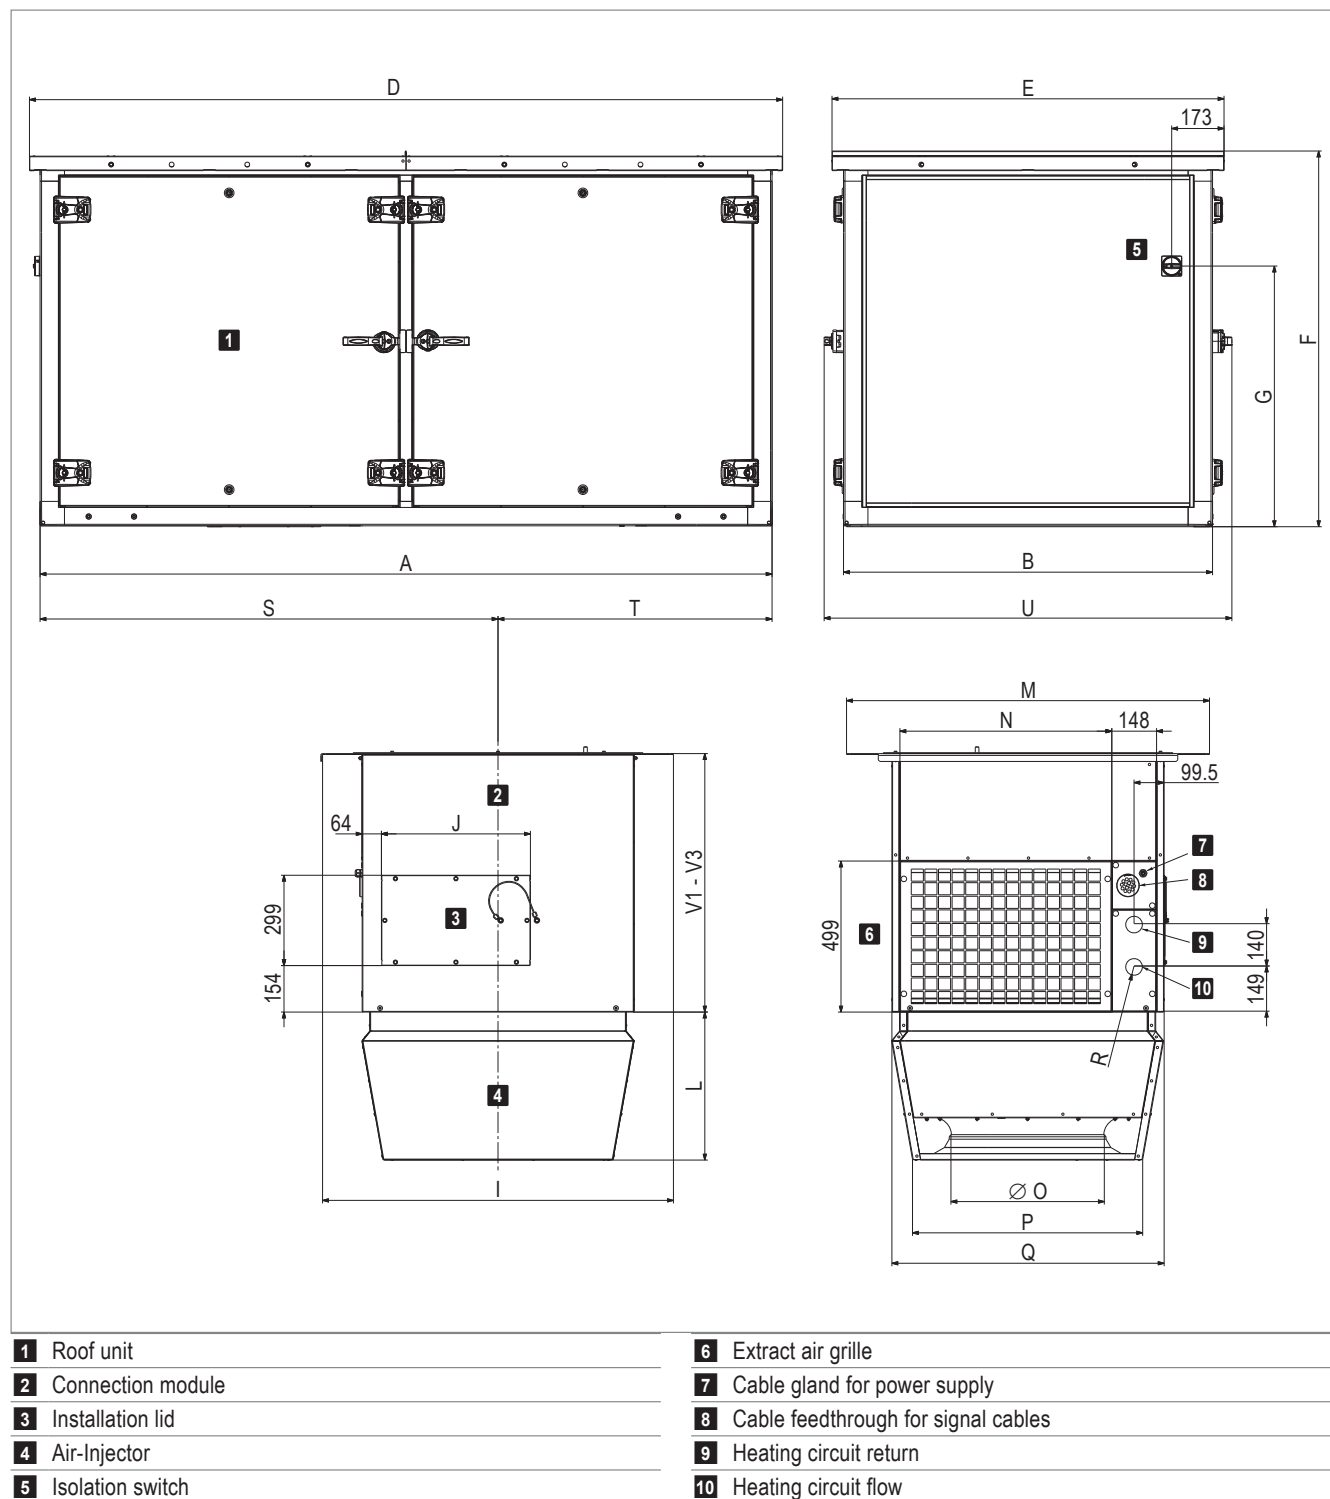


Table B10: Dimensional drawing for TopVent® CH with hydraulic assembly throttling circuit (dimensions in mm)

Unit type		CH-6	CH-9
A	mm	2420	2725
B	mm	1220	1420
D	mm	2490	2795
E	mm	1290	1490
F	mm	1239	1439
G	mm	862	962
I	mm	1160	1360
J	mm	492	492
L	mm	490	570
M	mm	1200	1400
N	mm	701	901
Ø O	mm	500	630
P	mm	767	937
Q	mm	900	1100
R (internal thread) ¹⁾	"	G 1½	G 1½
S	mm	1514	1684
T	mm	906	1041
U	mm	1348	1548
V1	mm	850	850
V2	mm	1300	1300
V3	mm	1750	1750

¹⁾ TopVent® units without hydraulic assembly: pipe outlets Ø 55 mm

Table B11: TopVent® CH dimensions

Unit type	CH-	6 A	6B	6C	9 A	9B	9C
Total	kg	610	609	616	779	778	791
Roof unit	kg	468	467	474	597	596	609
Below-roof unit	kg	142	142	142	182	182	182
Air-Injector	kg	40	40	40	57	57	57
Connection module V1	kg	102			125		
Additional weight V2	kg	+ 42			+ 50		
Additional weight V3	kg	+ 85			+ 101		

Table B12: TopVent® CH weights

Heating section		6 A	6B	6C	9 A	9B	9C
Connection (internal thread)	"	Rp 1¼	Rp 1¼	Rp 1¼	Rp 1½	Rp 1½	Rp 1½
Water content of the coil	l	4.6	4.6	7.9	7.4	7.4	12.4

Table B13: Hydraulic connection of the heating section in the roof unit (without hydraulic assembly)

4 Specification texts

4.1 TopVent® CH

Recirculation unit for heating rooms up to 25 m in height with central heat supply; configured as roof unit; equipped with highly efficient air distributor.

The unit consists of the following components:

- Roof unit (with access to all components relevant for maintenance)
- Below-roof unit, consisting of:
 - Connection module
 - Air-Injector
- Optional components

The TopVent® CH unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of energy-related products. It is a system of the “fan coil unit” type, provided for in Commission Regulation (EU) 2016/2281.

Roof unit

Self-supporting casing, construction made of thermally decoupled aluminium profile frame system with nylon connecting elements and panels made of coated zinc sheet (anthracite grey, similar to RAL 7016), additional rain canopy made of aluminium:

- Weatherproof, corrosion resistant, impact resistant, air-tight
- Low flammability, double-shelled, without heat bridges, with highly efficient insulation made of expanded polystyrene
- Hygienic and easy to maintain because of smooth interior surfaces and large access doors with ageing-resistant, silicone-free sealing materials

The roof unit includes:

Fan

Configured as maintenance-free, directly driven radial fan with high-efficiency EC motor, backwards-curved, 3D contoured blades and free-running rotor made of a high-performance composite material, aerodynamically optimised inflow nozzle, low-noise, with integrated overload protection.

Heating section

The heating section contains:

- The highly efficient heating coil consisting of seamless copper pipes with pressed-on, optimised and profiled aluminium fins and manifolds made of copper; for connection to the hot water supply

Extract air filter

Pleated cell filter of filter class ePM₁ 55% according to ISO 16890, consisting of micro glass with synthetic lamination as handle protection, pleat pack completely encapsulated to prevent leakage, frame made of recycled plastic, fully incinerable, including differential pressure switch for filter monitoring.

Unit control box

Control box for connection of the power supply and housing the control components that facilitate energy-optimised operation, controlled by the control system TopTronic® C. Plastic casing, protection rating IP56. The following components are installed:

- Circuit board with all required electrical components, unit controller (clipped on) as well as connection terminals for all internal and the following external connections:
 - Heating valve
 - Heating pump
 - Door contact

The circuit board is fitted with push-in terminals facilitating easy installation of the connection cables. All components in the unit control box as well as sensors, actuators in the unit and the isolation switch attached to the outside of the unit are fully factory-wired.

Power supply, bus connection, connection to Air-Injector actuator to be installed on site

Terminal box (variant)

Terminal box fitted at the side of the housing for connection of the power supply and peripheral components of the unit. Plastic casing, protection rating IP56. The following components are installed:

- Circuit board with all required electrical components as well as connection terminals for the following signals:
 - Input Enable fan
 - Input Control signal fan
 - Output Control signal next fan
 - Input Control signal actuator Air-Injector
 - Output Control signal next actuator Air-Injector
 - Output Feedback control signal Air-Injector
 - Output Error
- The following components in the unit are factory-wired:
 - Isolation switch
 - Fan
 - Supply air temperature sensor

Access openings

Defined side walls of the roof unit configured as inspection doors for easy access to all components relevant for maintenance. The hinges allow opening with an opening angle of 90° or complete removal of the inspection doors.

Below-roof unit

Connection module V1

Housing made of magnesium zinc sheet, air-tight, flame retardant, with highly efficient insulation made of expanded polystyrene, hygienic and easy to maintain because of smooth interior surfaces and ageing-resistant, silicone-free sealing materials; configured with:

- Extract air grille
- Cable feedthroughs for the electric supply
- Pipe feedthroughs for the hydraulic supply

Installation and insulation of the pipelines on site

Connection module V2 / V3 (variant)

The connection module is extended for adapting to the local installation situation.

Design with Air-Injector

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, with:

- Vortex air distributor with concentric outlet nozzle, adjustable vanes and integrated absorber hood
- Actuator for infinitely variable adjustment of the air distribution from vertical to horizontal
 - for draught-free air distribution in the hall under changing operating conditions
 - for the rapid and large-area reduction of temperature stratification in the room through induction of secondary air and strong mixing of the room air with supply air

Actuator installed in the connection module for easy access from the roof.

Design without Air-Injector (variant)

Unit configured without vortex air distributor for connection to an on-site supply air duct and air distribution within the building.

Air distribution box (variant)

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, configured with 2 collars as connecting piece to the on-site air distribution system.

Outlet nozzle (variant)

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials. Concentric outlet nozzle.

Options for the unit

Paint finish of below-roof unit

Exterior painting of the below-roof unit in choice of RAL colour.

Supply air silencer

Designed as a sound-absorbing mat made of melamine foam; hygienically perfect with carbon fibre coating; mounted in the roof unit; insertion loss 3 dB.

Hydraulic assembly throttling circuit

Assembly for hydraulic throttling circuit, sized for the coil in the unit and the Hoval TopTronic® C, consisting of:

- Control valve with volume flow presetting, ball valve and automatic air vent, installed and wired in the roof unit
- Pre-insulated corrugated pipelines installed in the below-roof unit for connection to the distribution network

Pipelines in the roof unit and in the below-roof unit to be connected on site, pipelines in the roof unit to be insulated on site

Pump control

Electrical components for controlling a mixing or injection circuit in the load circuit, factory-installed in the unit control box.

Roof frame

Consisting of 4 load-bearing side walls made of galvanised sheet steel with fastening rails for the roof foil, supplied loose with the matching connecting screws.

Assembly, insulation, integration in the roof structure on site.

4.2 TopTronic® C – System control

Zone-based control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size per system bus: 64 control zones with up to 10 supply and extract air handling units or supply air units and 10 recirculation units each.

Zone allocation

Configured in advance for the customer at the factory:

	Room designation	Unit type
Zone 1:	_____	_____
Zone 2:	_____	_____
...		

System structure

- Zone control panel made of coated sheet steel (light grey RAL 7035), ... x ... x ... mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - 1 zone controller and 1 room temperature sensor per zone (expandable to up to 4 room temperature sensors per zone)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in one control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Heating/cooling demand per zone with feedback monitoring

Functions, standard

- Zone-based autonomous room control. Temperature and ventilation control separately adjustable for each zone
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time
- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution

- Main operating modes of supply and extract air handling units:

VE Ventilation, infinitely variably adjustment

AQ.... Air quality, automatic control with Hoval combination sensor (option), optional reference variable:

- CO₂ or VOC
- Air humidity (optimised dehumidification mode)

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

EA Exhaust air, infinitely variably adjustment

SA Supply air, infinitely variably adjustment

ST Standby

- Main operating modes of supply air units:

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

SA Supply air, infinitely variably adjustment

With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC

ST Standby

- Main operating modes of recirculation units:

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

ST Standby

- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)
- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- TopTronic® C-ZT as zone operator terminal: for simple on-site operation of a control zone
- Manual operating selector switches
- Manual operating selector buttons
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP
 - Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Alarm lamp
- Socket

Per zone:

- The change-over between heating and cooling can be either automatic or manual
 - Cooling lock switch for automatic changeover
 - Heating/cooling switch for manual changeover
- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Combination sensor fresh air temperature and humidity
- Transfer of actual values and setpoints from external systems (0-10 V; 4-20 mA)
- Load shedding input
- Signal for external extract air fan
- Operating selector switches on terminal
- Operating selector button on terminal
- Control of distributor pump, incl. power supply
- Control box TW Pro

Power distribution:

- Circuit breakers and output terminals for Hoval indoor climate units
- Safety relay (4-pin)

4.3 TopTronic® C – Single zone control panel

Control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size: 1 control zone with up to 10 supply and extract air handling units or supply air units and 10 recirculation units.

System structure

- Zone control panel, designed as compact cabinet for wall installation, made of coated sheet steel (light grey RAL 7035), 380 × 300 × 210 mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - Zone controller
 - 1 Room temperature sensor (expandable to up to 4 room temperature sensors)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in the control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Circuit board with external connections for:
 - Power supply
 - Zone bus
 - Room temperature sensors (max. 4)
 - Fresh air temperature sensor
 - Combination sensor room air quality, temperature and humidity
 - Collective alarm
 - Forced off
 - Heating demand
 - Setpoint heating demand
 - Fault heat supply
 - Cooling demand
 - Fault cold supply
 - External enabling heating/cooling (for automatic changeover)
 - External setting heating/cooling (for manual changeover)
 - Changeover valves heating/cooling
 - External setpoint fresh air ratio
 - Operating selector switch on terminal (digital)
 - Operating selector button on terminal

Functions, standard

- Room temperature control via sequential control of the coils
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time

- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution
- Main operating modes of supply and extract air handling units:
 - VE Ventilation, infinitely variably adjustment
 - AQ.... Air quality, automatic control with Hoval combination sensor (option), optional reference variable CO₂ or VOC
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - EA Exhaust air, infinitely variably adjustment
 - SA Supply air, infinitely variably adjustment
 - ST Standby
- Main operating modes of supply air units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - SA Supply air, infinitely variably adjustment
 - With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC
 - ST Standby
- Main operating modes of recirculation units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - ST Standby
- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)
- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP
 - Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Signal for external extract air fan
- Control box TW Pro

4.4 HovalSupervisor cloud TopTronic® C

(Terms of use according to www.hoval.com/hsc are accepted when ordered.)

HovalSupervisor cloud TopTronic® C

Remote access, visualisation, historization, trends, evaluations and alarming for Hoval indoor climate systems with TopTronic® C control

- Project-specific system engineering
- Visualisation of the system statuses, error messages, actual and nominal values of the entire plant system
- Graphical display of the entire plant control system, in order to complete an analysis of sequences and subsequently to be able to perform an optimisation
- Integrated continuous line recorder for a period of 3 years
- Integrated alarm management
- Multi-user system: simultaneous access, 2 users included per plant
- Max. 300 data points historicized
- Max. 10 control zones

Consisting of:

- Project-specific engineering of the visualisation as described above
- Industrial router for connecting the TopTronic® C control system
 - Metal casing installed in the zone control panel
 - Without SIM card, free choice of phone network
 - Router configuration possible via web server
 - Network connections:
 - 2 x 10/100 Mbit Ethernet
 - 2 x SIM card slot
 - SMA connections:
 - 1 x WLAN
 - 2 x mobile data via integrated antenna
 - Power supply for industrial router installed in zone control panel

HovalSupervisor cloud TopTronic® C subscription

Subscription for use of the HovalSupervisor cloud for visualisation of a TopTronic® C system

- 1 year term (subscription billed once a year)
- Use of the HovalSupervisor cloud and storage of the data in the cloud
- Paid support during business hours (only for the software, not for the system)
- The respective valid conditions of use and the service level agreement (SLA) apply, which can be retrieved online.

Options for HovalSupervisor cloud

- Antenna to improve mobile data reception in conjunction with the HovalSupervisor cloud TopTronic® C
 - Antenna with mounting bracket for on-site installation outside the TopTronic® C zone control panel
 - 2G/3G/4G-LTE/5G-ready
 - SMA port available on the antenna
- Antenna extension cable for connecting the antenna in conjunction with the HovalSupervisor cloud
 - SMA port
 - Double shielded
 - Length: 5 m

4.5 EasyTronic EC

Room temperature controller with timer for TopVent® TH, TC, CH, CC, TV recirculation units and TopVent® TW Pro air curtains, protection rating IP30, with the following functions:

- Recording the room temperature with the integrated temperature sensor
- Connection option for external room temperature sensor
- Room temperature control in on/off mode
- Lowering of the room temperature setpoint value via week programme
- Unit control depending on a door contact switch
- Manual adjustment of the fan speed
- Manual adjustment of air distribution with the Hoval Air-Injector from vertical to horizontal (for TopVent® TH, TC, CH, CC)
- Signal for switching a pump or a valve
- Fan off delay in cooling mode
- External heating/cooling changeover
- Alarm display
- Connection to the building management system via Modbus RTU

Options

- External room temperature sensor (protection rating IP65)



TopVent® CC

Recirculation unit configured as roof unit for heating and cooling spaces up to 25 m in height with central heat and cold supply (2-pipe-system)

1 Use	.24
2 Construction and operation	.24
3 Technical data	.27
4 Specification texts	.33

1 Use

1.1 Intended use

TopVent® CC is a recirculation unit for heating and cooling spaces up to 25 m in height with central heat and cold supply. It fulfils the following functions:

- Heating (with connection to a hot water supply)
- Cooling (with connection to a water chiller)
- Recirculation operation
- Air distribution and destratification with adjustable Air-Injector
- Air filtration

TopVent® CC is configured as a roof unit. It is installed in the roof to save space and does not protrude far into the room. Maintenance work is carried out from the roof without causing disruption to operations in the building.

The TopVent® CC unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of energy-related products. It is a system of the “fan coil unit” type, provided for in Commission Regulation (EU) 2016/2281.

The Hoval TopTronic® C integrated control system ensures energy-efficient, demand-based operation of Hoval indoor climate systems.

Intended use also includes compliance with the operating instructions. Any usage over and above this use is considered to be not as intended. The manufacturer can accept no liability for damage resulting from improper use.

1.2 User group

The units are only allowed to be installed, operated and maintained by authorised and instructed personnel who are well acquainted with the units and are informed about possible dangers.

2 Construction and operation

2.1 Construction

The TopVent® CC unit consists of the following components:

Roof unit

The self-supporting housing for mounting on the roof frame is of double-shell construction; this ensures good thermal insulation and high stability. The roof unit includes the following components:

- Fan
 - Heating/cooling section
 - Coil for heating and cooling the supply air with hot water or cold water
 - Condensate separator
 - Extract air filter
 - Unit control box (part of the TopTronic® C control system)
- All components are easily accessible for maintenance work through large access openings.


Below-roof unit

The below-roof unit comprises the following components:

- Connection module:


The connection module serves as an air duct through the roof and for drawing in extract air from the hall through the extract air grille. To enable easy adaptation to local installation conditions, the connection module is available in 3 lengths.
- Air-Injector:

The Air-Injector is a patented, infinitely variable vortex air distributor for the draught-free introduction of air into the hall under changing operating conditions.

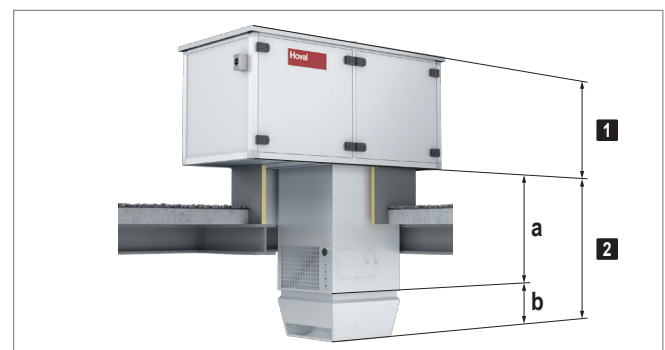

- 1 Roof unit
- 2 Below-roof unit
 - a Connection module
 - b Air-Injector


Fig. C1: TopVent® CC components

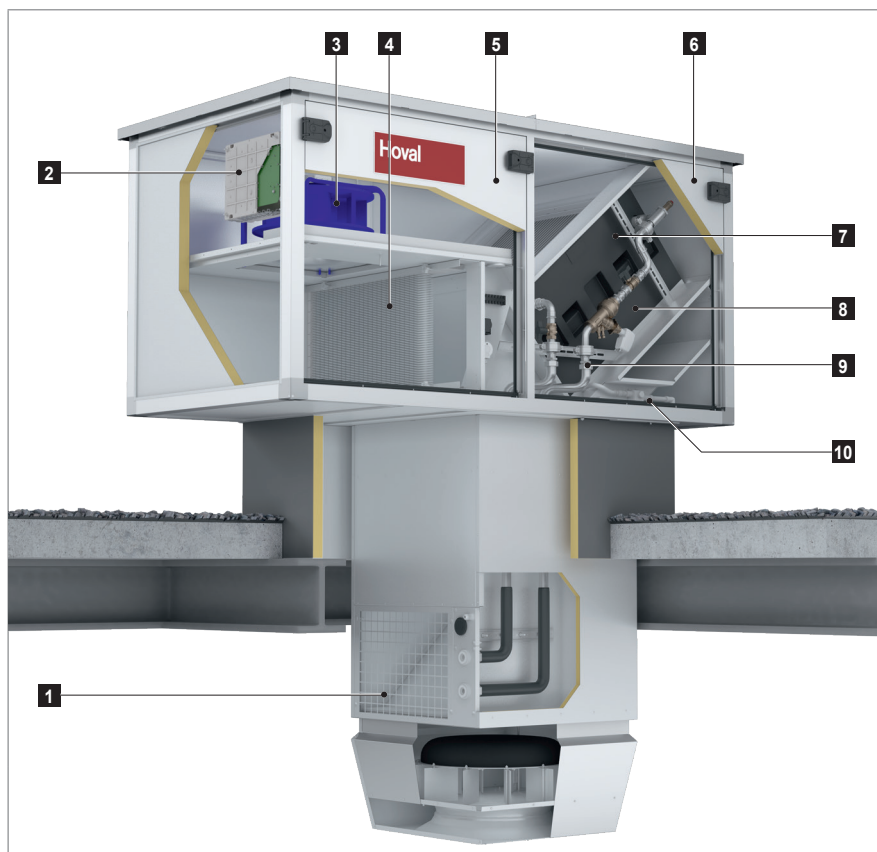

- | | |
|----|---------------------------------------|
| 1 | Extract air grille |
| 2 | Unit control box |
| 3 | Fan |
| 4 | Extract air filter |
| 5 | Fan access door |
| 6 | Hydraulic connection access door |
| 7 | Heating/cooling coil |
| 8 | Condensate separator |
| 9 | Hydraulic assembly throttling circuit |
| 10 | Condensate drain |

Fig. C2: TopVent® CC construction

2.2 Function diagram

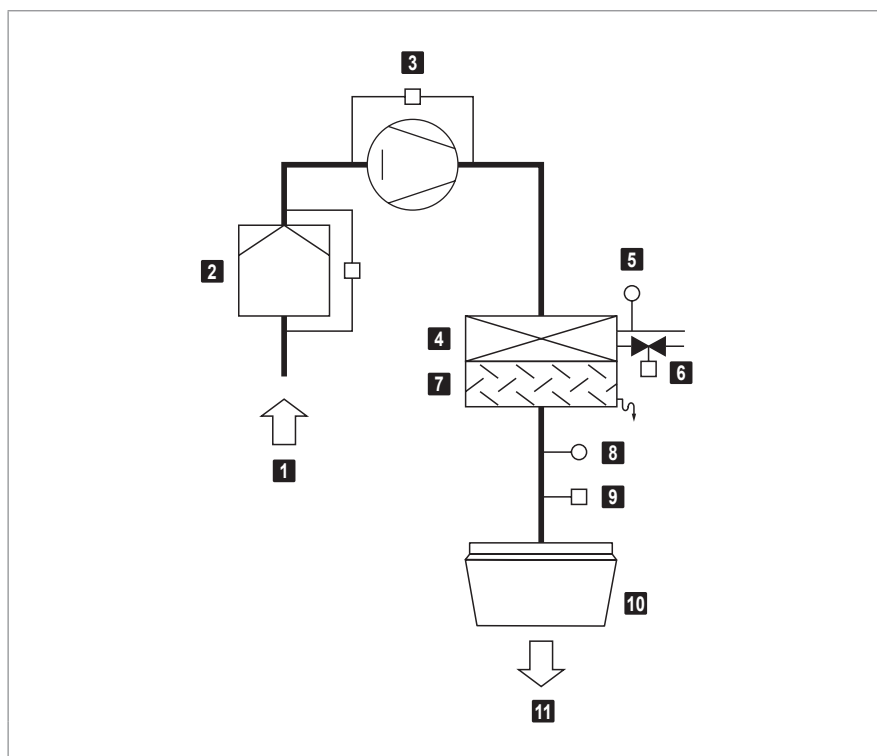

- | | |
|----|--|
| 1 | Extract air |
| 2 | Extract air filter with differential pressure switch |
| 3 | Fan with flow rate monitoring |
| 4 | Heating/cooling coil |
| 5 | Return temperature sensor |
| 6 | Control valve with actuator (option) |
| 7 | Condensate separator |
| 8 | Supply air temperature sensor |
| 9 | Actuator Air-Injector |
| 10 | Air-Injector |
| 11 | Supply air |

Fig. C3: TopVent® CC function diagram

2.3 Operating modes

TopVent® CC operates in the following modes:

- Recirculation
- Recirculation speed 1
- Standby

The TopTronic® C control system regulates these operating modes automatically for each control zone in accordance with the specifications in the calendar. The following points also apply:

- The operating mode of a control zone can be switched over manually.
- Each TopVent® CC unit can operate individually in a local operating mode:
Off, Recirculation, Recirculation speed 1







Code	Operating mode		Description
REC	Recirculation On/Off operation: during heat or cool demand, the unit draws in room air, heats or cools it and blows it back into the room. The room temperature set value day is active.		Fan speed 1/2 ¹⁾ Heating/cooling on ¹⁾ 1) Depending on heat or cool demand
DES	■ Destratification: To avoid heat build-up under the ceiling, it may be appropriate to switch on the fan when there is no heat or cool demand (either in permanent operation or in on/off operation depending on the temperature stratification, as desired).		Fan speed 2 Heating/cooling off
REC1	Recirculation speed 1 The same as REC, but the unit operates only at speed 1 (low air flow rate)		Fan speed 1 Heating/cooling on ¹⁾ 1) Depending on heat or cool demand
DES	■ Destratification: The same as for REC, but the unit operates only at speed 1		Fan speed 1 Heating/cooling off
ST	Standby The unit is ready for operation; the following operating modes are activated if required:		
CPR	■ Cooling protection: If the room temperature drops below the set value for cooling protection, the unit heats up the room in recirculation operation.		Fan speed 2 Heating on
OPR	■ Overheating protection: If the room temperature rises above the set value for overheating protection, the unit cools down the room in recirculation operation.		Fan speed 2 Cooling on
L_OFF	Off (local operating mode) The unit is switched off; frost protection for the unit remains active.		Fan off Heating/cooling off
–	Forced heating The unit draws in room air, warms it and blows it back into the room. Forced heating is activated by connecting the unit to a power supply (only if there is no bus connection to the zone controller). For example, it is suitable for heating the hall before taking the control system into operation or if the controller fails during the heating period.		Fan speed 2 Heating on

Table C1: TopVent® CC operating modes

3.4 Air flow rate

Unit type		CC-6	CC-9
Nominal air flow rate	m³/h	6000	9000
Floor area covered			
■ for applications with higher comfort requirements (e.g. production halls, assembly halls, sports halls)	m²	537	946
■ for applications with low comfort requirements (e.g. warehouses, logistics centres)	m²	953	1674

Table C5: TopVent® CC air flow rate

3.5 Air filtration

Filter	Extract air
Class acc. to ISO 16890	ISO ePM ₁ 55 %
Class acc. to EN 779	F7
Factory setting of differential pressure switches	300 Pa

Table C6: TopVent® CC air filtration

3.6 Sound level

Unit type			CC-6-C		CC-9-C	
			Indoors	Outdoors	Indoors	Outdoors
Sound pressure level (at a distance of 5 m) ¹⁾		dB(A)	55	42	59	46
Total sound power level		dB(A)	77	64	81	68
Octave sound power level	63 Hz	dB	45	40	47	42
	125 Hz	dB	61	55	65	59
	250 Hz	dB	67	57	70	60
	500 Hz	dB	71	60	73	62
	1000 Hz	dB	74	57	78	61
	2000 Hz	dB	70	56	76	62
	4000 Hz	dB	66	47	71	52
	8000 Hz	dB	65	39	66	40

¹⁾ with a hemispherical radiation pattern in a low-reflection room

Table C7: TopVent® CC sound level

3.7 Heat output

Heating medium temperature			80/60 °C					60/40 °C				
Size	Type	t _{room}	Q	H _{max}	t _s	Δp _W	m _W	Q	H _{max}	t _s	Δp _W	m _W
		°C	kW	m	°C	kPa	l/h	kW	m	°C	kPa	l/h
CC-6	C	16	76.0	9.4	55.6	18	3267	45.0	11.8	40.3	6	1935
		20	70.3	9.8	56.8	16	3022	39.3	12.5	41.5	5	1690
CC-9	C	16	117.9	9.8	56.9	18	5066	69.9	12.3	41.1	6	3003
		20	109.1	10.2	58.0	15	4686	61.0	13.1	42.1	5	2622
	D	16	140.7	9.1	64.4	15	6045	85.4	11.3	46.2	5	3670
		20	130.4	9.5	65.0	13	5600	75.1	12.0	46.8	4	3225
Legend:	Type = Type of coil t _{room} = Room air temperature Q = Heat output H _{max} = Maximum mounting height t _s = Supply air temperature Δp _W = Water pressure drop m _W = Water quantity											
Reference:	■ At room air temperature 16 °C: extract air temperature 18 °C ■ At room air temperature 20 °C: extract air temperature 22 °C											

Table C8: TopVent® CC heat output

3.8 Cooling capacity

Cooling medium temperature				6/12 °C						8/14 °C					
Size	Type	t _{room}	RH _{room}	Q _{sen}	Q _{tot}	t _s	Δp _w	m _w	m _c	Q _{sen}	Q _{tot}	t _s	Δp _w	m _w	m _c
		°C	%	kW	kW	°C	kPa	l/h	kg/h	kW	kW	°C	kPa	l/h	kg/h
CC-6	C	22	50	20.4	20.4	13.9	15	2925	0.0	18.0	18.0	15.1	12	2573	0.0
			70	18.5	27.7	14.9	28	3960	13.5	16.0	21.4	16.1	17	3064	7.9
		26	50	25.2	31.1	15.5	36	4448	8.6	22.7	24.8	16.7	23	3552	3.0
			70	23.2	43.7	16.5	71	6263	30.2	20.8	37.5	17.7	52	5367	24.6
CC-9	C	22	50	31.4	31.4	13.6	15	4496	0.0	27.6	27.6	14.9	12	3947	0.0
			70	28.4	44.7	14.6	31	6401	23.9	24.6	28.2	15.9	12	4031	5.2
		26	50	38.8	49.9	15.2	38	7149	16.3	35.0	35.0	16.4	19	5013	0.0
			70	35.9	69.8	16.2	75	9989	49.8	32.0	53.2	17.4	44	7619	31.1
	D	22	50	37.1	37.1	11.8	13	5307	0.0	32.2	32.2	13.4	10	4613	0.0
			70	34.6	56.7	12.6	30	8118	32.5	29.7	45.1	14.2	19	6459	22.6
		26	50	46.4	62.4	12.7	36	8941	23.5	41.6	50.9	14.3	24	7282	13.6
			70	43.9	87.4	13.5	70	12513	63.9	39.1	75.8	15.1	53	10854	54.0
Legend:	Type = Type of coil t _{room} = Room air temperature RH _{room} = Relative humidity of the room air Q _{sen} = Sensible cooling capacity Q _{tot} = Total cooling capacity t _s = Supply air temperature Δp _w = Water pressure drop m _w = Water quantity m _c = Condensate quantity														
Reference:	■ At room air temperature 22 °C: extract air temperature 24 °C ■ At room air temperature 26 °C: extract air temperature 28 °C														

Table C9: TopVent® CC cooling capacity

3.9 Dimensions and weights

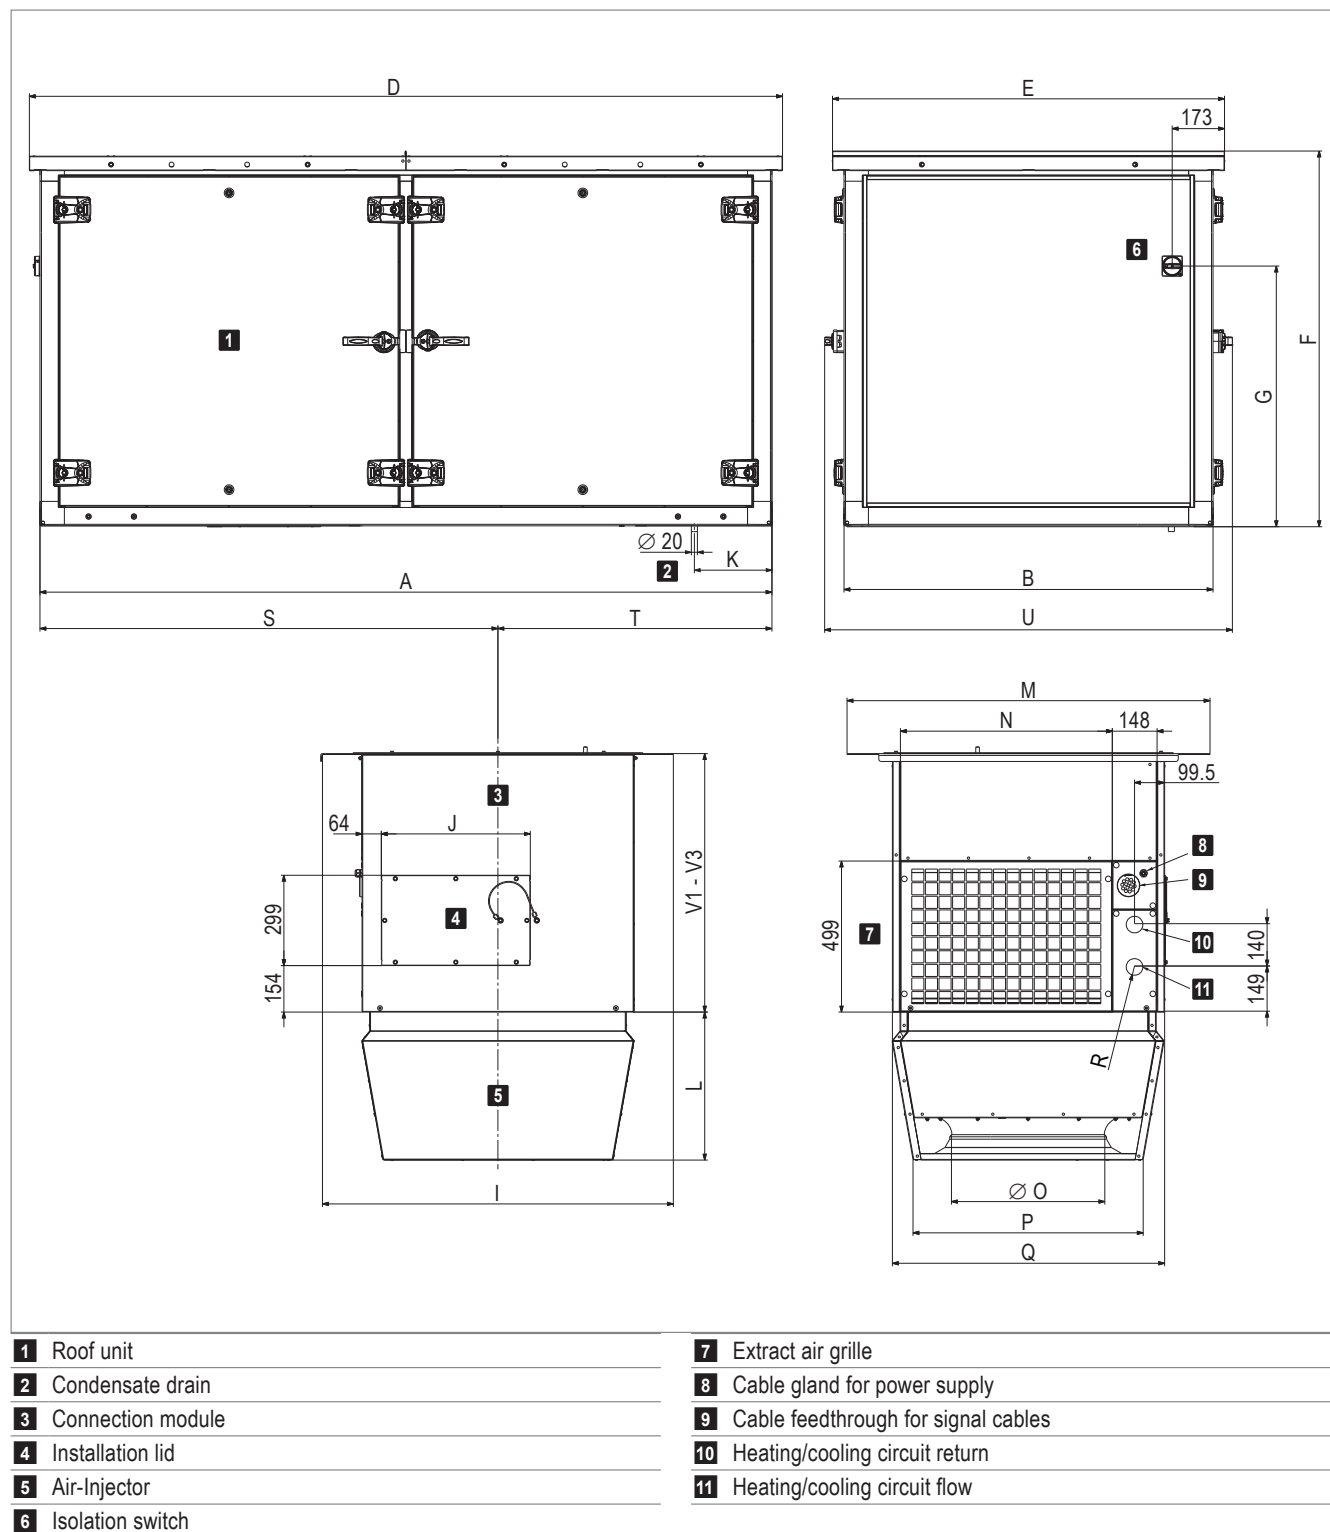


Table C10: Dimensional drawing for TopVent® CC with hydraulic assembly throttling circuit (dimensions in mm)

Unit type		CC-6	CC-9
A	mm	2420	2725
B	mm	1220	1420
D	mm	2490	2795
E	mm	1290	1490
F	mm	1239	1439
G	mm	862	962
I	mm	1160	1360
J	mm	492	492
K	mm	257	292
L	mm	490	570
M	mm	1200	1400
N	mm	701	901
Ø O	mm	500	630
P	mm	767	937
Q	mm	900	1100
R (internal thread) ¹⁾	"	G 1½	G 1½
S	mm	1514	1684
T	mm	906	1041
U	mm	1348	1548
V1	mm	850	850
V2	mm	1300	1300
V3	mm	1750	1750

¹⁾ TopVent® units without hydraulic assembly: pipe outlets Ø 55 mm

Table C11: TopVent® CC dimensions

Unit type	CC-	6-C	9-C	9-D
Total	kg	647	824	843
Roof unit	kg	505	642	661
Below-roof unit	kg	142	182	182
Air-Injector	kg	40	57	57
Connection module V1	kg	102	125	
Additional weight V2	kg	+ 42	+ 50	
Additional weight V3	kg	+ 85	+ 101	

Table C12: TopVent® CC weights

Heating/cooling section		6-C	9-C	9-D
Connection (internal thread)	"	Rp 1¼	Rp 1½	Rp 2
Water content of the coil	l	7.9	12.4	19.2

Table C13: Hydraulic connection of the heating/cooling section in the roof unit (without hydraulic assembly)

3.10 Product information according to ErP

Trademark / Model	Hoval TopVent® CC			Unit
	6-C	9-C	9-D	
Cooling capacity (sensible) ($P_{\text{rated,c}}$)	26.5	41.0	48.6	kW
Cooling capacity (latent) ($P_{\text{rated,c}}$)	5.6	7.3	15.2	kW
Heating capacity ($P_{\text{rated,h}}$)	29.8	46.2	54.2	kW
Total electric power input (P_{elec})	1.10	1.94	2.09	kW
Sound power level (L_{WA})	64	68		dB(A)
Contact details	Hoval Aktiengesellschaft Austrasse 70, 9490 Vaduz, Liechtenstein www.hoval.com			

Table C14: Product information according to Commission Regulation (EU) 2016/2281, Table 13

4 Specification texts

4.1 TopVent® CC

Recirculation unit for heating and cooling rooms up to 25 m in height with central heat and cold supply (2-pipe system); configured as roof unit; equipped with highly efficient air distributor.

The unit consists of the following components:

- Roof unit (with access to all components relevant for maintenance)
- Below-roof unit, consisting of:
 - Connection module
 - Air-Injector
- Optional components

The TopVent® CC unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of energy-related products. It is a system of the “fan coil unit” type, provided for in Commission Regulation (EU) 2016/2281.

Roof unit

Self-supporting casing, construction made of thermally decoupled aluminium profile frame system with nylon connecting elements and panels made of coated zinc sheet (anthracite grey, similar to RAL 7016), additional rain canopy made of aluminium:

- Weatherproof, corrosion resistant, impact resistant, air-tight
- Low flammability, double-shelled, without heat bridges, with highly efficient insulation made of expanded polystyrene
- Hygienic and easy to maintain because of smooth interior surfaces and large access doors with ageing-resistant, silicone-free sealing materials

The roof unit includes:

Fan

Configured as maintenance-free, directly driven radial fan with high-efficiency EC motor, backwards-curved, 3D contoured blades and free-running rotor made of a high-performance composite material, aerodynamically optimised inflow nozzle, low-noise, with integrated overload protection.

Heating/cooling section

The heating/cooling section contains:

- The highly efficient heating/cooling coil consisting of seamless copper pipes with pressed-on, optimised and profiled aluminium fins and manifolds made of copper; for connection to the hot water and cold water supply

- The pull-out condensate separator with collecting channel, made of high-quality corrosion-resistant material, with a downslope in all directions for rapid draining
- the condensate drain on the roof via siphon

Extract air filter

Pleated cell filter of filter class ePM₁ 55% according to ISO 16890, consisting of micro glass with synthetic lamination as handle protection, pleat pack completely encapsulated to prevent leakage, frame made of recycled plastic, fully incinerable, including differential pressure switch for filter monitoring.

Unit control box

Control box for connection of the power supply and housing the control components that facilitate energy-optimised operation, controlled by the control system TopTronic® C. Plastic casing, protection rating IP56. The following components are installed:

- Circuit board with all required electrical components, unit controller (clipped on) as well as connection terminals for all internal and the following external connections:
 - Heating/cooling valve
 - Heating/cooling pump
 - Door contact

The circuit board is fitted with push-in terminals facilitating easy installation of the connection cables. All components in the unit control box as well as sensors, actuators in the unit and the isolation switch attached to the outside of the unit are fully factory-wired.

Power supply, bus connection, connection to Air-Injector actuator to be installed on site

Terminal box (variant)

Terminal box fitted at the side of the housing for connection of the power supply and peripheral components of the unit. Plastic casing, protection rating IP56. The following components are installed:

- Circuit board with all required electrical components as well as connection terminals for the following signals:
 - Input Enable fan
 - Input Control signal fan
 - Output Control signal next fan
 - Input Control signal actuator Air-Injector
 - Output Control signal next actuator Air-Injector
 - Output Feedback control signal Air-Injector
 - Output Error
- The following components in the unit are factory-wired:
 - Isolation switch
 - Fan
 - Supply air temperature sensor

Access openings

Defined side walls of the roof unit configured as inspection doors for easy access to all components relevant for maintenance. The hinges allow opening with an opening angle of 90° or complete removal of the inspection doors.

Below-roof unit

Connection module V1

Housing made of magnesium zinc sheet, air-tight, flame retardant, with highly efficient insulation made of expanded polystyrene, hygienic and easy to maintain because of smooth interior surfaces and ageing-resistant, silicone-free sealing materials; configured with:

- Extract air grille
- Cable feedthroughs for the electric supply
- Pipe feedthroughs for the hydraulic supply

Installation and insulation of the pipelines on site

Connection module V2 / V3 (variant)

The connection module is extended for adapting to the local installation situation.

Design with Air-Injector

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, internally insulated with closed-cell polyethylene foam, with:

- Vortex air distributor with concentric outlet nozzle, adjustable vanes and integrated absorber hood
- Actuator for infinitely variable adjustment of the air distribution from vertical to horizontal
 - for draught-free air distribution in the hall under changing operating conditions
 - for the rapid and large-area reduction of temperature stratification in the room through induction of secondary air and strong mixing of the room air with supply air

Actuator installed in the connection module for easy access from the roof.

Design without Air-Injector (variant)

Unit configured without vortex air distributor for connection to an on-site supply air duct and air distribution within the building.

Air distribution box (variant)

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, insulated on the inside with closed-cell polyethylene foam; configured with 2 collars as connecting piece to the on-site air distribution system.

Options for the unit

Paint finish of below-roof unit

Exterior painting of the below-roof unit in choice of RAL colour.

Supply air silencer

Designed as a sound-absorbing mat made of melamine foam; hygienically perfect with carbon fibre coating; mounted in the roof unit; insertion loss 3 dB.

Hydraulic assembly throttling circuit

Assembly for hydraulic throttling circuit, sized for the coil in the unit and the Hoval TopTronic® C, consisting of:

- Control valve with volume flow presetting, ball valve and automatic air vent, installed and wired in the roof unit
- Pre-insulated corrugated pipelines installed in the below-roof unit for connection to the distribution network

Pipelines in the roof unit and in the below-roof unit to be connected on site, pipelines in the roof unit to be insulated on site

Pump control

Electrical components for controlling a mixing or injection circuit in the load circuit, factory-installed in the unit control box.

Roof frame

Consisting of 4 load-bearing side walls made of galvanised sheet steel with fastening rails for the roof foil, supplied loose with the matching connecting screws.

Assembly, insulation, integration in the roof structure on site.

4.2 TopTronic® C – System control

Zone-based control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size per system bus: 64 control zones with up to 10 supply and extract air handling units or supply air units and 10 recirculation units each.

Zone allocation

Configured in advance for the customer at the factory:

	Room designation	Unit type
Zone 1:	_____	_____
Zone 2:	_____	_____
...		

System structure

- Zone control panel made of coated sheet steel (light grey RAL 7035), ... x ... x ... mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - 1 zone controller and 1 room temperature sensor per zone (expandable to up to 4 room temperature sensors per zone)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in one control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Heating/cooling demand per zone with feedback monitoring

Functions, standard

- Zone-based autonomous room control. Temperature and ventilation control separately adjustable for each zone
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time
- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution

- Main operating modes of supply and extract air handling units:
 - VE Ventilation, infinitely variably adjustment
 - AQ Air quality, automatic control with Hoval combination sensor (option), optional reference variable:
 - CO₂ or VOC
 - Air humidity (optimised dehumidification mode)
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - EA Exhaust air, infinitely variably adjustment
 - SA Supply air, infinitely variably adjustment
 - ST Standby

- Main operating modes of supply air units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - SA Supply air, infinitely variably adjustment
 - With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC
 - ST Standby

- Main operating modes of recirculation units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - ST Standby

- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)
- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- TopTronic® C-ZT as zone operator terminal: for simple on-site operation of a control zone
- Manual operating selector switches
- Manual operating selector buttons
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP
 - Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Alarm lamp
- Socket

Per zone:

- The change-over between heating and cooling can be either automatic or manual
 - Cooling lock switch for automatic changeover
 - Heating/cooling switch for manual changeover
- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Combination sensor fresh air temperature and humidity
- Transfer of actual values and setpoints from external systems (0-10 V; 4-20 mA)
- Load shedding input
- Signal for external extract air fan
- Operating selector switches on terminal
- Operating selector button on terminal
- Control of distributor pump, incl. power supply
- Control box TW Pro

Power distribution:

- Circuit breakers and output terminals for Hoval indoor climate units
- Safety relay (4-pin)

4.3 TopTronic® C – Single zone control panel

Control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size: 1 control zone with up to 10 supply and extract air handling units or supply air units and 10 recirculation units.

System structure

- Zone control panel, designed as compact cabinet for wall installation, made of coated sheet steel (light grey RAL 7035), 380 × 300 × 210 mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - Zone controller
 - 1 Room temperature sensor (expandable to up to 4 room temperature sensors)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in the control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Circuit board with external connections for:
 - Power supply
 - Zone bus
 - Room temperature sensors (max. 4)
 - Fresh air temperature sensor
 - Combination sensor room air quality, temperature and humidity
 - Collective alarm
 - Forced off
 - Heating demand
 - Setpoint heating demand
 - Fault heat supply
 - Cooling demand
 - Fault cold supply
 - External enabling heating/cooling (for automatic changeover)
 - External setting heating/cooling (for manual changeover)
 - Changeover valves heating/cooling
 - External setpoint fresh air ratio
 - Operating selector switch on terminal (digital)
 - Operating selector button on terminal

Functions, standard

- Room temperature control via sequential control of the coils
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time

- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution
- Main operating modes of supply and extract air handling units:
 - VE Ventilation, infinitely variably adjustment
 - AQ.... Air quality, automatic control with Hoval combination sensor (option), optional reference variable CO₂ or VOC
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - EA Exhaust air, infinitely variably adjustment
 - SA Supply air, infinitely variably adjustment
 - ST Standby
- Main operating modes of supply air units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - SA Supply air, infinitely variably adjustment
 - With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC
 - ST Standby
- Main operating modes of recirculation units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - ST Standby
- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)
- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP
 - Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Signal for external extract air fan
- Control box TW Pro

4.4 HovalSupervisor cloud TopTronic® C

(Terms of use according to www.hoval.com/hsc are accepted when ordered.)

HovalSupervisor cloud TopTronic® C

Remote access, visualisation, historization, trends, evaluations and alarming for Hoval indoor climate systems with TopTronic® C control

- Project-specific system engineering
- Visualisation of the system statuses, error messages, actual and nominal values of the entire plant system
- Graphical display of the entire plant control system, in order to complete an analysis of sequences and subsequently to be able to perform an optimisation
- Integrated continuous line recorder for a period of 3 years
- Integrated alarm management
- Multi-user system: simultaneous access, 2 users included per plant
- Max. 300 data points historicized
- Max. 10 control zones

Consisting of:

- Project-specific engineering of the visualisation as described above
- Industrial router for connecting the TopTronic® C control system
 - Metal casing installed in the zone control panel
 - Without SIM card, free choice of phone network
 - Router configuration possible via web server
 - Network connections:
 - 2 x 10/100 Mbit Ethernet
 - 2 x SIM card slot
 - SMA connections:
 - 1 x WLAN
 - 2 x mobile data via integrated antenna
 - Power supply for industrial router installed in zone control panel

HovalSupervisor cloud TopTronic® C subscription

Subscription for use of the HovalSupervisor cloud for visualisation of a TopTronic® C system

- 1 year term (subscription billed once a year)
- Use of the HovalSupervisor cloud and storage of the data in the cloud
- Paid support during business hours (only for the software, not for the system)
- The respective valid conditions of use and the service level agreement (SLA) apply, which can be retrieved online.

Options for HovalSupervisor cloud

- Antenna to improve mobile data reception in conjunction with the HovalSupervisor cloud TopTronic® C
 - Antenna with mounting bracket for on-site installation outside the TopTronic® C zone control panel
 - 2G/3G/4G-LTE/5G-ready
 - SMA port available on the antenna
- Antenna extension cable for connecting the antenna in conjunction with the HovalSupervisor cloud
 - SMA port
 - Double shielded
 - Length: 5 m

4.5 EasyTronic EC

Room temperature controller with timer for TopVent® TH, TC, CH, CC, TV recirculation units and TopVent® TW Pro air curtains, protection rating IP30, with the following functions:

- Recording the room temperature with the integrated temperature sensor
- Connection option for external room temperature sensor
- Room temperature control in on/off mode
- Lowering of the room temperature setpoint value via week programme
- Unit control depending on a door contact switch
- Manual adjustment of the fan speed
- Manual adjustment of air distribution with the Hoval Air-Injector from vertical to horizontal (for TopVent® TH, TC, CH, CC)
- Signal for switching a pump or a valve
- Fan off delay in cooling mode
- External heating/cooling changeover
- Alarm display
- Connection to the building management system via Modbus RTU

Options

- External room temperature sensor (protection rating IP65)



TopVent® CHC

Recirculation unit configured as roof unit for heating and cooling spaces up to 25 m in height with central heat and cold supply (4-pipe-system)

1 Use	.42
2 Construction and operation	.42
3 Technical data	.45
4 Specification texts	.52

1 Use

1.1 Intended use

TopVent® CHC is a recirculation unit for heating and cooling spaces up to 25 m in height with central heat and cold supply. It fulfils the following functions:

- Heating (with connection to a hot water supply)
- Cooling (with connection to a water chiller)
- Recirculation operation
- Air distribution and destratification with adjustable Air-Injector
- Air filtration

TopVent® CHC is configured as a roof unit. It is installed in the roof to save space and does not protrude far into the room. Maintenance work is carried out from the roof without causing disruption to operations in the building.

The TopVent® CHC unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of energy-related products. It is a system of the “fan coil unit” type, provided for in Commission Regulation (EU) 2016/2281.

The Hoval TopTronic® C integrated control system ensures energy-efficient, demand-based operation of Hoval indoor climate systems.

Intended use also includes compliance with the operating instructions. Any usage over and above this use is considered to be not as intended. The manufacturer can accept no liability for damage resulting from improper use.

1.2 User group

The units are only allowed to be installed, operated and maintained by authorised and instructed personnel who are well acquainted with the units and are informed about possible dangers.

2 Construction and operation

2.1 Construction

The TopVent® CHC unit consists of the following components:

Roof unit

The self-supporting housing for mounting on the roof frame is of double-shell construction; this ensures good thermal insulation and high stability. The roof unit includes the following components:

- Fan
- Heating section
 - Coil for heating the supply air with hot water
- Cooling section
 - Coil for cooling the supply air with cold water
 - Condensate separator
- Extract air filter
- Unit control box (part of the TopTronic® C control system)

All components are easily accessible for maintenance work through large access openings.


Below-roof unit

The below-roof unit comprises the following components:

- Connection module:


The connection module serves as an air duct through the roof and for drawing in extract air from the hall through the extract air grille. To enable easy adaptation to local installation conditions, the connection module is available in 3 lengths.
- Air-Injector:

The Air-Injector is a patented, infinitely variable vortex air distributor for the draught-free introduction of air into the hall under changing operating conditions.

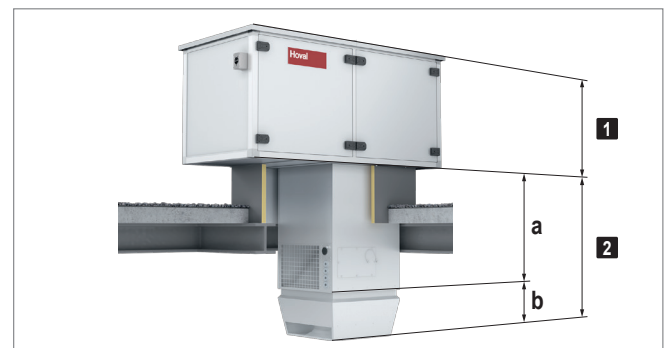

- 1 Roof unit
- 2 Below-roof unit
 - a Connection module
 - b Air-Injector


Fig. D1: TopVent® CHC components

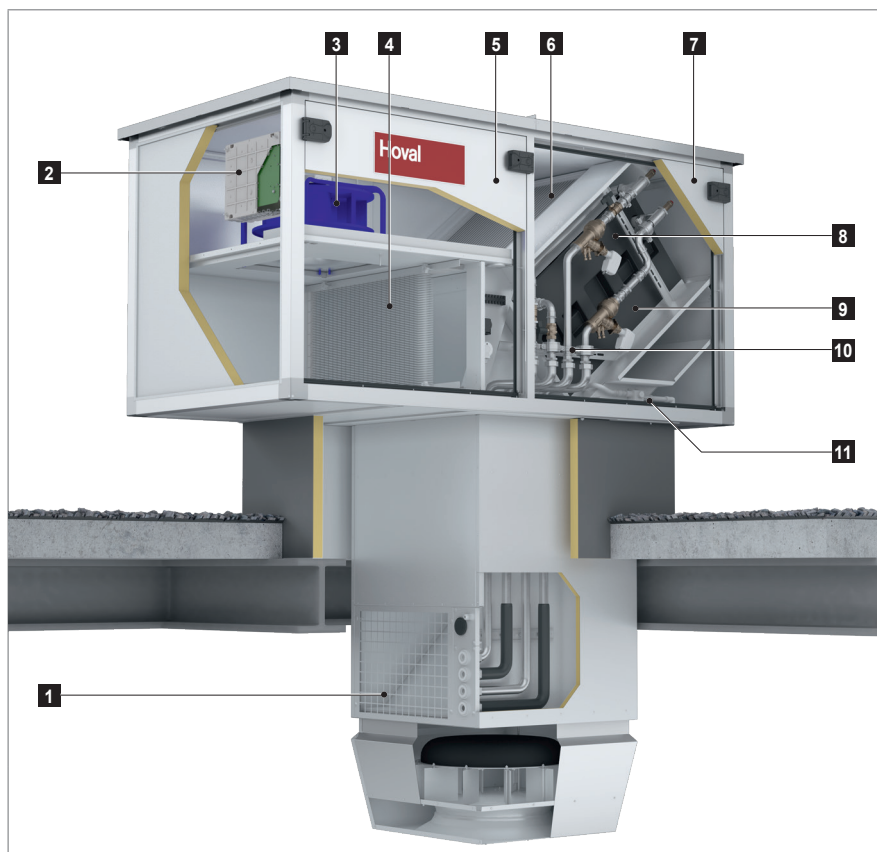

- | | |
|----|---------------------------------------|
| 1 | Extract air grille |
| 2 | Unit control box |
| 3 | Fan |
| 4 | Extract air filter |
| 5 | Fan access door |
| 6 | Heating coil |
| 7 | Hydraulic connection access door |
| 8 | Cooling coil |
| 9 | Condensate separator |
| 10 | Hydraulic assembly throttling circuit |
| 11 | Condensate drain |

Fig. D2: TopVent® CHC construction

2.2 Function diagram

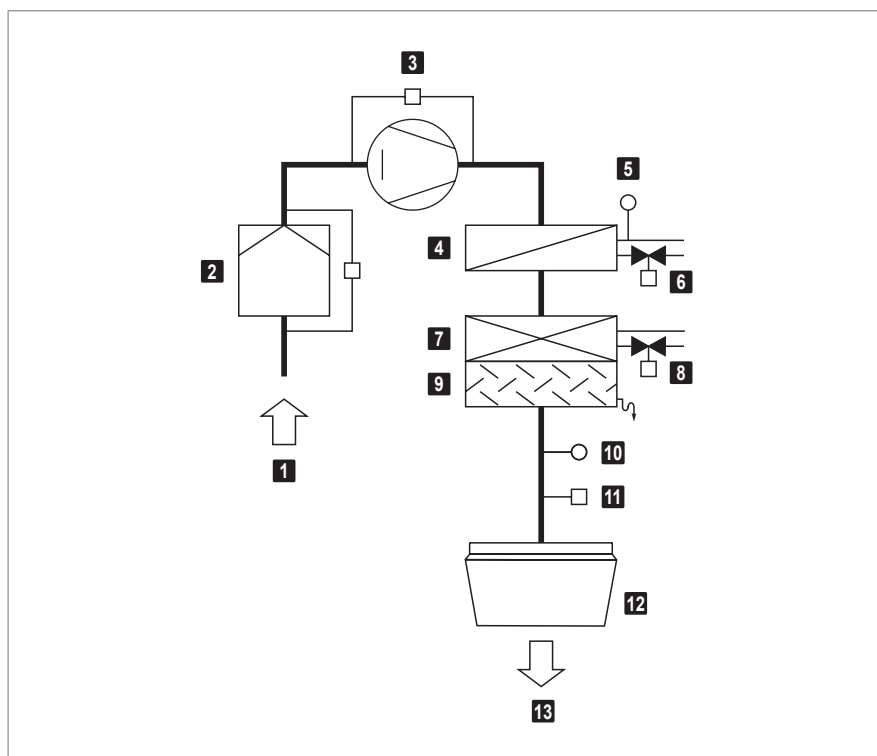

- | | |
|----|--|
| 1 | Extract air |
| 2 | Extract air filter with differential pressure switch |
| 3 | Fan with flow rate monitoring |
| 4 | Heating coil |
| 5 | Return temperature sensor |
| 6 | Control valve with actuator (option) |
| 7 | Cooling coil |
| 8 | Control valve with actuator (option) |
| 9 | Condensate separator |
| 10 | Supply air temperature sensor |
| 11 | Actuator Air-Injector |
| 12 | Air-Injector |
| 13 | Supply air |

Fig. D3: TopVent® CHC function diagram

2.3 Operating modes

TopVent® CHC operates in the following modes:

- Recirculation
- Recirculation speed 1
- Standby

The TopTronic® C control system regulates these operating modes automatically for each control zone in accordance with the specifications in the calendar. The following points also apply:

- The operating mode of a control zone can be switched over manually.
- Each TopVent® CHC unit can operate individually in a local operating mode:
Off, Recirculation, Recirculation speed 1







Code	Operating mode		Description
REC	Recirculation On/Off operation: during heat or cool demand, the unit draws in room air, heats or cools it and blows it back into the room. The room temperature set value day is active.		Fan speed 1/2 ¹⁾ Heating/cooling on ¹⁾ 1) Depending on heat or cool demand
DES	■ Destratification: To avoid heat build-up under the ceiling, it may be appropriate to switch on the fan when there is no heat or cool demand (either in permanent operation or in on/off operation depending on the temperature stratification, as desired).		Fan speed 2 Heating/cooling off
REC1	Recirculation speed 1 The same as REC, but the unit operates only at speed 1 (low air flow rate)		Fan speed 1 Heating/cooling on ¹⁾ 1) Depending on heat or cool demand
DES	■ Destratification: The same as for REC, but the unit operates only at speed 1		Fan speed 1 Heating/cooling off
ST	Standby The unit is ready for operation; the following operating modes are activated if required:		
CPR	■ Cooling protection: If the room temperature drops below the set value for cooling protection, the unit heats up the room in recirculation operation.		Fan speed 2 Heating on
OPR	■ Overheating protection: If the room temperature rises above the set value for overheating protection, the unit cools down the room in recirculation operation.		Fan speed 2 Cooling on
L_OFF	Off (local operating mode) The unit is switched off; frost protection for the unit remains active.		Fan off Heating/cooling off
–	Forced heating The unit draws in room air, warms it and blows it back into the room. Forced heating is activated by connecting the unit to a power supply (only if there is no bus connection to the zone controller). For example, it is suitable for heating the hall before taking the control system into operation or if the controller fails during the heating period.		Fan speed 2 Heating on

Table D1: TopVent® CHC operating modes

3 Technical data

3.1 Type code

	CHC	-	6	B	C	...
Unit type	TopVent® CHC					
Unit size	6 or 9					
Heating section	A with coil type A B with coil type B C with coil type C					
Cooling section	C with coil type C D with coil type D					
Further options						

Table D2: TopVent® CHC type code

3.2 Application limits

Extract air temperature		max.	°C	45
Moisture content of extract air		max.	g/kg	15
Supply air temperature		max.	°C	60
Temperature of the heating medium		max.	°C	90
Pressure of the heating medium		max.	kPa	800
Air flow rate	Size 6:	min.	m³/h	3100
	Size 9:	min.	m³/h	5000
Condensate quantity	Size 6:	max.	kg/h	90
	Size 9:	max.	kg/h	150
The units cannot be used in: ■ Damp locations ■ Places with a corrosive or aggressive environment ■ Spaces with a large amount of dust ■ Areas where there is danger of explosion				

Table D3: TopVent® CHC application limits

3.3 Electrical connection

Unit type		CHC-6	CHC-9
Supply voltage	V AC	3 x 400	3 x 400
Permitted voltage tolerance	%	± 5	± 5
Frequency	Hz	50	50
Connected load	kW	2.43	3.53
Current consumption max.	A	4.17	5.87
Series fuse	A	13	13
Protection rating	-	IP54	IP54

Table D4: TopVent® CHC electrical connections

3.4 Air flow rate

Unit type		CHC-6	CHC-9
Nominal air flow rate	m³/h	6000	9000
Floor area covered			
■ for applications with higher comfort requirements (e.g. production halls, assembly halls, sports halls)	m²	537	946
■ for applications with low comfort requirements (e.g. warehouses, logistics centres)	m²	953	1674

Table D5: TopVent® CHC air flow rate

3.5 Air filtration

Filter	Extract air
Class acc. to ISO 16890	ISO ePM ₁ 55 %
Class acc. to EN 779	F7
Factory setting of differential pressure switches	300 Pa

Table D6: TopVent® CHC air filtration

3.6 Sound level

Unit type			CHC-6CC		CHC-9CC	
			Indoors	Outdoors	Indoors	Outdoors
Sound pressure level (at a distance of 5 m) ¹⁾		dB(A)	55	43	59	47
Total sound power level		dB(A)	77	65	81	69
Octave sound power level	63 Hz	dB	45	41	47	43
	125 Hz	dB	58	54	60	56
	250 Hz	dB	67	59	70	62
	500 Hz	dB	71	61	73	63
	1000 Hz	dB	73	58	77	62
	2000 Hz	dB	69	57	75	63
	4000 Hz	dB	64	47	70	53
	8000 Hz	dB	63	39	65	41

¹⁾ with a hemispherical radiation pattern in a low-reflection room

Table D7: TopVent® CHC sound level

3.7 Heat output

Heating medium temperature			80/60 °C					60/40 °C				
Size	Type	t _{room} °C	Q kW	H _{max} m	t _s °C	Δp _w kPa	m _w l/h	Q kW	H _{max} m	t _s °C	Δp _w kPa	m _w l/h
CHC-6	A	16	32.8	13.4	34.2	7	1410	18.8	16.8	27.3	2	807
		20	30.3	14.0	37.0	6	1301	16.2	17.9	30.0	2	697
	B	16	47.0	11.6	41.3	13	2020	26.9	14.6	31.3	4	1157
		20	43.4	12.0	43.5	11	1864	23.3	15.5	33.5	3	1001
	C	16	76.0	9.4	55.6	18	3267	45.0	11.8	40.3	6	1935
		20	70.3	9.8	56.8	16	3022	39.3	12.5	41.5	5	1690
CHC-9	A	16	55.5	13.6	36.3	8	2386	31.7	17.0	28.5	3	1364
		20	51.2	14.1	38.9	7	2201	27.4	18.1	31.1	2	1179
	B	16	71.2	12.2	41.5	12	3060	40.6	15.4	31.4	4	1746
		20	65.7	12.7	43.7	10	2823	35.1	16.5	33.6	3	1509
	C	16	117.9	9.8	56.9	18	5066	69.9	12.3	41.1	6	3003
		20	109.1	10.2	58.0	15	4686	61.0	13.1	42.1	5	2622
Legend:	Type = Type of coil t _{room} = Room air temperature Q = Heat output H _{max} = Maximum mounting height t _s = Supply air temperature Δp _w = Water pressure drop m _w = Water quantity											
Reference:	■ At room air temperature 16 °C: extract air temperature 18 °C ■ At room air temperature 20 °C: extract air temperature 22 °C											

Table D8: TopVent® CHC heat output

3.8 Cooling capacity

Cooling medium temperature				6/12 °C						8/14 °C					
Size	Type	t _{room}	RH _{room}	Q _{sen}	Q _{tot}	t _s	Δp _w	m _w	m _c	Q _{sen}	Q _{tot}	t _s	Δp _w	m _w	m _c
		°C	%	kW	kW	°C	kPa	l/h	kg/h	kW	kW	°C	kPa	l/h	kg/h
CHC-6	C	22	50	20.4	20.4	13.9	15	2925	0.0	20.4	20.4	13.9	15	2925	0.0
			70	18.5	27.7	14.9	28	3960	13.5	16.0	21.4	16.1	17	3064	7.9
		26	50	25.2	31.1	15.5	36	4448	8.6	22.7	24.8	16.7	23	3552	3.0
			70	23.2	43.7	16.5	71	6263	30.2	20.8	37.5	17.7	52	5367	24.6
CHC-9	C	22	50	31.4	31.4	13.6	15	4496	0.0	31.4	31.4	13.6	15	4496	0.0
			70	28.4	44.7	14.6	31	6401	23.9	24.6	28.2	15.9	12	4031	5.2
		26	50	38.8	49.9	15.2	38	7149	16.3	35.0	35.0	16.4	19	5013	0.0
			70	35.9	69.8	16.2	75	9989	49.8	32.0	53.2	17.4	44	7619	31.1
	D	22	50	37.1	37.1	11.8	13	5307	0.0	37.1	37.1	11.8	13	5307	0.0
			70	34.6	56.7	12.6	30	8118	32.5	29.7	45.1	14.2	19	6459	22.6
		26	50	46.4	62.4	12.7	36	8941	23.5	41.6	50.9	14.3	24	7282	13.6
			70	43.9	87.4	13.5	70	12513	63.9	39.1	75.8	15.1	53	10854	54.0
Legend:	Type = Type of coil t _{room} = Room air temperature RH _{room} = Relative humidity of the room air Q _{sen} = Sensible cooling capacity Q _{tot} = Total cooling capacity t _s = Supply air temperature Δp _w = Water pressure drop m _w = Water quantity m _c = Condensate quantity														
Reference:	■ At room air temperature 22 °C: extract air temperature 24 °C ■ At room air temperature 26 °C: extract air temperature 28 °C														

Table D9: TopVent® CHC cooling capacity

3.9 Product information according to ErP

Trademark / Model	Hoval TopVent® CHC									Unit
	6AC	6BC	6CC	9AC	9BC	9CC	9AD	9BD	9CD	
Cooling capacity (sensible) (P _{rated,c})	26.5	26.5	26.5	41	41	41	48.6	48.6	48.6	kW
Cooling capacity (latent) (P _{rated,c})	5.6	5.6	5.6	7.3	7.3	7.3	15.2	15.2	15.2	kW
Heating capacity (P _{rated,h})	13.2	18.9	29.8	22.6	28.5	46.2	22.6	28.5	46.2	kW
Total electric power input (P _{elec})	1.16	1.20	1.29	2.05	2.12	2.27	2.20	2.27	2.42	kW
Sound power level (L _{WA})	65			69						dB(A)
Contact details	Hoval Aktiengesellschaft Austrasse 70, 9490 Vaduz, Liechtenstein www.hoval.com									

Table D10: Product information according to Commission Regulation (EU) 2016/2281, Table 13

3.10 Dimensions and weights

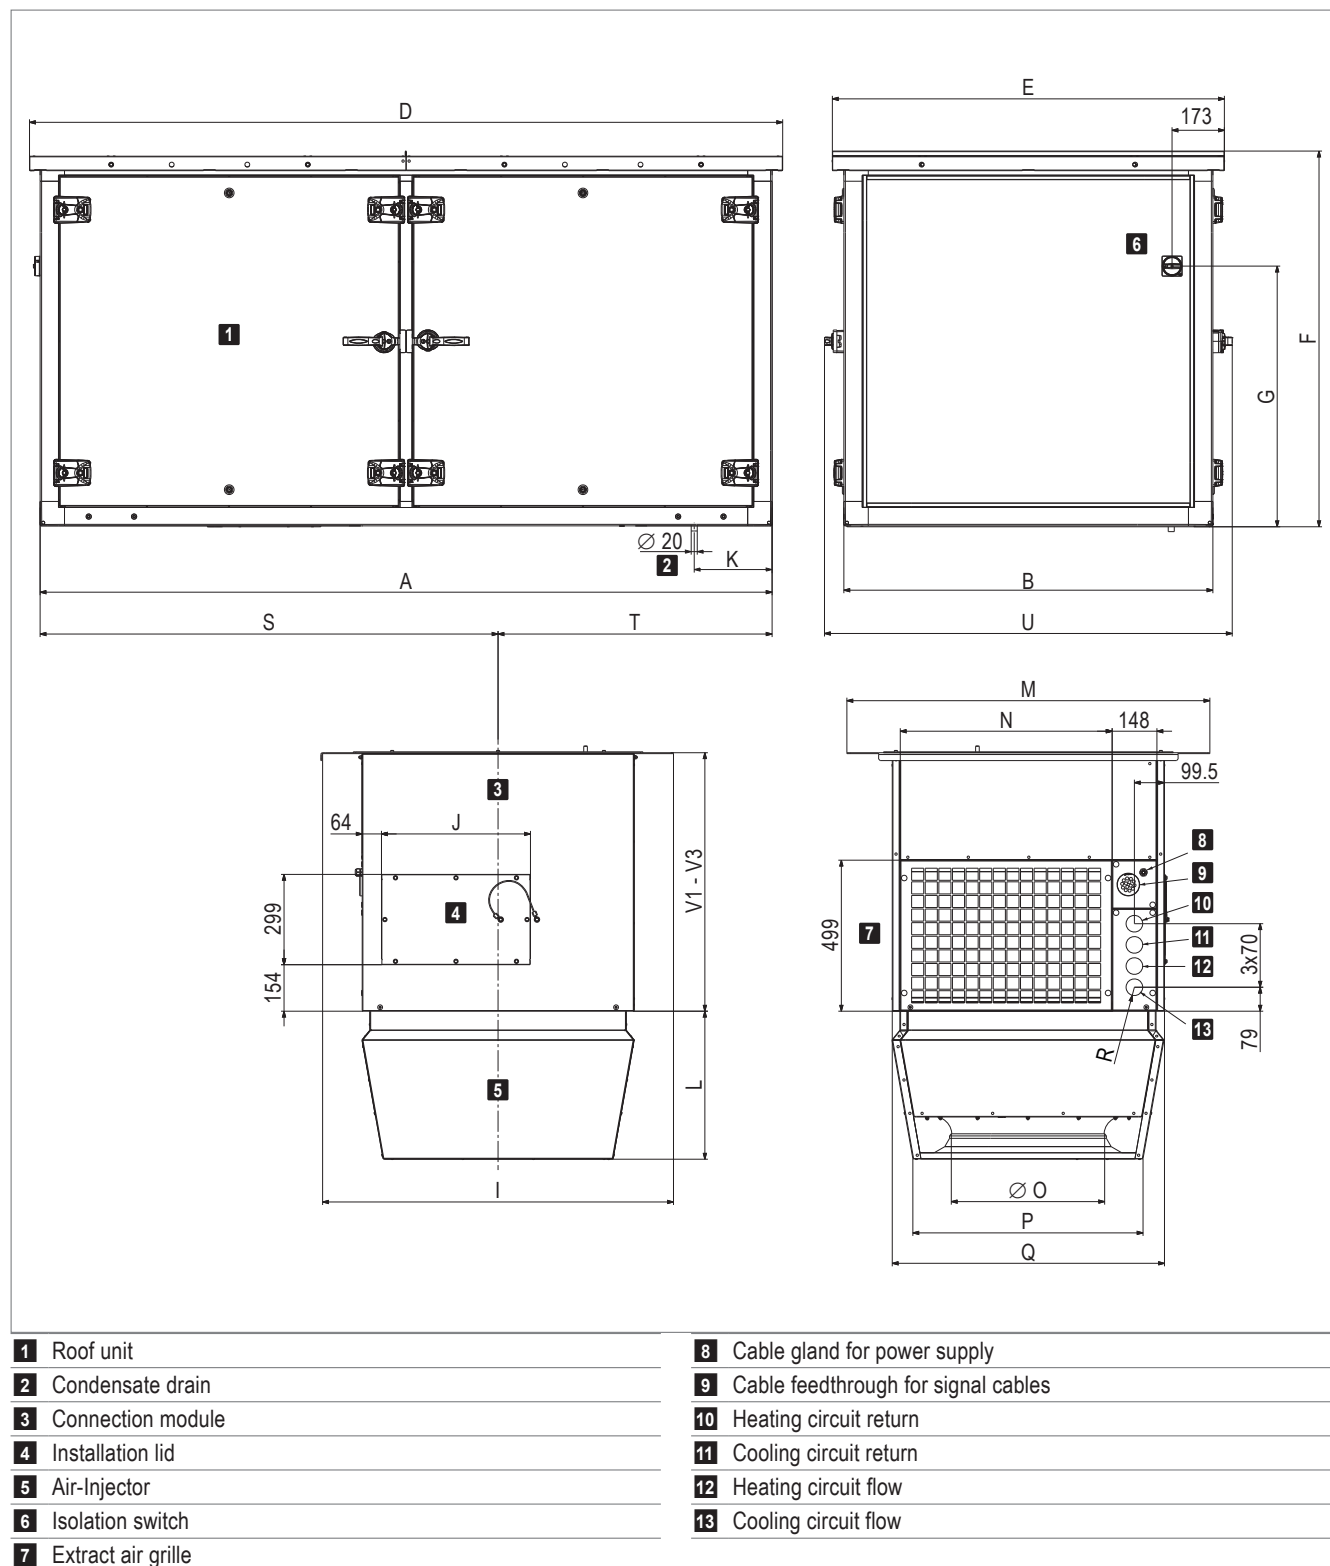


Table D11: Dimensional drawing for TopVent® CHC with hydraulic assembly throttling circuit (dimensions in mm)

Unit type		CHC-6	CHC-9
A	mm	2420	2725
B	mm	1220	1420
D	mm	2490	2795
E	mm	1290	1490
F	mm	1239	1439
G	mm	862	962
I	mm	1160	1360
J	mm	492	492
K	mm	257	292
L	mm	490	570
M	mm	1200	1400
N	mm	701	901
Ø O	mm	500	630
P	mm	767	937
Q	mm	900	1100
R (internal thread) ¹⁾	"	G 1½	G 1½
S	mm	1514	1684
T	mm	906	1041
U	mm	1348	1548
V1	mm	850	850
V2	mm	1300	1300
V3	mm	1750	1750

¹⁾ TopVent® units without hydraulic assembly: pipe outlets Ø 55 mm

Table D12: TopVent® CHC dimensions

Unit type	CHC-	6AC	6BC	6CC	9AC	9BC	9CC	9AD	9BD	9CD
Total	kg	678	677	684	867	866	879	886	885	898
Roof unit	kg	536	535	542	685	684	697	704	703	716
Below-roof unit	kg	142	142	142	182	182	182	182	182	182
Air-Injector	kg	40	40	40	57	57	57	57	57	57
Connection module V1	kg	102			125					
Additional weight V2	kg	+ 42			+ 50					
Additional weight V3	kg	+ 85			+ 101					

Table D13: TopVent® CHC weights

Heating section		6 A	6B	6C	9 A	9B	9C
Connection (internal thread)	"	Rp 1¼	Rp 1¼	Rp 1¼	Rp 1½	Rp 1½	Rp 1½
Water content of the coil	l	4.6	4.6	7.9	7.4	7.4	12.4

Table D14: Hydraulic connection of the heating section in the roof unit (without hydraulic assembly)

Cooling section		6-C	9-C	9-D
Y (internal thread)	"	Rp 1¼	Rp 1½	Rp 2
Water content of the coil	l	7.9	12.4	19.2

Table D15: Hydraulic connection of the cooling section in the roof unit (without hydraulic assembly)

4 Specification texts

4.1 TopVent® CHC

Recirculation unit for heating and cooling rooms up to 25 m in height with central heat and cold supply (4-pipe system); configured as roof unit; equipped with highly efficient air distributor.

The unit consists of the following components:

- Roof unit (with access to all components relevant for maintenance)
- Below-roof unit, consisting of:
 - Connection module
 - Air-Injector
- Optional components

The TopVent® CHC unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of energy-related products. It is a system of the “fan coil unit” type, provided for in Commission Regulation (EU) 2016/2281.

Roof unit

Self-supporting casing, construction made of thermally decoupled aluminium profile frame system with nylon connecting elements and panels made of coated zinc sheet (anthracite grey, similar to RAL 7016), additional rain canopy made of aluminium:

- Weatherproof, corrosion resistant, impact resistant, air-tight
- Low flammability, double-shelled, without heat bridges, with highly efficient insulation made of expanded polystyrene
- Hygienic and easy to maintain because of smooth interior surfaces and large access doors with ageing-resistant, silicone-free sealing materials

The roof unit includes:

Fan

Configured as maintenance-free, directly driven radial fan with high-efficiency EC motor, backwards-curved, 3D contoured blades and free-running rotor made of a high-performance composite material, aerodynamically optimised inflow nozzle, low-noise, with integrated overload protection.

Heating section

The heating section contains:

- The highly efficient heating coil consisting of seamless copper pipes with pressed-on, optimised and profiled aluminium fins and manifolds made of copper; for connection to the hot water supply

Cooling section

The cooling section contains:

- The highly efficient cooling coil consisting of seamless copper pipes with pressed-on, optimised and profiled aluminium fins and manifolds made of copper; for connection to the cold water supply
- The pull-out condensate separator with collecting channel, made of high-quality corrosion-resistant material, with a downslope in all directions for rapid draining
- the condensate drain on the roof via siphon

Extract air filter

Pleated cell filter of filter class ePM₁ 55% according to ISO 16890, consisting of micro glass with synthetic lamination as handle protection, pleat pack completely encapsulated to prevent leakage, frame made of recycled plastic, fully incinerable, including differential pressure switch for filter monitoring.

Unit control box

Control box for connection of the power supply and housing the control components that facilitate energy-optimised operation, controlled by the control system TopTronic® C. Plastic casing, protection rating IP56. The following components are installed:

- Circuit board with all required electrical components, unit controller (clipped on) as well as connection terminals for all internal and the following external connections:
 - Heating and cooling valve
 - Heating and cooling pump
 - Door contact

The circuit board is fitted with push-in terminals facilitating easy installation of the connection cables. All components in the unit control box as well as sensors, actuators in the unit and the isolation switch attached to the outside of the unit are fully factory-wired.

Power supply, bus connection, connection to Air-Injector actuator to be installed on site

Access openings

Defined side walls of the roof unit configured as inspection doors for easy access to all components relevant for maintenance. The hinges allow opening with an opening angle of 90° or complete removal of the inspection doors.

Below-roof unit

Connection module V1

Housing made of magnesium zinc sheet, air-tight, flame retardant, with highly efficient insulation made of expanded polystyrene, hygienic and easy to maintain because of smooth interior surfaces and ageing-resistant, silicone-free sealing materials; configured with:

- Extract air grille
- Cable feedthroughs for the electric supply
- Pipe feedthroughs for the hydraulic supply

Installation and insulation of the pipelines on site

Connection module V2 / V3 (variant)

The connection module is extended for adapting to the local installation situation.

Design with Air-Injector

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, internally insulated with closed-cell polyethylene foam, with:

- Vortex air distributor with concentric outlet nozzle, adjustable vanes and integrated absorber hood
- Actuator for infinitely variable adjustment of the air distribution from vertical to horizontal
 - for draught-free air distribution in the hall under changing operating conditions
 - for the rapid and large-area reduction of temperature stratification in the room through induction of secondary air and strong mixing of the room air with supply air

Actuator installed in the connection module for easy access from the roof.

Design without Air-Injector (variant)

Unit configured without vortex air distributor for connection to an on-site supply air duct and air distribution within the building.

Air distribution box (variant)

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, insulated on the inside with closed-cell polyethylene foam; configured with 2 collars as connecting piece to the on-site air distribution system.

Options for the unit

Paint finish of below-roof unit

Exterior painting of the below-roof unit in choice of RAL colour.

Supply air silencer

Designed as a sound-absorbing mat made of melamine foam; hygienically perfect with carbon fibre coating; mounted in the roof unit; insertion loss 3 dB.

Hydraulic assembly throttling circuit

Assembly for hydraulic throttling circuit, sized for the coil in the unit and the Hoval TopTronic® C, consisting of:

- Control valve with volume flow presetting, ball valve and automatic air vent, installed and wired in the roof unit
- Pre-insulated corrugated pipelines installed in the below-roof unit for connection to the distribution network

Pipelines in the roof unit and in the below-roof unit to be connected on site, pipelines in the roof unit to be insulated on site

Pump control

Electrical components for controlling a mixing or injection circuit in the load circuit, factory-installed in the unit control box.

Roof frame

Consisting of 4 load-bearing side walls made of galvanised sheet steel with fastening rails for the roof foil, supplied loose with the matching connecting screws.

Assembly, insulation, integration in the roof structure on site.

4.2 TopTronic® C – System control

Zone-based control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size per system bus: 64 control zones with up to 10 supply and extract air handling units or supply air units and 10 recirculation units each.

Zone allocation

Configured in advance for the customer at the factory:

	Room designation	Unit type
Zone 1:	_____	_____
Zone 2:	_____	_____
...		

System structure

- Zone control panel made of coated sheet steel (light grey RAL 7035), ... x ... x ... mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - 1 zone controller and 1 room temperature sensor per zone (expandable to up to 4 room temperature sensors per zone)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in one control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Heating/cooling demand per zone with feedback monitoring

Functions, standard

- Zone-based autonomous room control. Temperature and ventilation control separately adjustable for each zone
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time
- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution

- Main operating modes of supply and extract air handling units:

VE Ventilation, infinitely variably adjustment

AQ.... Air quality, automatic control with Hoval combination sensor (option), optional reference variable:

- CO₂ or VOC
- Air humidity (optimised dehumidification mode)

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

EA Exhaust air, infinitely variably adjustment

SA Supply air, infinitely variably adjustment

ST Standby

- Main operating modes of supply air units:

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

SA Supply air, infinitely variably adjustment

With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC

ST Standby

- Main operating modes of recirculation units:

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

ST Standby

- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)
- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- TopTronic® C-ZT as zone operator terminal: for simple on-site operation of a control zone
- Manual operating selector switches
- Manual operating selector buttons
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP
 - Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Alarm lamp
- Socket

Per zone:

- The change-over between heating and cooling can be either automatic or manual
 - Cooling lock switch for automatic changeover
 - Heating/cooling switch for manual changeover
- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Combination sensor fresh air temperature and humidity
- Transfer of actual values and setpoints from external systems (0-10 V; 4-20 mA)
- Load shedding input
- Signal for external extract air fan
- Operating selector switches on terminal
- Operating selector button on terminal
- Control of distributor pump, incl. power supply
- Control box TW Pro

Power distribution:

- Circuit breakers and output terminals for Hoval indoor climate units
- Safety relay (4-pin)

4.3 TopTronic® C – Single zone control panel

Control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size: 1 control zone with up to 10 supply and extract air handling units or supply air units and 10 recirculation units.

System structure

- Zone control panel, designed as compact cabinet for wall installation, made of coated sheet steel (light grey RAL 7035), 380 × 300 × 210 mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - Zone controller
 - 1 Room temperature sensor (expandable to up to 4 room temperature sensors)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in the control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Circuit board with external connections for:
 - Power supply
 - Zone bus
 - Room temperature sensors (max. 4)
 - Fresh air temperature sensor
 - Combination sensor room air quality, temperature and humidity
 - Collective alarm
 - Forced off
 - Heating demand
 - Setpoint heating demand
 - Fault heat supply
 - Cooling demand
 - Fault cold supply
 - External enabling heating/cooling (for automatic changeover)
 - External setting heating/cooling (for manual changeover)
 - Changeover valves heating/cooling
 - External setpoint fresh air ratio
 - Operating selector switch on terminal (digital)
 - Operating selector button on terminal

Functions, standard

- Room temperature control via sequential control of the coils
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time

- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution
- Main operating modes of supply and extract air handling units:
 - VE Ventilation, infinitely variably adjustment
 - AQ.... Air quality, automatic control with Hoval combination sensor (option), optional reference variable CO₂ or VOC
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - EA Exhaust air, infinitely variably adjustment
 - SA Supply air, infinitely variably adjustment
 - ST Standby
- Main operating modes of supply air units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - SA Supply air, infinitely variably adjustment
 - With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC
 - ST Standby
- Main operating modes of recirculation units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - ST Standby
- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)
- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP

- Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Signal for external extract air fan
- Control box TW Pro

4.4 HovalSupervisor cloud TopTronic® C

(Terms of use according to www.hoval.com/hsc are accepted when ordered.)

HovalSupervisor cloud TopTronic® C

Remote access, visualisation, historization, trends, evaluations and alarming for Hoval indoor climate systems with TopTronic® C control

- Project-specific system engineering
- Visualisation of the system statuses, error messages, actual and nominal values of the entire plant system
- Graphical display of the entire plant control system, in order to complete an analysis of sequences and subsequently to be able to perform an optimisation
- Integrated continuous line recorder for a period of 3 years
- Integrated alarm management
- Multi-user system: simultaneous access, 2 users included per plant
- Max. 300 data points historicized
- Max. 10 control zones

Consisting of:

- Project-specific engineering of the visualisation as described above
- Industrial router for connecting the TopTronic® C control system
 - Metal casing installed in the zone control panel
 - Without SIM card, free choice of phone network
 - Router configuration possible via web server
 - Network connections:
 - 2 x 10/100 Mbit Ethernet
 - 2 x SIM card slot
 - SMA connections:
 - 1 x WLAN
 - 2 x mobile data via integrated antenna
 - Power supply for industrial router installed in zone control panel

HovalSupervisor cloud TopTronic® C subscription

Subscription for use of the HovalSupervisor cloud for visualisation of a TopTronic® C system

- 1 year term (subscription billed once a year)
- Use of the HovalSupervisor cloud and storage of the data in the cloud
- Paid support during business hours (only for the software, not for the system)
- The respective valid conditions of use and the service level agreement (SLA) apply, which can be retrieved online.

Options for HovalSupervisor cloud

- Antenna to improve mobile data reception in conjunction with the HovalSupervisor cloud TopTronic® C
 - Antenna with mounting bracket for on-site installation outside the TopTronic® C zone control panel
 - 2G/3G/4G-LTE/5G-ready
 - SMA port available on the antenna
- Antenna extension cable for connecting the antenna in conjunction with the HovalSupervisor cloud
 - SMA port
 - Double shielded
 - Length: 5 m



TopVent® SH

Supply air unit configured as roof unit for ventilating and heating spaces up to 25 m in height with central heat supply

1 Use	.60
2 Construction and operation	.60
3 Technical data	.64
4 Specification texts	.70

1 Use

1.1 Intended use

TopVent® SH is a supply air unit for ventilating and heating spaces up to 25 m in height with central heat supply. It fulfils the following functions:

- Heating (with connection to a hot water supply)
- Fresh air supply
- Mixed air operation
- Recirculation operation
- Air distribution and destratification with adjustable Air-Injector
- Air filtration

TopVent® SH size 9 units can be optionally equipped with evaporative cooling for direct adiabatic cooling of the supply air flow.

TopVent® SH is configured as a roof unit. It is installed in the roof to save space and does not protrude far into the room. Maintenance work is carried out from the roof without causing disruption to operations in the building.

The TopVent® SH unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of ventilation systems. It is a system of the “non-residential ventilation unit” (NRVU) and “unidirectional ventilation unit” (UVU) type, provided for in Commission Regulation (EU) 1253/2014.

The Hoval TopTronic® C integrated control system ensures energy-efficient, demand-based operation of Hoval indoor climate systems.

Intended use also includes compliance with the operating instructions. Any usage over and above this use is considered to be not as intended. The manufacturer can accept no liability for damage resulting from improper use.

1.2 User group

The units are only allowed to be installed, operated and maintained by authorised and instructed personnel who are well acquainted with the units and are informed about possible dangers.

2 Construction and operation

2.1 Construction

The TopVent® SH unit consists of the following components:

Roof unit

The self-supporting housing for mounting on the roof frame is of double-shell construction; this ensures good thermal insulation and high stability. The roof unit includes the following components:

- Fan
 - Heating section
 - Coil for heating the supply air with hot water
 - Fresh air and extract air filters
 - Control dampers
 - Unit control box (part of the TopTronic® C control system)
- All components are easily accessible for maintenance work through large access openings. A protection hood protects the fresh air inlet from strong winds and snowfall (supplied loose for assembly on site).


Below-roof unit

The below-roof unit comprises the following components:

- Connection module:


The connection module serves as an air duct through the roof and for drawing in extract air from the hall through the extract air grille. To enable easy adaptation to local installation conditions, the connection module is available in 3 lengths.
- Air-Injector:

The Air-Injector is a patented, infinitely variable vortex air distributor for the draught-free introduction of air into the hall under changing operating conditions.

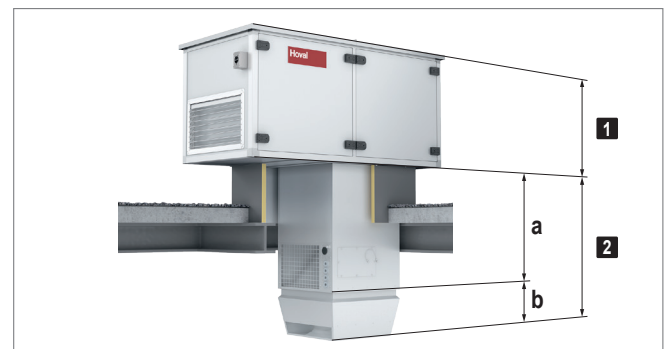

- 1 Roof unit
- 2 Below-roof unit
 - a Connection module
 - b Air-Injector


Fig. E1: TopVent® SH components

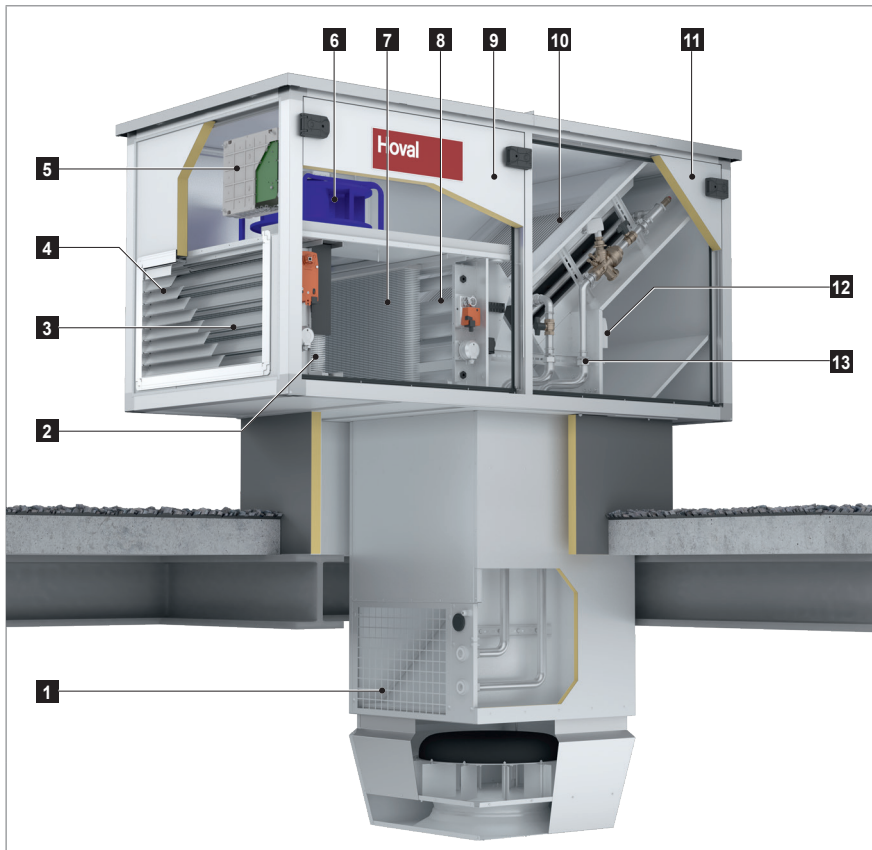

- | | |
|----|---------------------------------------|
| 1 | Extract air grille |
| 2 | Fresh air filter |
| 3 | Fresh air damper |
| 4 | Weather protection |
| 5 | Unit control box |
| 6 | Fan |
| 7 | Extract air filter |
| 8 | Recirculation damper |
| 9 | Fan access door |
| 10 | Heating coil |
| 11 | Hydraulic connection access door |
| 12 | Frost controller |
| 13 | Hydraulic assembly throttling circuit |

Fig. E2: TopVent® SH construction

2.2 Function diagram

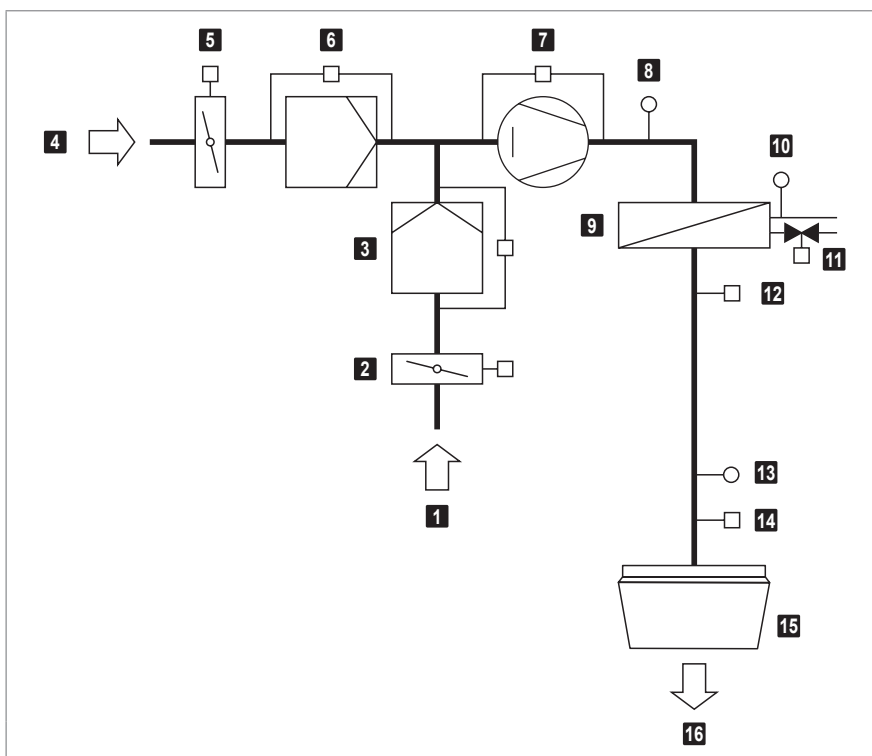

- | | |
|----|--|
| 1 | Extract air |
| 2 | Recirculation damper with actuator |
| 3 | Extract air filter with differential pressure switch |
| 4 | Fresh air |
| 5 | Fresh air damper with actuator |
| 6 | Fresh air filter with differential pressure switch |
| 7 | Fan with flow rate monitoring |
| 8 | Mixed air temperature sensor |
| 9 | Heating coil |
| 10 | Return temperature sensor |
| 11 | Control valve with actuator (option) |
| 12 | Frost controller |
| 13 | Supply air temperature sensor |
| 14 | Actuator Air-Injector |
| 15 | Air-Injector |
| 16 | Supply air |

Fig. E3: TopVent® SH function diagram



2.3 Operating modes

TopVent® SH operates in the following modes:

- Supply air speed 2
- Supply air speed 1
- Recirculation
- Recirculation speed 1
- Standby

The TopTronic® C control system regulates these operating modes automatically for each control zone in accordance with the specifications in the calendar. The following points also apply:

- The operating mode of a control zone can be switched over manually.
- Each TopVent® SH unit can operate individually in a local operating mode: Off, Supply air speed 2, Supply air speed 1, Recirculation, Recirculation speed 1

Code	Operating mode		Description
SA2	Supply air speed 2 The fan runs at speed 2 (high air flow rate). The room temperature set value day is active. The unit blows fresh air into the room. The control of the fresh air ratio can be selected:		
	<u>Fixed fresh air ratio:</u> The unit operates continuously with the set fresh air ratio. The system controls the heating according to the heating demand.		Fan speed 2 Fresh air damper..... 10 % open ¹⁾ Heating 0-100 % ²⁾ ¹⁾ Percentage is adjustable ²⁾ Depending on heat demand
	<u>Variable fresh air ratio:</u> ■ The system regulates the fresh air ratio depending on the temperature. The set fresh air ratio serves as a minimum value. If the temperature conditions permit, more fresh air is brought into the room and used for free heating or free cooling. Only when this potential is fully utilised is the heating switched on via the coil if required. ■ If a combination sensor for room air is installed (option), the system additionally controls the fresh air ratio depending on the air quality: – If there is no heat demand, the fresh air damper is opened 100% if the indoor air quality is too poor. – When the setpoint value for the CO₂ or VOC content of the room air is reached, the fresh air damper closes again to the set minimum value.		Fan speed 2 Fresh air damper..... MIN-100 % open ¹⁾ Heating 0-100 % ²⁾ ¹⁾ A minimum value can be set ²⁾ Depending on heat demand
	 Notice In order to save heating energy, the unit only operates with the set minimum fresh air rate when heat is required.		
SA1	Supply air speed 1 The same as SA2, but the fan operates at speed 1 (low air flow rate)		Fan speed 1 Fresh air damper..... MIN-100 % open ¹⁾ Heating 0-100 % ¹⁾ Fixed or variable (see above)








Code	Operating mode		Description
REC	Recirculation On/off-operation: If heating is required, the unit draws in room air, heats it and blows it back into the room. The room temperature set value day is active.		Fan speed 1/2 ¹⁾ Fresh air damper..... closed Heating on ¹⁾ ¹⁾ Depending on heat demand
DES	■ Destratification: To avoid heat build-up under the ceiling, it may be appropriate to switch on the fan when there is no heat demand (either in permanent operation or in on/off operation depending on the temperature stratification, as desired).		Fan speed 2 Fresh air damper..... closed Heating off
REC1	Recirculation speed 1 The same as REC, but the unit operates only at speed 1 (low air flow rate)		Fan speed 1 Fresh air damper..... closed Heating on ¹⁾ ¹⁾ Depending on heat demand
DES	■ Destratification: The same as for REC, but the unit operates only at speed 1		Fan speed 1 Fresh air damper..... closed Heating off
ST	Standby The unit is ready for operation; the following operating modes are activated if required:		
CPR	■ Cooling protection: If the room temperature drops below the set value for cooling protection, the unit heats up the room in recirculation operation.		Fan speed 2 Fresh air damper..... closed Heating on
NCS	■ Night cooling: If the room temperature rises above the set value for night cooling and the current fresh air temperature permits it, the unit blows cool fresh air into the room and extracts warmer room air.		Fan speed 2 Fresh air damper..... open Heating off
L_OFF	Off (local operating mode) The unit is switched off; frost protection for the unit remains active.		Fan off Fresh air damper..... closed Heating off
–	Forced heating The unit draws in room air, warms it and blows it back into the room. Forced heating can be activated and set as required by the Hoval service technician. For example, it is suitable for heating the hall before taking the control system into operation or if the controller fails during the heating period.		Fan speed 2 ¹⁾ Fresh air damper..... closed ¹⁾ Heating on ¹⁾ ¹⁾ Adjustable by the Hoval service technician

Table E1: TopVent® SH operating modes

3 Technical data

3.1 Type code

	SH	-	6	B	-	...
Unit type						
TopVent® SH						
Unit size						
6 or 9						
Heating section						
A with coil type A						
B with coil type B						
C with coil type C						
Further options						

Table E2: TopVent® SH type code

3.2 Application limits

Extract air temperature		max.	°C	45
Moisture content of extract air		max.	g/kg	15
Fresh air temperature		min.	°C	-20
		max.	°C	45
Supply air temperature		max.	°C	60
Temperature of the heating medium		max.	°C	90
Pressure of the heating medium		max.	kPa	800
Air flow rate	Size 6:	min.	m³/h	3100
	Size 9:	min.	m³/h	5000
The units cannot be used in:				
■ Damp locations				
■ Places with a corrosive or aggressive environment				
■ Spaces with a large amount of dust				
■ Areas where there is danger of explosion				

Table E3: TopVent® SH application limits

3.3 Electrical connection

Unit type		SH-6	SH-9
Supply voltage	V AC	3 x 400	3 x 400
Permitted voltage tolerance	%	± 5	± 5
Frequency	Hz	50	50
Connected load	kW	2.23	3.33
Current consumption max.	A	4.17	5.87
Series fuse	A	13	13
Protection rating	-	IP54	IP54

Table E4: TopVent® SH electrical connections

3.4 Air flow rate

Unit type		SH-6	SH-9
Nominal air flow rate	m³/h	6000	9000
Floor area covered	m²	537	946

Table E5: TopVent® SH air flow rate

3.5 Air filtration

Filter	Fresh air / Extract air
Class acc. to ISO 16890	ISO ePM ₁ 55 %
Class acc. to EN 779	F7
Factory setting of differential pressure switches	300 Pa

Table E6: TopVent® SH air filtration

3.6 Sound level

Unit type			SH-6C		SH-9C	
			indoors	outdoors ¹⁾	indoors	outdoors ¹⁾
Sound pressure level (at a distance of 5 m) ²⁾		dB(A)	55	47	58	49
Total sound power level		dB(A)	77	69	80	71
Octave sound power level	63 Hz	dB	45	44	46	44
	125 Hz	dB	61	56	64	57
	250 Hz	dB	67	63	69	63
	500 Hz	dB	71	65	73	65
	1000 Hz	dB	74	60	77	64
	2000 Hz	dB	70	58	75	64
	4000 Hz	dB	66	57	71	61
		8000 Hz	dB	65	65	57

¹⁾ with fresh air ratio 10 %

²⁾ with a hemispherical radiation pattern in a low-reflection room

Table E7: TopVent® SH sound level

3.7 Heat output

Heating medium temperature			80/60 °C					60/40 °C				
Size	Type	t _F °C	Q kW	H _{max} m	t _S °C	Δp _W kPa	m _W l/h	Q kW	H _{max} m	t _S °C	Δp _W kPa	m _W l/h
SH-6	A	−5	33.1	14.4	33.9	7	1424	19.1	18.8	27.0	2	820
		−15	33.8	14.7	33.2	8	1451	19.7	19.5	26.3	3	848
	B	−5	47.5	12.1	41.0	13	2040	27.4	15.7	31.1	4	1177
		−15	48.4	12.2	40.5	14	2079	28.3	16.1	30.5	5	1216
	C	−5	76.8	9.7	55.5	18	3297	45.7	12.3	40.1	7	1965
		−15	78.2	9.7	55.2	19	3358	47.2	12.4	39.9	7	2026
SH-9	A	−5	56.1	14.4	36.0	8	2409	32.3	18.8	28.2	3	1387
		−15	57.1	14.6	35.4	8	2455	33.4	19.4	27.5	3	1433
	B	−5	71.9	12.8	41.2	12	3090	41.3	16.7	31.1	4	1775
		−15	73.3	12.9	40.7	13	3149	42.7	17.0	30.6	4	1834
	C	−5	119.0	10.1	56.8	18	5113	71.0	12.9	40.9	7	3050
		−15	121.2	10.1	56.5	19	5208	73.2	12.9	40.7	7	3145
Legend:	Type = Type of coil t _F = Fresh air temperature Q = Heat output H _{max} = Maximum mounting height t _S = Supply air temperature Δp _W = Water pressure drop m _W = Water quantity											
Reference:	■ Room air 18 °C, extract air 20 °C / 20 % rel. humidity ■ Fresh air ratio 10 %											

Table E8: TopVent® SH heat output

3.8 Product information according to ErP

Trademark / Model		Hoval TopVent® SH						Unit
		6A	6B	6C	9A	9B	9C	
Type		NRVU, UVU						–
Drive		Variable speed drive						–
Heat recovery system		none						–
Thermal efficiency of heat recovery (η_{t_nrvu})		–						%
Nominal flow rate (q_{nom})		1.67	1.67	1.67	2.50	2.50	2.50	m³/s
Effective electric power input (P)		0.88	0.91	0.99	1.57 1.83 ¹⁾	1.64 1.90 ¹⁾	1.77 2.04 ¹⁾	kW
Internal specific fan power (SFP_{int})		162	162	162	65	65	65	W/(m³/s)
Face velocity		3.106	3.106	3.106	3.273	3.273	3.273	m/s
Nominal external pressure ($\Delta p_{s, ext}$)	Supply air	0			0			Pa
	Extract air	–			–			
Internal pressure drop of ventilation components ($\Delta p_{s, int}$)	Fresh air/supply air	–			–			Pa
	Extract air/exhaust air	–			–			
Static efficiency of the fans (η_{fan}) in accordance with Regulation (EU) No 327/2011		69.0			63.6			%
Maximum leakage rate	External	≤ 1			≤ 1			%
	Internal	–			–			
Energy classification of the filters	Supply air ePM ₁ 55 %	D			D			–
	Extract air	–			–			
Visual filter warning		Displayed on the operating unit						–
Casing sound power level (L_{WA})		69			71 72 ¹⁾			dB(A)
Disassembly instructions		Devices that are no longer functional must be dismantled by a specialist company and disposed of at suitable collection points.						
Contact details		Hoval Aktiengesellschaft Austrasse 70, 9490 Vaduz, Liechtenstein www.hoval.com						

¹⁾ TopVent SH-9 with adiabatic cooling (option "AC" or "AV")

¹⁾ TopVent SH-9 with adiabatic cooling (option "AC" or "AV")

Table E9: Product information according to Commission Regulation (EU) 1253/2014, Article 4(2)

3.9 Dimensions and weights

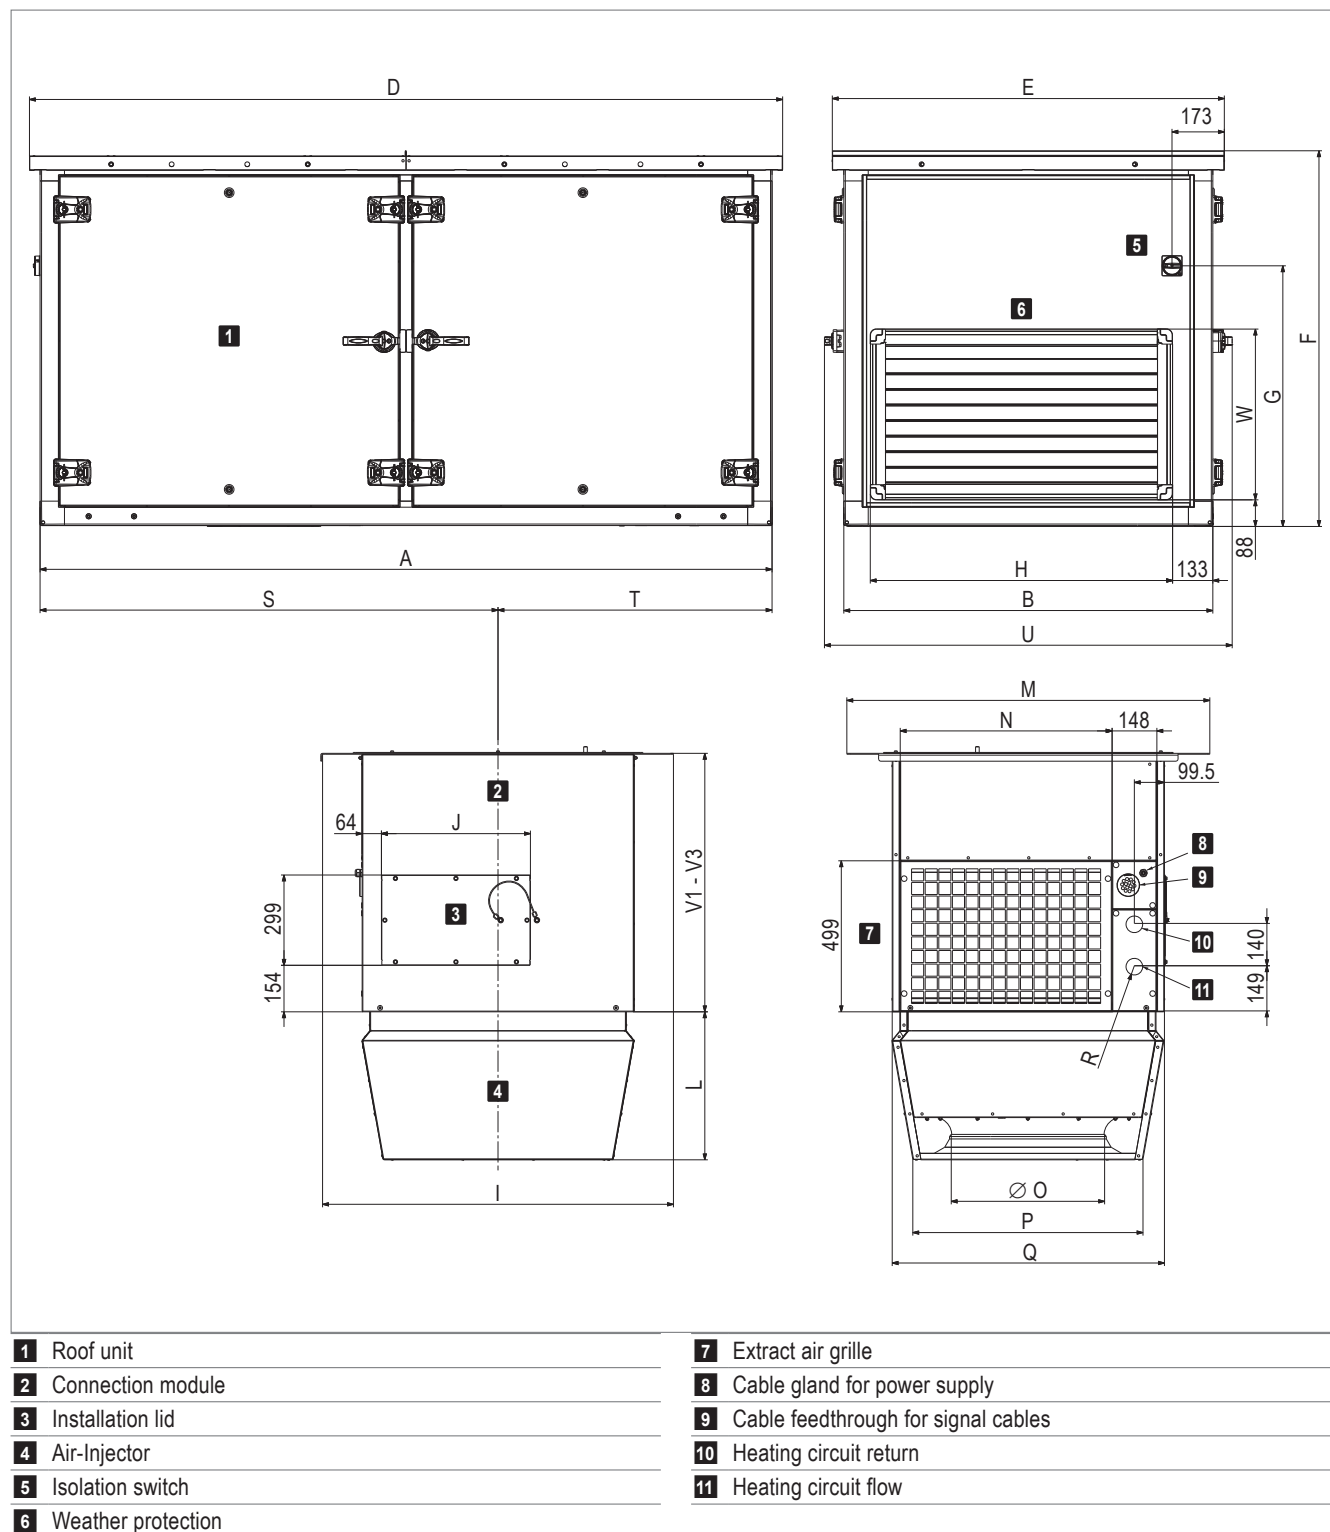


Table E10: Dimensional drawing for TopVent® SH with hydraulic assembly throttling circuit (dimensions in mm)

Unit type		SH-6	SH-9
A	mm	2420	2725
B	mm	1220	1420
D	mm	2490	2795
E	mm	1290	1490
F	mm	1239	1439
G	mm	862	962
H	mm	999	1199
I	mm	1160	1360
J	mm	492	492
L	mm	490	570
M	mm	1200	1400
N	mm	701	901
Ø O	mm	500	630
P	mm	767	937
Q	mm	900	1100
R (internal thread) ¹⁾	"	G 1½	G 1½
S	mm	1514	1684
T	mm	906	1041
U	mm	1348	1548
V1	mm	850	850
V2	mm	1300	1300
V3	mm	1750	1750
W	mm	565	664

¹⁾ TopVent® units without hydraulic assembly: pipe outlets Ø 55 mm

Table E11: TopVent® SH dimensions


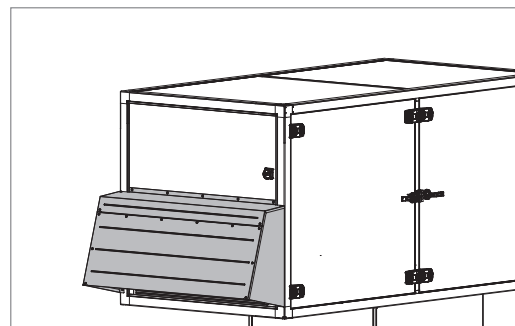


Fig. E4: Fresh air inlet with protection hood

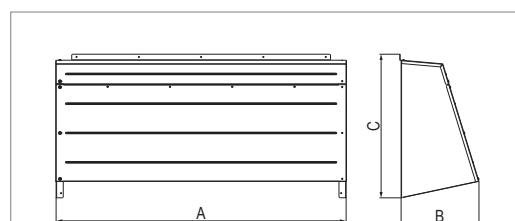

Size		6	9
A	mm	1220	1420
B	mm	377	381
C	mm	603	703
Weight	kg	11.2	13.6

Table E14: Protection hood dimensions and weights

Unit type	SH-	6 A	6B	6C	9 A	9B	9C
Total	kg	655	654	661	834	833	846
Roof unit	kg	513	512	519	652	651	664
Below-roof unit	kg	142	142	142	182	182	182
Air-Injector	kg	40	40	40	57	57	57
Connection module V1	kg	102			125		
Additional weight V2	kg	+ 42			+ 50		
Additional weight V3	kg	+ 85			+ 101		

Table E12: TopVent® SH weights

Heating section		6 A	6B	6C	9 A	9B	9C
Connection (internal thread)	"	Rp 1¼	Rp 1¼	Rp 1¼	Rp 1½	Rp 1½	Rp 1½
Water content of the coil	l	4.6	4.6	7.9	7.4	7.4	12.4

Table E13: Hydraulic connection of the heating section in the roof unit (without hydraulic assembly)

4 Specification texts

4.1 TopVent® SH

Supply air unit for ventilating and heating rooms up to 25 m in height with central heat supply; configured as roof unit; equipped with highly efficient air distributor.

The unit consists of the following components:

- Roof unit (with access to all components relevant for maintenance)
- Below-roof unit, consisting of:
 - Connection module
 - Air-Injector
- Optional components

The TopVent® SH unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of ventilation systems. It is a system of the “non-residential ventilation unit” (NRVU) and “unidirectional ventilation unit” (UVU) type, provided for in Commission Regulation (EU) 1253/2014.

Roof unit

Self-supporting casing, construction made of thermally decoupled aluminium profile frame system with nylon connecting elements and panels made of coated zinc sheet (anthracite grey, similar to RAL 7016), additional rain canopy made of aluminium:

- Weatherproof, corrosion resistant, impact resistant, air-tight
- Low flammability, double-shelled, without heat bridges, with highly efficient insulation made of expanded polystyrene
- Hygienic and easy to maintain because of smooth interior surfaces and large access doors with ageing-resistant, silicone-free sealing materials

The roof unit includes:

Fan

Configured as maintenance-free, directly driven radial fan with high-efficiency EC motor, backwards-curved, 3D contoured blades and free-running rotor made of a high-performance composite material, aerodynamically optimised inflow nozzle, low-noise, with integrated overload protection.

Heating section

The heating section contains:

- The highly efficient heating coil consisting of seamless copper pipes with pressed-on, optimised and profiled aluminium fins and manifolds made of copper; for connection to the hot water supply
- Frost controller

Fresh air filter

Pleated cell filter of filter class ePM₁ 55% according to ISO 16890, consisting of micro glass with synthetic lamination as handle protection, pleat pack completely encapsulated to prevent leakage, frame made of recycled plastic, fully incinerable, including differential pressure switch for filter monitoring.

Extract air filter

Pleated cell filter of filter class ePM₁ 55% according to ISO 16890, consisting of micro glass with synthetic lamination as handle protection, pleat pack completely encapsulated to prevent leakage, frame made of recycled plastic, fully incinerable, including differential pressure switch for filter monitoring.

Fresh air damper

Damper consisting of sheet steel blades with sealing lip and plastic gearwheels; tightness class 4 according to EN 1751; including actuator with shut-off function by spring return.

Recirculation damper

Damper consisting of sheet steel blades with plastic gearwheels; tightness class 2 according to EN 1751; including actuator.

Unit control box

Control box for connection of the power supply and housing the control components that facilitate energy-optimised operation, controlled by the control system TopTronic® C. Plastic casing, protection rating IP56. The following components are installed:

- Circuit board with all required electrical components, unit controller (clipped on) as well as connection terminals for all internal and the following external connections:
 - Heating valve
 - Heating pump
 - Forced off

The circuit board is fitted with push-in terminals facilitating easy installation of the connection cables. All components in the unit control box as well as sensors, actuators in the unit and the isolation switch attached to the outside of the unit are fully factory-wired.

Power supply, bus connection, connection to Air-Injector actuator to be installed on site

Access openings

Defined side walls of the roof unit configured as inspection doors for easy access to all components relevant for maintenance. The hinges allow opening with an opening angle of 90° or complete removal of the inspection doors.

Below-roof unit

Connection module V1

Housing made of magnesium zinc sheet, air-tight, flame retardant, with highly efficient insulation made of expanded polystyrene, hygienic and easy to maintain because of smooth interior surfaces and ageing-resistant, silicone-free sealing materials; configured with:

- Extract air grille
- Cable feedthroughs for the electric supply
- Pipe feedthroughs for the hydraulic supply

Installation and insulation of the pipelines on site

Connection module V2 / V3 (variant)

The connection module is extended for adapting to the local installation situation.

Design with Air-Injector

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, internally insulated with closed-cell polyethylene foam, with:

- Vortex air distributor with concentric outlet nozzle, adjustable vanes and integrated absorber hood
- Actuator for infinitely variable adjustment of the air distribution from vertical to horizontal
 - for draught-free air distribution in the hall under changing operating conditions
 - for the rapid and large-area reduction of temperature stratification in the room through induction of secondary air and strong mixing of the room air with supply air

Actuator installed in the connection module for easy access from the roof.

Design without Air-Injector (variant)

Unit configured without vortex air distributor for connection to an on-site supply air duct and air distribution within the building.

Air distribution box (variant)

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, insulated on the inside with closed-cell polyethylene foam; configured with 2 collars as connecting piece to the on-site air distribution system.

Options for the unit

Paint finish of below-roof unit

Exterior painting of the below-roof unit in choice of RAL colour.

Supply air silencer

Designed as a sound-absorbing mat made of melamine foam; hygienically perfect with carbon fibre coating; mounted in the roof unit; insertion loss 3 dB.

Hydraulic assembly throttling circuit

Assembly for hydraulic throttling circuit, sized for the coil in the unit and the Hoval TopTronic® C, consisting of:

- Control valve with volume flow presetting, ball valve and automatic air vent, installed and wired in the roof unit
- Pre-insulated corrugated pipelines installed in the below-roof unit for connection to the distribution network

Pipelines in the roof unit and in the below-roof unit to be connected on site, pipelines in the roof unit to be insulated on site

Pump control

Electrical components for controlling a mixing or injection circuit in the load circuit, factory-installed in the unit control box.

Roof frame

Consisting of 4 load-bearing side walls made of galvanised sheet steel with fastening rails for the roof foil, supplied loose with the matching connecting screws.

Assembly, insulation, integration in the roof structure on site.

Adiabatic cooling

Evaporative cooler for comfort improvement by means of direct adiabatic cooling at high fresh air temperatures. Supply valve and drain valve mounted and wired in the roof unit. On-site: Connection of the supply valve to a water supply line, connection of the water drain line to a waste water system.

Adiabatic cooling incl. control valve

Evaporative cooler for comfort improvement by means of direct adiabatic cooling at high fresh air temperatures. Supply valve and drain valve mounted and wired in the roof unit. Pre-adjustable pressure reducing valve supplied loose. On-site: Connection of the supply valve to a water supply line, connection of the water drain line to a waste water system. Installation of the pressure reducing valve in the water supply line.

4.2 TopTronic® C – System control

Zone-based control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size per system bus: 64 control zones with up to 10 supply and extract air handling units or supply air units and 10 recirculation units each.

Zone allocation

Configured in advance for the customer at the factory:

	Room designation	Unit type
Zone 1:	_____	_____
Zone 2:	_____	_____
...		

System structure

- Zone control panel made of coated sheet steel (light grey RAL 7035), ... x ... x ... mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - 1 zone controller and 1 room temperature sensor per zone (expandable to up to 4 room temperature sensors per zone)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in one control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Heating/cooling demand per zone with feedback monitoring

Functions, standard

- Zone-based autonomous room control. Temperature and ventilation control separately adjustable for each zone
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time
- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution

- Main operating modes of supply and extract air handling units:

VE Ventilation, infinitely variably adjustment

AQ.... Air quality, automatic control with Hoval combination sensor (option), optional reference variable:

- CO₂ or VOC
- Air humidity (optimised dehumidification mode)

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

EA Exhaust air, infinitely variably adjustment

SA Supply air, infinitely variably adjustment

ST Standby

- Main operating modes of supply air units:

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

SA Supply air, infinitely variably adjustment

With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC

ST Standby

- Main operating modes of recirculation units:

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

ST Standby

- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)
- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- TopTronic® C-ZT as zone operator terminal: for simple on-site operation of a control zone
- Manual operating selector switches
- Manual operating selector buttons
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP
 - Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Alarm lamp
- Socket

Per zone:

- The change-over between heating and cooling can be either automatic or manual
 - Cooling lock switch for automatic changeover
 - Heating/cooling switch for manual changeover
- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Combination sensor fresh air temperature and humidity
- Transfer of actual values and setpoints from external systems (0-10 V; 4-20 mA)
- Load shedding input
- Signal for external extract air fan
- Operating selector switches on terminal
- Operating selector button on terminal
- Control of distributor pump, incl. power supply
- Control box TW Pro

Power distribution:

- Circuit breakers and output terminals for Hoval indoor climate units
- Safety relay (4-pin)

4.3 TopTronic® C – Single zone control panel

Control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size: 1 control zone with up to 10 supply and extract air handling units or supply air units and 10 recirculation units.

System structure

- Zone control panel, designed as compact cabinet for wall installation, made of coated sheet steel (light grey RAL 7035), 380 × 300 × 210 mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - Zone controller
 - 1 Room temperature sensor (expandable to up to 4 room temperature sensors)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in the control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Circuit board with external connections for:
 - Power supply
 - Zone bus
 - Room temperature sensors (max. 4)
 - Fresh air temperature sensor
 - Combination sensor room air quality, temperature and humidity
 - Collective alarm
 - Forced off
 - Heating demand
 - Setpoint heating demand
 - Fault heat supply
 - Cooling demand
 - Fault cold supply
 - External enabling heating/cooling (for automatic changeover)
 - External setting heating/cooling (for manual changeover)
 - Changeover valves heating/cooling
 - External setpoint fresh air ratio
 - Operating selector switch on terminal (digital)
 - Operating selector button on terminal

Functions, standard

- Room temperature control via sequential control of the coils
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time

- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution
- Main operating modes of supply and extract air handling units:
 - VE Ventilation, infinitely variably adjustment
 - AQ.... Air quality, automatic control with Hoval combination sensor (option), optional reference variable CO₂ or VOC
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - EA Exhaust air, infinitely variably adjustment
 - SA Supply air, infinitely variably adjustment
 - ST Standby
- Main operating modes of supply air units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - SA Supply air, infinitely variably adjustment
 - With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC
 - ST Standby
- Main operating modes of recirculation units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - ST Standby
- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)
- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP
 - Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Signal for external extract air fan
- Control box TW Pro

4.4 HovalSupervisor cloud TopTronic® C

(Terms of use according to www.hoval.com/hsc are accepted when ordered.)

HovalSupervisor cloud TopTronic® C

Remote access, visualisation, historization, trends, evaluations and alarming for Hoval indoor climate systems with TopTronic® C control

- Project-specific system engineering
- Visualisation of the system statuses, error messages, actual and nominal values of the entire plant system
- Graphical display of the entire plant control system, in order to complete an analysis of sequences and subsequently to be able to perform an optimisation
- Integrated continuous line recorder for a period of 3 years
- Integrated alarm management
- Multi-user system: simultaneous access, 2 users included per plant
- Max. 300 data points historicized
- Max. 10 control zones

Consisting of:

- Project-specific engineering of the visualisation as described above
- Industrial router for connecting the TopTronic® C control system
 - Metal casing installed in the zone control panel
 - Without SIM card, free choice of phone network
 - Router configuration possible via web server
 - Network connections:
 - 2 x 10/100 Mbit Ethernet
 - 2 x SIM card slot
 - SMA connections:
 - 1 x WLAN
 - 2 x mobile data via integrated antenna
 - Power supply for industrial router installed in zone control panel

HovalSupervisor cloud TopTronic® C subscription

Subscription for use of the HovalSupervisor cloud for visualisation of a TopTronic® C system

- 1 year term (subscription billed once a year)
- Use of the HovalSupervisor cloud and storage of the data in the cloud
- Paid support during business hours (only for the software, not for the system)
- The respective valid conditions of use and the service level agreement (SLA) apply, which can be retrieved online.

Options for HovalSupervisor cloud

- Antenna to improve mobile data reception in conjunction with the HovalSupervisor cloud TopTronic® C
 - Antenna with mounting bracket for on-site installation outside the TopTronic® C zone control panel
 - 2G/3G/4G-LTE/5G-ready
 - SMA port available on the antenna
- Antenna extension cable for connecting the antenna in conjunction with the HovalSupervisor cloud
 - SMA port
 - Double shielded
 - Length: 5 m



TopVent® SC

Supply air unit configured as roof unit for ventilating, heating and cooling spaces up to 25 m in height with central heat and cold supply (2-pipe-system)

1 Use	.78
2 Construction and operation	.78
3 Technical data	.82
4 Specification texts	.88

1 Use

1.1 Intended use

TopVent® SC is a supply air unit for ventilating, heating and cooling spaces up to 25 m in height with central heat and cold supply. It fulfils the following functions:

- Heating (with connection to a hot water supply)
- Cooling (with connection to a water chiller)
- Fresh air supply
- Mixed air operation
- Recirculation operation
- Air distribution and destratification with adjustable Air-Injector
- Air filtration

TopVent® SC is configured as a roof unit. It is installed in the roof to save space and does not protrude far into the room. Maintenance work is carried out from the roof without causing disruption to operations in the building.

The TopVent® SC unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of ventilation systems. It is a system of the “non-residential ventilation unit” (NRVU) and “unidirectional ventilation unit” (UVU) type, provided for in Commission Regulation (EU) 1253/2014.

The Hoval TopTronic® C integrated control system ensures energy-efficient, demand-based operation of Hoval indoor climate systems.

Intended use also includes compliance with the operating instructions. Any usage over and above this use is considered to be not as intended. The manufacturer can accept no liability for damage resulting from improper use.

1.2 User group

The units are only allowed to be installed, operated and maintained by authorised and instructed personnel who are well acquainted with the units and are informed about possible dangers.

2 Construction and operation

2.1 Construction

The TopVent® SC unit consists of the following components:

Roof unit

The self-supporting housing for mounting on the roof frame is of double-shell construction; this ensures good thermal insulation and high stability. The roof unit includes the following components:

- Fan
 - Heating/cooling section
 - Coil for heating and cooling the supply air with hot water or cold water
 - Condensate separator
 - Fresh air and extract air filters
 - Control dampers
 - Unit control box (part of the TopTronic® C control system)
- All components are easily accessible for maintenance work through large access openings. A protection hood protects the fresh air inlet from strong winds and snowfall (supplied loose for assembly on site).

Below-roof unit

The below-roof unit comprises the following components:

- Connection module:

The connection module serves as an air duct through the roof and for drawing in extract air from the hall through the extract air grille. To enable easy adaptation to local installation conditions, the connection module is available in 3 lengths.
- Air-Injector:

The Air-Injector is a patented, infinitely variable vortex air distributor for the draught-free introduction of air into the hall under changing operating conditions.


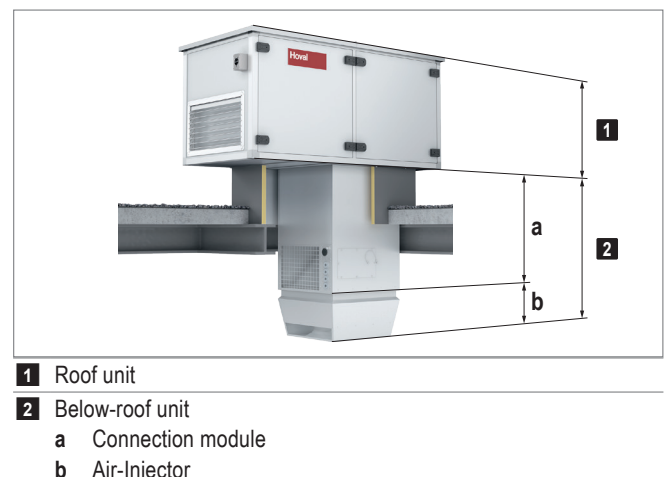



Fig. F1: TopVent® SC components

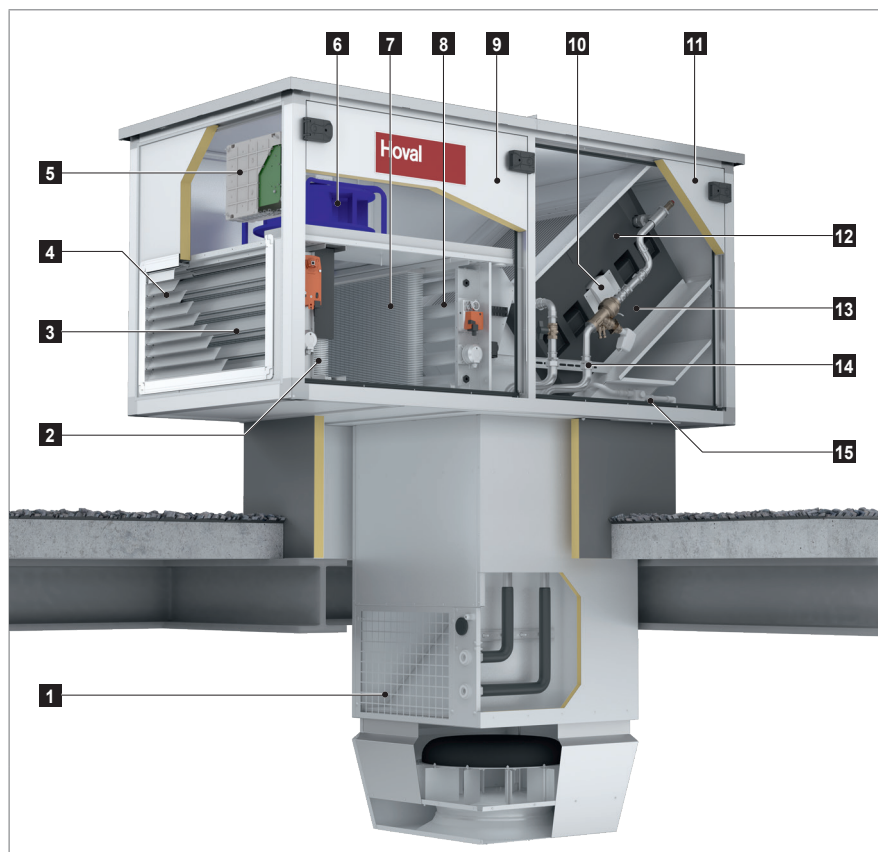

- | | |
|----|---------------------------------------|
| 1 | Extract air grille |
| 2 | Fresh air filter |
| 3 | Fresh air damper |
| 4 | Weather protection |
| 5 | Unit control box |
| 6 | Fan |
| 7 | Extract air filter |
| 8 | Recirculation damper |
| 9 | Fan access door |
| 10 | Frost controller |
| 11 | Hydraulic connection access door |
| 12 | Heating/cooling coil |
| 13 | Condensate separator |
| 14 | Hydraulic assembly throttling circuit |
| 15 | Condensate drain |

Fig. F2: TopVent® SC construction

2.2 Function diagram

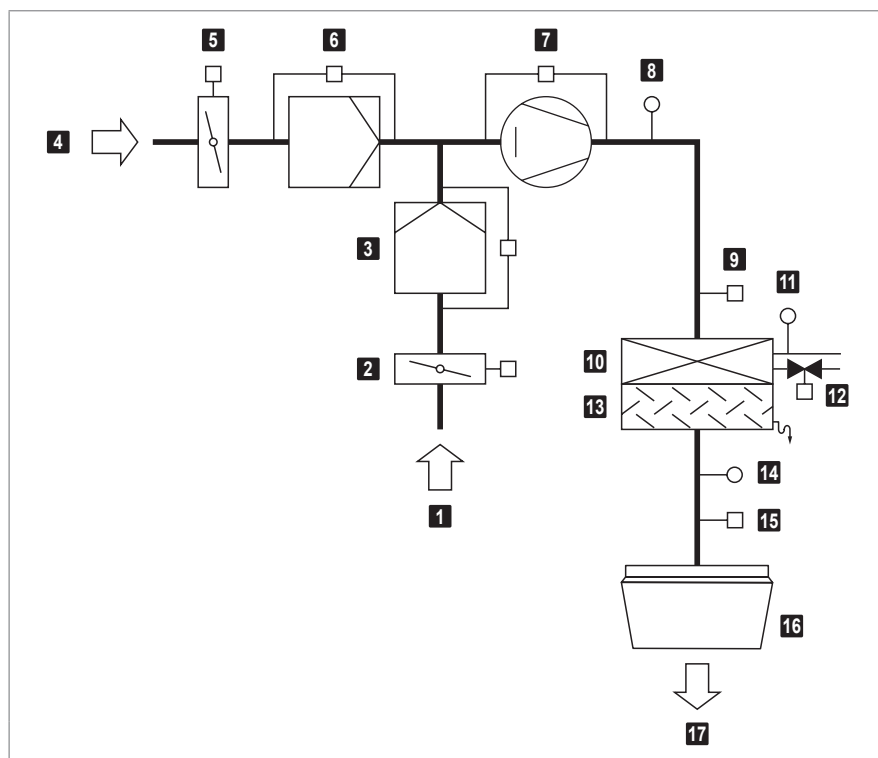

- | | |
|----|--|
| 1 | Extract air |
| 2 | Recirculation damper with actuator |
| 3 | Extract air filter with differential pressure switch |
| 4 | Fresh air |
| 5 | Fresh air damper with actuator |
| 6 | Fresh air filter with differential pressure switch |
| 7 | Fan with flow rate monitoring |
| 8 | Mixed air temperature sensor |
| 9 | Frost controller |
| 10 | Heating/cooling coil |
| 11 | Return temperature sensor |
| 12 | Control valve with actuator (option) |
| 13 | Condensate separator |
| 14 | Supply air temperature sensor |
| 15 | Actuator Air-Injector |
| 16 | Air-Injector |
| 17 | Supply air |

Fig. F3: TopVent® SC function diagram



2.3 Operating modes

TopVent® SC operates in the following modes:

- Supply air speed 2
- Supply air speed 1
- Recirculation
- Recirculation speed 1
- Standby

The TopTronic® C control system regulates these operating modes automatically for each control zone in accordance with the specifications in the calendar. The following points also apply:

- The operating mode of a control zone can be switched over manually.
- Each TopVent® SC unit can operate individually in a local operating mode: Off, Supply air speed 2, Supply air speed 1, Recirculation, Recirculation speed 1

Code	Operating mode		Description
SA2	Supply air speed 2 The fan runs at speed 2 (high air flow rate). The room temperature set value day is active. The unit blows fresh air into the room. The control of the fresh air ratio can be selected:		
	<u>Fixed fresh air ratio:</u> The unit operates continuously with the set fresh air ratio. The system controls the heating/cooling according to the heating/cooling demand.		Fan speed 2 Fresh air damper..... 10 % open ¹⁾ Heating/cooling 0-100 % ²⁾ ¹⁾ Percentage is adjustable ²⁾ Depending on heat or cool demand
	<u>Variable fresh air ratio:</u> ■ The system regulates the fresh air ratio depending on the temperature. The set fresh air ratio serves as a minimum value. If the temperature conditions permit, more fresh air is brought into the room and used for free heating or free cooling. Only when this potential is fully utilised is the heating/cooling switched on via the coil if required. ■ If a combination sensor for room air is installed (option), the system additionally controls the fresh air ratio depending on the air quality: – If there is no heat demand, the fresh air damper is opened 100% if the indoor air quality is too poor. – When the setpoint value for the CO₂ or VOC content of the room air is reached, the fresh air damper closes again to the set minimum value.		Fan speed 2 Fresh air damper..... MIN-100 % open ¹⁾ Heating/cooling 0-100 % ²⁾ ¹⁾ A minimum value can be set ²⁾ Depending on heat or cool demand
	 Notice In order to save heating energy, the unit only operates with the set minimum fresh air rate when heat is required.		
SA1	Supply air speed 1 The same as SA2, but the fan operates at speed 1 (low air flow rate)		Fan speed 1 Fresh air damper..... MIN-100 % open ¹⁾ Heating/cooling 0-100 % ¹⁾ Fixed or variable (see above)








Code	Operating mode		Description
REC	Recirculation On/Off operation: during heat or cool demand, the unit draws in room air, heats or cools it and blows it back into the room. The room temperature set value day is active.		Fan speed 1/2 ¹⁾ Fresh air damper closed Heating/cooling on ¹⁾ ¹⁾ Depending on heat or cool demand
DES	■ Destratification: To avoid heat build-up under the ceiling, it may be appropriate to switch on the fan when there is no heat or cool demand (either in permanent operation or in on/off operation depending on the temperature stratification, as desired).		Fan speed 2 Fresh air damper closed Heating/cooling off
REC1	Recirculation speed 1 The same as REC, but the unit operates only at speed 1 (low air flow rate)		Fan speed 1 Fresh air damper closed Heating/cooling on ¹⁾ ¹⁾ Depending on heat or cool demand
DES	■ Destratification: The same as for REC, but the unit operates only at speed 1		Fan speed 1 Fresh air damper closed Heating/cooling off
ST	Standby The unit is ready for operation; the following operating modes are activated if required:		
CPR	■ Cooling protection: If the room temperature drops below the set value for cooling protection, the unit heats up the room in recirculation operation.		Fan speed 2 Fresh air damper closed Heating on
OPR	■ Overheating protection: If the room temperature rises above the set value for overheating protection, the unit cools down the room in recirculation operation.		Fan speed 2 Fresh air damper closed Cooling on
NCS	■ Night cooling: If the room temperature rises above the set value for night cooling and the current fresh air temperature permits it, the unit blows cool fresh air into the room and extracts warmer room air.		Fan speed 2 Fresh air damper open Heating/cooling off
L_OFF	Off (local operating mode) The unit is switched off; frost protection for the unit remains active.		Fan off Fresh air damper closed Heating/cooling off
–	Forced heating The unit draws in room air, warms it and blows it back into the room. Forced heating can be activated and set as required by the Hoval service technician. For example, it is suitable for heating the hall before taking the control system into operation or if the controller fails during the heating period.		Fan speed 2 ¹⁾ Fresh air damper closed ¹⁾ Heating on ¹⁾ ¹⁾ Adjustable by the Hoval service technician

Table F1: TopVent® SC operating modes

3 Technical data

3.1 Type code

	SC	-	6	-	C	...
Unit type	TopVent® SC					
Unit size	6 or 9					
Heating/cooling section	C with coil type C D with coil type D					
Further options						

Table F2: TopVent® SC type code

3.2 Application limits

Extract air temperature		max.	°C	45
Extract air relative humidity		max.	%	60
Moisture content of extract air		max.	g/kg	15
Fresh air temperature		min.	°C	-20
		max.	°C	45
Supply air temperature		max.	°C	60
Temperature of the heating medium		max.	°C	90
Pressure of the heating medium		max.	kPa	800
Air flow rate	Size 6:	min.	m³/h	3100
	Size 9:	min.	m³/h	5000
Condensate quantity	Size 6:	max.	kg/h	90
	Size 9:	max.	kg/h	150
The units cannot be used in: ■ Damp locations ■ Places with a corrosive or aggressive environment ■ Spaces with a large amount of dust ■ Areas where there is danger of explosion				

Table F3: TopVent® SC application limits

3.3 Electrical connection

Unit type		SC-6	SC-9
Supply voltage	V AC	3 x 400	3 x 400
Permitted voltage tolerance	%	± 5	± 5
Frequency	Hz	50	50
Connected load	kW	2.23	3.33
Current consumption max.	A	4.17	5.87
Series fuse	A	13	13
Protection rating	-	IP54	IP54

Table F4: TopVent® SC electrical connections

3.4 Air flow rate

Unit type		SC-6	SC-9
Nominal air flow rate	m³/h	6000	9000
Floor area covered	m²	537	946

Table F5: TopVent® SC air flow rate

3.5 Air filtration

Filter	Fresh air / Extract air
Class acc. to ISO 16890	ISO ePM ₁ 55 %
Class acc. to EN 779	F7
Factory setting of differential pressure switches	300 Pa

Table F6: TopVent® SC air filtration

3.6 Sound level

Unit type			SC-6-C		SC-9-C	
			Indoors	Outdoors ¹⁾	Indoors	Outdoors ¹⁾
Sound pressure level (at a distance of 5 m) ²⁾		dB(A)	55	47	59	50
Total sound power level		dB(A)	77	69	81	72
Octave sound power level	63 Hz	dB	45	44	47	45
	125 Hz	dB	61	55	65	58
	250 Hz	dB	67	63	70	64
	500 Hz	dB	71	65	73	66
	1000 Hz	dB	74	60	78	65
	2000 Hz	dB	70	59	76	65
	4000 Hz	dB	66	56	71	61
		8000 Hz	dB	65	66	57

¹⁾ with fresh air ratio 10 %

²⁾ with a hemispherical radiation pattern in a low-reflection room

Table F7: TopVent® SC sound level

3.7 Heat output

Heating medium temperature			80/60 °C					60/40 °C				
Size	Type	t _F	Q	H _{max}	t _S	Δp _W	m _W	Q	H _{max}	t _S	Δp _W	m _W
		°C	kW	m	°C	kPa	l/h	kW	m	°C	kPa	l/h
SC-6	C	-5	76.8	9.7	55.5	18	3297	45.7	12.3	40.1	7	1965
		-15	78.2	9.7	55.2	19	3358	47.2	12.4	39.9	7	2026
SC-9	C	-5	119.0	10.1	56.8	18	5113	71.0	12.9	40.9	7	3050
		-15	121.2	10.1	56.5	19	5208	73.2	12.9	40.7	7	3145
	D	-5	142.0	9.3	64.4	15	6101	86.7	11.7	46.1	6	3725
		-15	144.6	9.4	64.2	15	6212	89.3	11.7	46.0	6	3837
Legend:	Type = Type of coil t _F = Fresh air temperature Q = Heat output H _{max} = Maximum mounting height t _S = Supply air temperature Δp _W = Water pressure drop m _W = Water quantity											
Reference:	■ Room air 18 °C, extract air 20 °C / 20 % rel. humidity ■ Fresh air ratio 10 %											

Table F8: TopVent® SC heat output

3.8 Cooling capacity

Cooling medium temperature				6/12 °C						8/14 °C					
Size	Type	t _F °C	RH _F %	Q _{sen} kW	Q _{tot} kW	t _s °C	Δp _W kPa	m _W l/h	m _C kg/h	Q _{sen} kW	Q _{tot} kW	t _s °C	Δp _W kPa	m _W l/h	m _C kg/h
SC-6	C	28	40	21.0	21.0	14.0	16	3000	0.0	18.5	18.5	15.2	13	2649	0.0
			60	20.7	20.7	14.2	16	2961	0.0	18.2	18.2	15.4	12	2609	0.0
		32	40	25.7	32.3	15.7	39	4630	9.7	23.3	26.1	16.9	25	3734	4.1
			60	25.4	34.1	15.8	43	4884	12.7	23.0	27.8	17.0	29	3988	7.1
SC-9	C	28	40	32.2	32.2	13.8	16	4614	0.0	28.4	28.4	15.0	12	4064	0.0
			60	31.8	31.8	13.9	16	4554	0.0	28.0	28.0	15.2	12	4004	0.0
		32	40	39.7	51.9	15.3	41	7432	18.0	35.8	35.8	16.6	20	5131	0.0
			60	39.3	54.7	15.4	46	7829	22.7	35.4	38.1	16.7	22	5459	4.0
	D	28	40	38.1	38.1	11.8	13	5451	0.0	33.2	33.2	13.4	10	4756	0.0
			60	37.7	37.8	12.0	13	5409	0.1	32.9	32.9	13.6	10	4706	0.0
		32	40	47.4	64.8	12.7	39	9285	25.6	42.6	53.3	14.3	26	7626	15.7
			60	47.1	68.3	12.9	43	9785	31.2	42.2	56.7	14.5	30	8126	21.3
Legend:	Type = Type of coil t _F = Fresh air temperature RH _F = Relative humidity of the fresh air Q _{sen} = Sensible cooling capacity Q _{tot} = Total cooling capacity t _s = Supply air temperature Δp _W = Water pressure drop m _W = Water quantity m _C = Condensate quantity														
Reference:	■ At fresh air temperature 28 °C: room air 22 °C / 50 % RH, extract air 24 °C ■ At fresh air temperature 32 °C: room air 26 °C / 50 % RH, extract air 28 °C Fresh air ratio 10 %														

Table F9: TopVent® SC cooling capacity

3.9 Product information according to ErP

Trademark / Model		Hoval TopVent® SC			Unit
		6-C	9-C	9-D	
Type		NRVU, UVU			–
Drive		Variable speed drive			–
Heat recovery system		none			–
Thermal efficiency of heat recovery (η_{t_nrvu})		–			%
Nominal flow rate (q_{nom})		1.67	2.50	2.50	m³/s
Effective electric power input (P)		1.10	1.94	2.09	kW
Internal specific fan power (SFP_{int})		162	65	65	W/(m³/s)
Face velocity		3.106	3.273	3.273	m/s
Nominal external pressure ($\Delta p_{s, ext}$)	Supply air	0	0		Pa
	Extract air	–	–		
Internal pressure drop of ventilation components ($\Delta p_{s, int}$)	Fresh air/supply air	–	–		Pa
	Extract air/exhaust air	–	–		
Static efficiency of the fans (η_{fan}) in accordance with Regulation (EU) No 327/2011		69.0	63.6		%
Maximum leakage rate	External	≤ 1	≤ 1		%
	Internal	–	–		
Energy classification of the filters	Supply air ePM ₁ 55 %	D	D		–
	Extract air	–	–		
Visual filter warning		Displayed on the operating unit			–
Casing sound power level (L_{WA})		69	72		dB(A)
Disassembly instructions		Devices that are no longer functional must be dismantled by a specialist company and disposed of at suitable collection points.			–
Contact details		Hoval Aktiengesellschaft Austrasse 70, 9490 Vaduz, Liechtenstein www.hoval.com			

Table F10: Product information according to Commission Regulation (EU) 1253/2014, Article 4(2)

3.10 Dimensions and weights

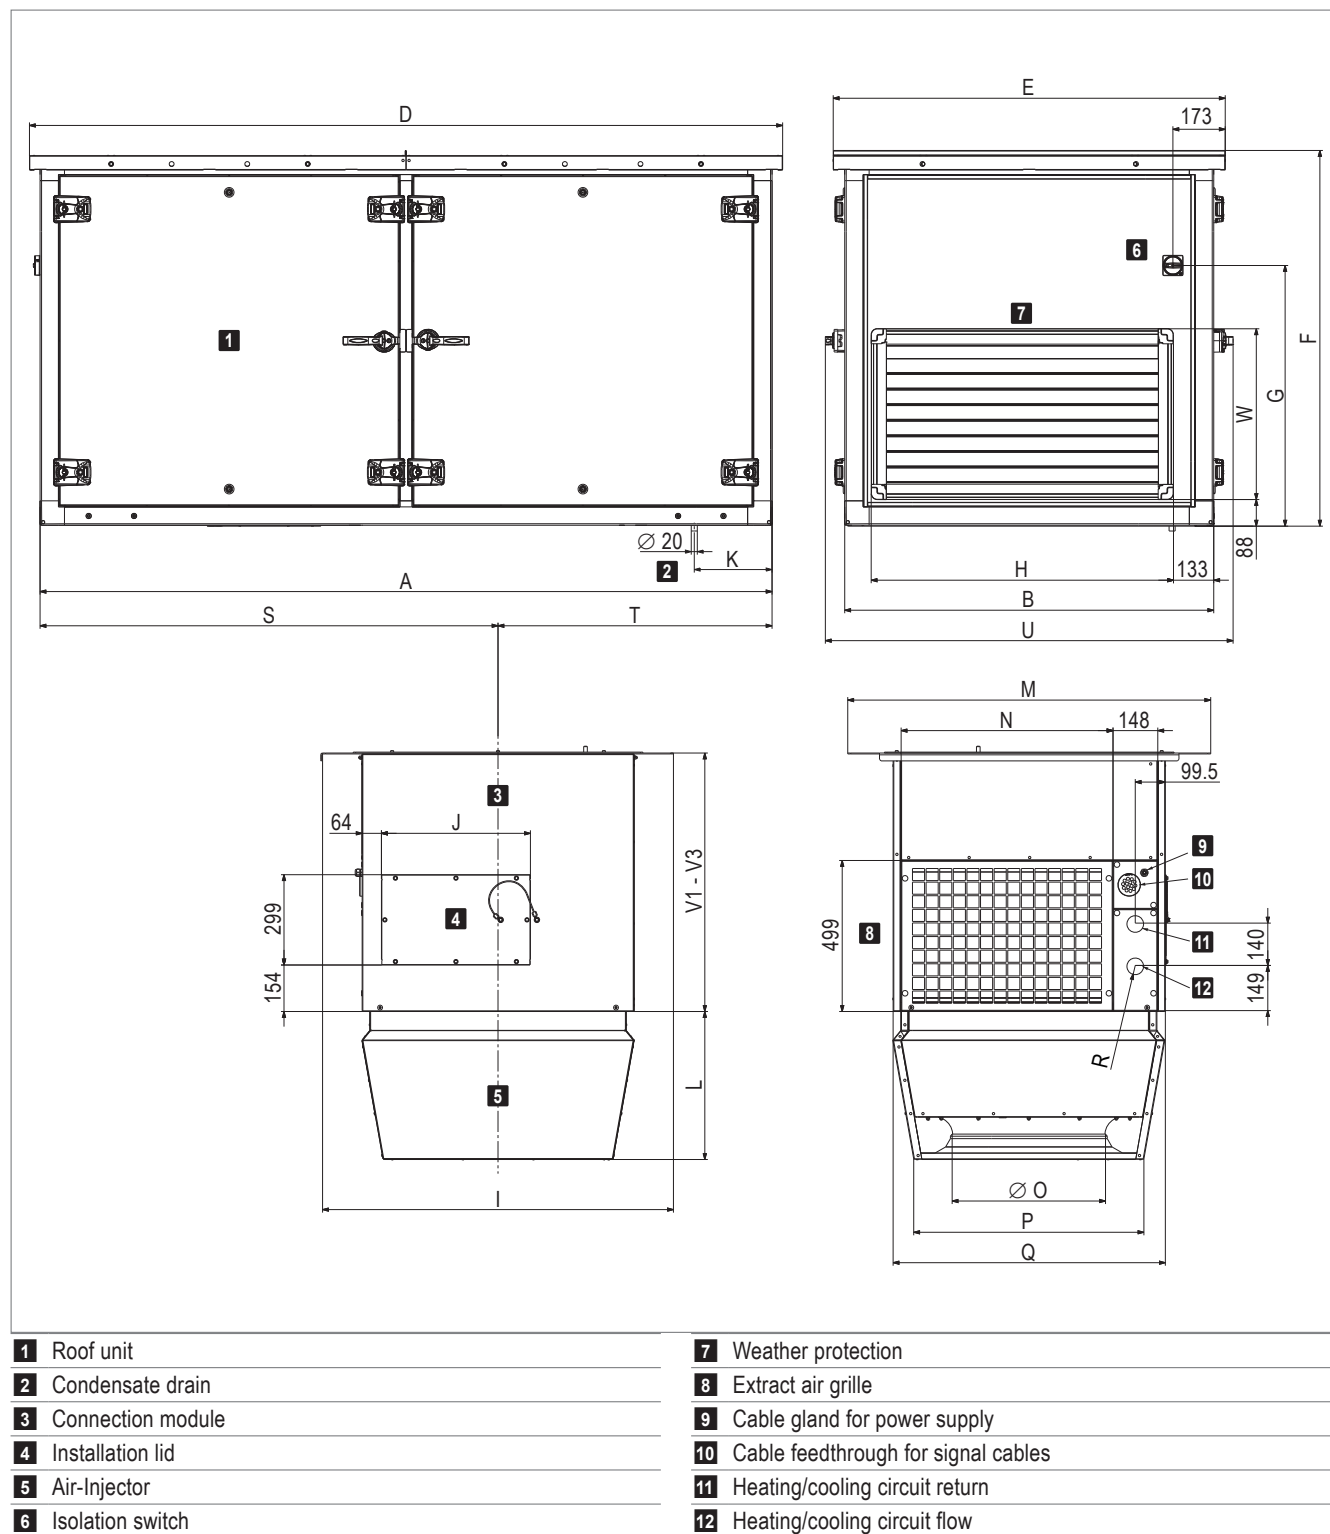


Table F11: Dimensional drawing for TopVent® SC with hydraulic assembly throttling circuit (dimensions in mm)

Unit type		SC-6	SC-9
A	mm	2420	2725
B	mm	1220	1420
D	mm	2490	2795
E	mm	1290	1490
F	mm	1239	1439
G	mm	862	962
H	mm	999	1199
I	mm	1160	1360
J	mm	492	492
K	mm	257	292
L	mm	490	570
M	mm	1200	1400
N	mm	701	901
Ø O	mm	500	630
P	mm	767	937
Q	mm	900	1100
R (internal thread) ¹⁾	"	G 1½	G 1½
S	mm	1514	1684
T	mm	906	1041
U	mm	1348	1548
V1	mm	850	850
V2	mm	1300	1300
V3	mm	1750	1750
W	mm	565	664

¹⁾ TopVent® units without hydraulic assembly: pipe outlets Ø 55 mm

Table F12: TopVent® SC dimensions


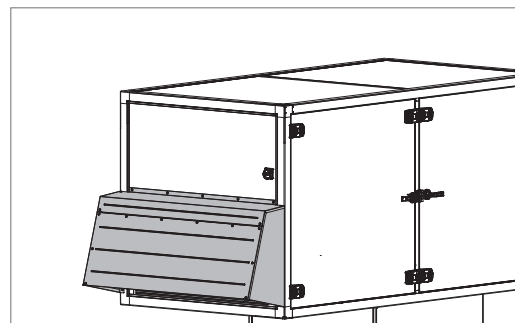


Fig. F4: Fresh air inlet with protection hood

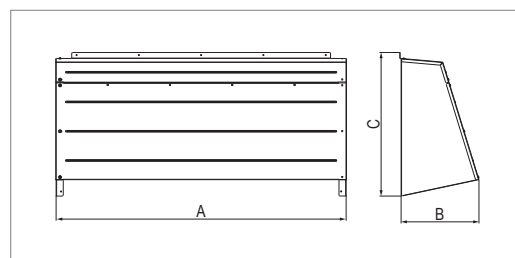

Size		6	9
A	mm	1220	1420
B	mm	377	381
C	mm	603	703
Weight	kg	11.2	13.6

Table F15: Protection hood dimensions and weights

Unit type	SC-	6-C	9-C	9-D
Total	kg	692	879	898
Roof unit	kg	550	697	716
Below-roof unit	kg	142	182	182
Air-Injector	kg	40	57	57
Connection module V1	kg	102	125	
Additional weight V2	kg	+ 42	+ 50	
Additional weight V3	kg	+ 85	+ 101	

Table F13: TopVent® SC weights

Heating/cooling section		6-C	9-C	9-D
Connection (internal thread)	"	Rp 1¼	Rp 1½	Rp 2
Water content of the coil	l	7.9	12.4	19.2

Table F14: Hydraulic connection of the heating/cooling section in the roof unit (without hydraulic assembly)

4 Specification texts

4.1 TopVent® SC

Supply air unit for ventilating, heating and cooling rooms up to 25 m in height with central heat and cold supply (2-pipe system); configured as roof unit; equipped with highly efficient air distributor.

The unit consists of the following components:

- Roof unit (with access to all components relevant for maintenance)
- Below-roof unit, consisting of:
 - Connection module
 - Air-Injector
- Optional components

The TopVent® SC unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of ventilation systems. It is a system of the “non-residential ventilation unit” (NRVU) and “unidirectional ventilation unit” (UVU) type, provided for in Commission Regulation (EU) 1253/2014.

Roof unit

Self-supporting casing, construction made of thermally decoupled aluminium profile frame system with nylon connecting elements and panels made of coated zinc sheet (anthracite grey, similar to RAL 7016), additional rain canopy made of aluminium:

- Weatherproof, corrosion resistant, impact resistant, air-tight
- Low flammability, double-shelled, without heat bridges, with highly efficient insulation made of expanded polystyrene
- Hygienic and easy to maintain because of smooth interior surfaces and large access doors with ageing-resistant, silicone-free sealing materials

The roof unit includes:

Fan

Configured as maintenance-free, directly driven radial fan with high-efficiency EC motor, backwards-curved, 3D contoured blades and free-running rotor made of a high-performance composite material, aerodynamically optimised inflow nozzle, low-noise, with integrated overload protection.

Heating/cooling section

The heating/cooling section contains:

- The highly efficient heating/cooling coil consisting of seamless copper pipes with pressed-on, optimised and profiled aluminium fins and manifolds made of copper; for connection to the hot water and cold water supply

- The pull-out condensate separator with collecting channel, made of high-quality corrosion-resistant material, with a downslope in all directions for rapid draining
- Frost controller
- the condensate drain on the roof via siphon

Fresh air filter

Pleated cell filter of filter class ePM₁ 55% according to ISO 16890, consisting of micro glass with synthetic lamination as handle protection, pleat pack completely encapsulated to prevent leakage, frame made of recycled plastic, fully incinerable, including differential pressure switch for filter monitoring.

Extract air filter

Pleated cell filter of filter class ePM₁ 55% according to ISO 16890, consisting of micro glass with synthetic lamination as handle protection, pleat pack completely encapsulated to prevent leakage, frame made of recycled plastic, fully incinerable, including differential pressure switch for filter monitoring.

Fresh air damper

Damper consisting of sheet steel blades with sealing lip and plastic gearwheels; tightness class 4 according to EN 1751; including actuator with shut-off function by spring return.

Recirculation damper

Damper consisting of sheet steel blades with plastic gearwheels; tightness class 2 according to EN 1751; including actuator.

Unit control box

Control box for connection of the power supply and housing the control components that facilitate energy-optimised operation, controlled by the control system TopTronic® C. Plastic casing, protection rating IP56. The following components are installed:

- Circuit board with all required electrical components, unit controller (clipped on) as well as connection terminals for all internal and the following external connections:
 - Heating/cooling valve
 - Heating/cooling pump
 - Forced off

The circuit board is fitted with push-in terminals facilitating easy installation of the connection cables. All components in the unit control box as well as sensors, actuators in the unit and the isolation switch attached to the outside of the unit are fully factory-wired.

Power supply, bus connection, connection to Air-Injector actuator to be installed on site

Access openings

Defined side walls of the roof unit configured as inspection doors for easy access to all components relevant for maintenance. The hinges allow opening with an opening angle of 90° or complete removal of the inspection doors.

Below-roof unit

Connection module V1

Housing made of magnesium zinc sheet, air-tight, flame retardant, with highly efficient insulation made of expanded polystyrene, hygienic and easy to maintain because of smooth interior surfaces and ageing-resistant, silicone-free sealing materials; configured with:

- Extract air grille
 - Cable feedthroughs for the electric supply
 - Pipe feedthroughs for the hydraulic supply
- Installation and insulation of the pipelines on site

Connection module V2 / V3 (variant)

The connection module is extended for adapting to the local installation situation.

Design with Air-Injector

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, internally insulated with closed-cell polyethylene foam, with:

- Vortex air distributor with concentric outlet nozzle, adjustable vanes and integrated absorber hood
- Actuator for infinitely variable adjustment of the air distribution from vertical to horizontal
 - for draught-free air distribution in the hall under changing operating conditions
 - for the rapid and large-area reduction of temperature stratification in the room through induction of secondary air and strong mixing of the room air with supply air

Actuator installed in the connection module for easy access from the roof.

Design without Air-Injector (variant)

Unit configured without vortex air distributor for connection to an on-site supply air duct and air distribution within the building.

Air distribution box (variant)

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, insulated on the inside with closed-cell polyethylene foam; configured with 2 collars as connecting piece to the on-site air distribution system.

Options for the unit

Paint finish of below-roof unit

Exterior painting of the below-roof unit in choice of RAL colour.

Supply air silencer

Designed as a sound-absorbing mat made of melamine foam; hygienically perfect with carbon fibre coating; mounted in the roof unit; insertion loss 3 dB.

Hydraulic assembly throttling circuit

Assembly for hydraulic throttling circuit, sized for the coil in the unit and the Hoval TopTronic® C, consisting of:

- Control valve with volume flow presetting, ball valve and automatic air vent, installed and wired in the roof unit
- Pre-insulated corrugated pipelines installed in the below-roof unit for connection to the distribution network

Pipelines in the roof unit and in the below-roof unit to be connected on site, pipelines in the roof unit to be insulated on site

Pump control

Electrical components for controlling a mixing or injection circuit in the load circuit, factory-installed in the unit control box.

Roof frame

Consisting of 4 load-bearing side walls made of galvanised sheet steel with fastening rails for the roof foil, supplied loose with the matching connecting screws.

Assembly, insulation, integration in the roof structure on site.

4.2 TopTronic® C – System control

Zone-based control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size per system bus: 64 control zones with up to 10 supply and extract air handling units or supply air units and 10 recirculation units each.

Zone allocation

Configured in advance for the customer at the factory:

	Room designation	Unit type
Zone 1:	_____	_____
Zone 2:	_____	_____
...		

System structure

- Zone control panel made of coated sheet steel (light grey RAL 7035), ... x ... x ... mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - 1 zone controller and 1 room temperature sensor per zone (expandable to up to 4 room temperature sensors per zone)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in one control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Heating/cooling demand per zone with feedback monitoring

Functions, standard

- Zone-based autonomous room control. Temperature and ventilation control separately adjustable for each zone
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time
- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution

- Main operating modes of supply and extract air handling units:

VE Ventilation, infinitely variably adjustment

AQ.... Air quality, automatic control with Hoval combination sensor (option), optional reference variable:

- CO₂ or VOC
- Air humidity (optimised dehumidification mode)

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

EA Exhaust air, infinitely variably adjustment

SA Supply air, infinitely variably adjustment

ST Standby

- Main operating modes of supply air units:

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

SA Supply air, infinitely variably adjustment

With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC

ST Standby

- Main operating modes of recirculation units:

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

ST Standby

- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)
- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- TopTronic® C-ZT as zone operator terminal: for simple on-site operation of a control zone
- Manual operating selector switches
- Manual operating selector buttons
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP
 - Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Alarm lamp
- Socket

Per zone:

- The change-over between heating and cooling can be either automatic or manual
 - Cooling lock switch for automatic changeover
 - Heating/cooling switch for manual changeover
- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Combination sensor fresh air temperature and humidity
- Transfer of actual values and setpoints from external systems (0-10 V; 4-20 mA)
- Load shedding input
- Signal for external extract air fan
- Operating selector switches on terminal
- Operating selector button on terminal
- Control of distributor pump, incl. power supply
- Control box TW Pro

Power distribution:

- Circuit breakers and output terminals for Hoval indoor climate units
- Safety relay (4-pin)

4.3 TopTronic® C – Single zone control panel

Control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size: 1 control zone with up to 10 supply and extract air handling units or supply air units and 10 recirculation units.

System structure

- Zone control panel, designed as compact cabinet for wall installation, made of coated sheet steel (light grey RAL 7035), 380 × 300 × 210 mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - Zone controller
 - 1 Room temperature sensor (expandable to up to 4 room temperature sensors)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in the control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Circuit board with external connections for:
 - Power supply
 - Zone bus
 - Room temperature sensors (max. 4)
 - Fresh air temperature sensor
 - Combination sensor room air quality, temperature and humidity
 - Collective alarm
 - Forced off
 - Heating demand
 - Setpoint heating demand
 - Fault heat supply
 - Cooling demand
 - Fault cold supply
 - External enabling heating/cooling (for automatic changeover)
 - External setting heating/cooling (for manual changeover)
 - Changeover valves heating/cooling
 - External setpoint fresh air ratio
 - Operating selector switch on terminal (digital)
 - Operating selector button on terminal

Functions, standard

- Room temperature control via sequential control of the coils
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time

- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution
- Main operating modes of supply and extract air handling units:
 - VE Ventilation, infinitely variably adjustment
 - AQ.... Air quality, automatic control with Hoval combination sensor (option), optional reference variable CO₂ or VOC
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - EA Exhaust air, infinitely variably adjustment
 - SA Supply air, infinitely variably adjustment
 - ST Standby
- Main operating modes of supply air units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - SA Supply air, infinitely variably adjustment
 - With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC
 - ST Standby
- Main operating modes of recirculation units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - ST Standby
- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)
- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP
 - Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Signal for external extract air fan
- Control box TW Pro

4.4 HovalSupervisor cloud TopTronic® C

(Terms of use according to www.hoval.com/hsc are accepted when ordered.)

HovalSupervisor cloud TopTronic® C

Remote access, visualisation, historization, trends, evaluations and alarming for Hoval indoor climate systems with TopTronic® C control

- Project-specific system engineering
- Visualisation of the system statuses, error messages, actual and nominal values of the entire plant system
- Graphical display of the entire plant control system, in order to complete an analysis of sequences and subsequently to be able to perform an optimisation
- Integrated continuous line recorder for a period of 3 years
- Integrated alarm management
- Multi-user system: simultaneous access, 2 users included per plant
- Max. 300 data points historicized
- Max. 10 control zones

Consisting of:

- Project-specific engineering of the visualisation as described above
- Industrial router for connecting the TopTronic® C control system
 - Metal casing installed in the zone control panel
 - Without SIM card, free choice of phone network
 - Router configuration possible via web server
 - Network connections:
 - 2 x 10/100 Mbit Ethernet
 - 2 x SIM card slot
 - SMA connections:
 - 1 x WLAN
 - 2 x mobile data via integrated antenna
 - Power supply for industrial router installed in zone control panel

HovalSupervisor cloud TopTronic® C subscription

Subscription for use of the HovalSupervisor cloud for visualisation of a TopTronic® C system

- 1 year term (subscription billed once a year)
- Use of the HovalSupervisor cloud and storage of the data in the cloud
- Paid support during business hours (only for the software, not for the system)
- The respective valid conditions of use and the service level agreement (SLA) apply, which can be retrieved online.

Options for HovalSupervisor cloud

- Antenna to improve mobile data reception in conjunction with the HovalSupervisor cloud TopTronic® C
 - Antenna with mounting bracket for on-site installation outside the TopTronic® C zone control panel
 - 2G/3G/4G-LTE/5G-ready
 - SMA port available on the antenna
- Antenna extension cable for connecting the antenna in conjunction with the HovalSupervisor cloud
 - SMA port
 - Double shielded
 - Length: 5 m



TopVent® SHC

Supply air unit configured as roof unit for ventilating, heating and cooling spaces up to 25 m in height with central heat and cold supply (4-pipe-system)

1 Use	.96
2 Construction and operation	.96
3 Technical data	100
4 Specification texts	107

1 Use

1.1 Intended use

TopVent® SHC is a supply air unit for ventilating, heating and cooling spaces up to 25 m in height with central heat and cold supply. It fulfils the following functions:

- Heating (with connection to a hot water supply)
- Cooling (with connection to a water chiller)
- Fresh air supply
- Mixed air operation
- Recirculation operation
- Air distribution and destratification with adjustable Air-Injector
- Air filtration

TopVent® SHC is configured as a roof unit. It is installed in the roof to save space and does not protrude far into the room. Maintenance work is carried out from the roof without causing disruption to operations in the building.

The TopVent® SHC unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of ventilation systems. It is a system of the “non-residential ventilation unit” (NRVU) and “unidirectional ventilation unit” (UVU) type, provided for in Commission Regulation (EU) 1253/2014.

The Hoval TopTronic® C integrated control system ensures energy-efficient, demand-based operation of Hoval indoor climate systems.

Intended use also includes compliance with the operating instructions. Any usage over and above this use is considered to be not as intended. The manufacturer can accept no liability for damage resulting from improper use.

1.2 User group

The units are only allowed to be installed, operated and maintained by authorised and instructed personnel who are well acquainted with the units and are informed about possible dangers.

2 Construction and operation

2.1 Construction

The TopVent® SHC unit consists of the following components:

Roof unit

The self-supporting housing for mounting on the roof frame is of double-shell construction; this ensures good thermal insulation and high stability. The roof unit includes the following components:

- Fan
- Heating section
 - Coil for heating the supply air with hot water
- Cooling section
 - Coil for cooling the supply air with cold water
 - Condensate separator
- Fresh air and extract air filters
- Control dampers
- Unit control box (part of the TopTronic® C control system)

All components are easily accessible for maintenance work through large access openings. A protection hood protects the fresh air inlet from strong winds and snowfall (supplied loose for assembly on site).


Below-roof unit

The below-roof unit comprises the following components:

- Connection module:


The connection module serves as an air duct through the roof and for drawing in extract air from the hall through the extract air grille. To enable easy adaptation to local installation conditions, the connection module is available in 3 lengths.
- Air-Injector:

The Air-Injector is a patented, infinitely variable vortex air distributor for the draught-free introduction of air into the hall under changing operating conditions.

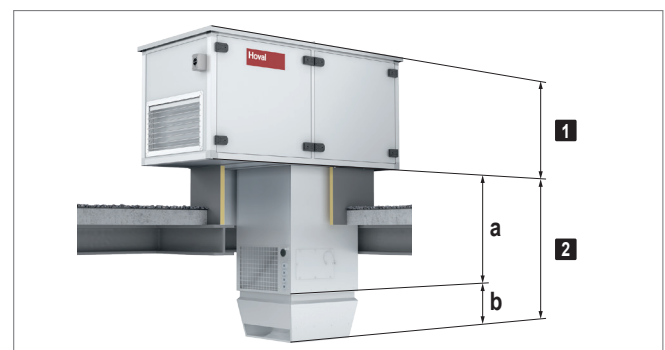

- 1 Roof unit
- 2 Below-roof unit
 - a Connection module
 - b Air-Injector


Fig. G1: TopVent® SHC components

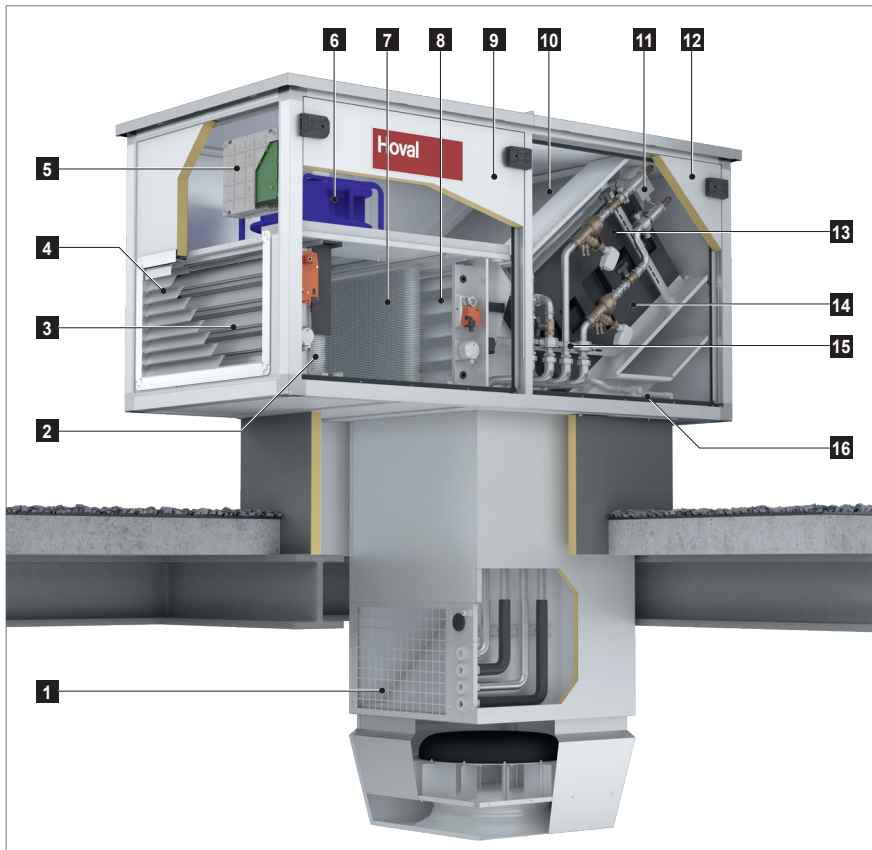

- | | |
|----|---------------------------------------|
| 1 | Extract air grille |
| 2 | Fresh air filter |
| 3 | Fresh air damper |
| 4 | Weather protection |
| 5 | Unit control box |
| 6 | Fan |
| 7 | Extract air filter |
| 8 | Recirculation damper |
| 9 | Fan access door |
| 10 | Heating coil |
| 11 | Frost controller |
| 12 | Hydraulic connection access door |
| 13 | Cooling coil |
| 14 | Condensate separator |
| 15 | Hydraulic assembly throttling circuit |
| 16 | Condensate drain |

Fig. G2: TopVent® SHC construction

2.2 Function diagram

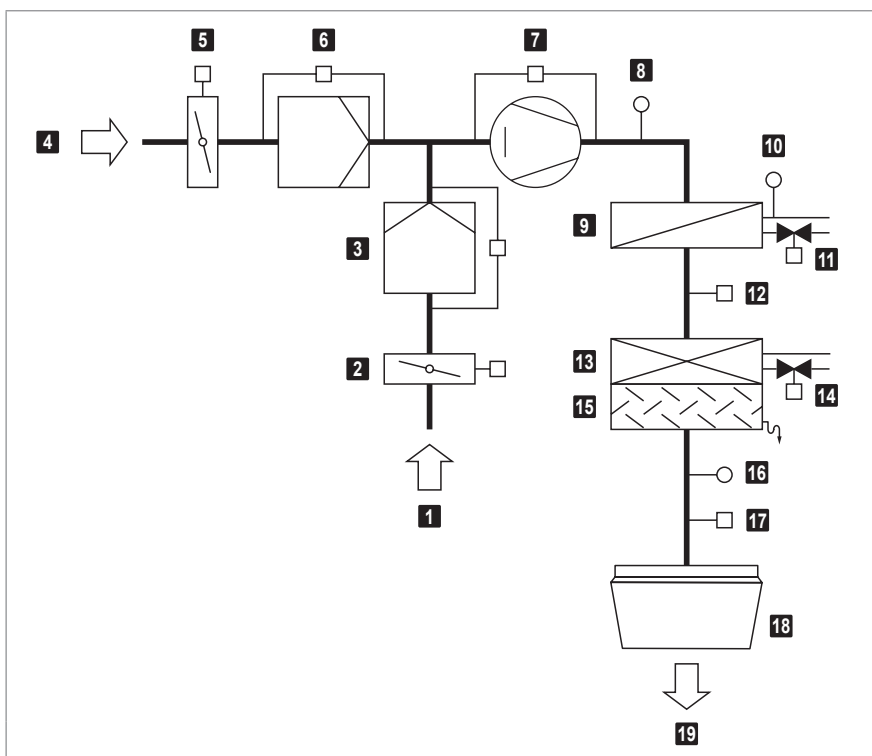

- | | |
|----|--|
| 1 | Extract air |
| 2 | Recirculation damper with actuator |
| 3 | Extract air filter with differential pressure switch |
| 4 | Fresh air |
| 5 | Fresh air damper with actuator |
| 6 | Fresh air filter with differential pressure switch |
| 7 | Fan with flow rate monitoring |
| 8 | Mixed air temperature sensor |
| 9 | Heating coil |
| 10 | Return temperature sensor |
| 11 | Control valve with actuator (option) |
| 12 | Frost controller |
| 13 | Cooling coil |
| 14 | Control valve with actuator (option) |
| 15 | Condensate separator |
| 16 | Supply air temperature sensor |
| 17 | Actuator Air-Injector |
| 18 | Air-Injector |
| 19 | Supply air |

Fig. G3: TopVent® SHC function diagram



2.3 Operating modes

TopVent® SHC operates in the following modes:

- Supply air speed 2
- Supply air speed 1
- Recirculation
- Recirculation speed 1
- Standby

The TopTronic® C control system regulates these operating modes automatically for each control zone in accordance with the specifications in the calendar. The following points also apply:

- The operating mode of a control zone can be switched over manually.
- Each TopVent® SHC unit can operate individually in a local operating mode: Off, Supply air speed 2, Supply air speed 1, Recirculation, Recirculation speed 1

Code	Operating mode		Description
SA2	Supply air speed 2 The fan runs at speed 2 (high air flow rate). The room temperature set value day is active. The unit blows fresh air into the room. The control of the fresh air ratio can be selected:		
	<u>Fixed fresh air ratio:</u> The unit operates continuously with the set fresh air ratio. The system controls the heating/cooling according to the heating/cooling demand.		Fan speed 2 Fresh air damper..... 10 % open ¹⁾ Heating/cooling 0-100 % ²⁾ ¹⁾ Percentage is adjustable ²⁾ Depending on heat or cool demand
	<u>Variable fresh air ratio:</u> ■ The system regulates the fresh air ratio depending on the temperature. The set fresh air ratio serves as a minimum value. If the temperature conditions permit, more fresh air is brought into the room and used for free heating or free cooling. Only when this potential is fully utilised is the heating/cooling switched on via the coil if required. ■ If a combination sensor for room air is installed (option), the system additionally controls the fresh air ratio depending on the air quality: – If there is no heat demand, the fresh air damper is opened 100% if the indoor air quality is too poor. – When the setpoint value for the CO₂ or VOC content of the room air is reached, the fresh air damper closes again to the set minimum value.		Fan speed 2 Fresh air damper..... MIN-100 % open ¹⁾ Heating/cooling 0-100 % ²⁾ ¹⁾ A minimum value can be set ²⁾ Depending on heat or cool demand
	 Notice In order to save heating energy, the unit only operates with the set minimum fresh air rate when heat is required.		
SA1	Supply air speed 1 The same as SA2, but the fan operates at speed 1 (low air flow rate)		Fan speed 1 Fresh air damper..... MIN-100 % open ¹⁾ Heating/cooling 0-100 % ¹⁾ Fixed or variable (see above)








Code	Operating mode		Description
REC	Recirculation On/Off operation: during heat or cool demand, the unit draws in room air, heats or cools it and blows it back into the room. The room temperature set value day is active.		Fan speed 1/2 ¹⁾ Fresh air damper closed Heating/cooling on ¹⁾ ¹⁾ Depending on heat or cool demand
DES	■ Destratification: To avoid heat build-up under the ceiling, it may be appropriate to switch on the fan when there is no heat or cool demand (either in permanent operation or in on/off operation depending on the temperature stratification, as desired).		Fan speed 2 Fresh air damper closed Heating/cooling off
REC1	Recirculation speed 1 The same as REC, but the unit operates only at speed 1 (low air flow rate)		Fan speed 1 Fresh air damper closed Heating/cooling on ¹⁾ ¹⁾ Depending on heat or cool demand
DES	■ Destratification: The same as for REC, but the unit operates only at speed 1		Fan speed 1 Fresh air damper closed Heating/cooling off
ST	Standby The unit is ready for operation; the following operating modes are activated if required:		
CPR	■ Cooling protection: If the room temperature drops below the set value for cooling protection, the unit heats up the room in recirculation operation.		Fan speed 2 Fresh air damper closed Heating on
OPR	■ Overheating protection: If the room temperature rises above the set value for overheating protection, the unit cools down the room in recirculation operation.		Fan speed 2 Fresh air damper closed Cooling on
NCS	■ Night cooling: If the room temperature rises above the set value for night cooling and the current fresh air temperature permits it, the unit blows cool fresh air into the room and extracts warmer room air.		Fan speed 2 Fresh air damper open Heating/cooling off
L_OFF	Off (local operating mode) The unit is switched off; frost protection for the unit remains active.		Fan off Fresh air damper closed Heating/cooling off
–	Forced heating The unit draws in room air, warms it and blows it back into the room. Forced heating can be activated and set as required by the Hoval service technician. For example, it is suitable for heating the hall before taking the control system into operation or if the controller fails during the heating period.		Fan speed 2 ¹⁾ Fresh air damper closed ¹⁾ Heating on ¹⁾ ¹⁾ Adjustable by the Hoval service technician

Table G1: TopVent® SHC operating modes

3 Technical data

3.1 Type code

	SHC	-	6	B	C	...
Unit type						
TopVent® SHC						
Unit size						
6 or 9						
Heating section						
A with coil type A						
B with coil type B						
C with coil type C						
Cooling section						
C with coil type C						
D with coil type D						
Further options						

Table G2: TopVent® SHC type code

3.2 Application limits

Extract air temperature		max.	°C	45
Moisture content of extract air		max.	g/kg	15
Fresh air temperature		min.	°C	-20
		max.	°C	45
Supply air temperature		max.	°C	60
Temperature of the heating medium		max.	°C	90
Pressure of the heating medium		max.	kPa	800
Air flow rate	Size 6:	min.	m³/h	3100
	Size 9:	min.	m³/h	5000
Condensate quantity	Size 6:	max.	kg/h	90
	Size 9:	max.	kg/h	150
The units cannot be used in:				
■ Damp locations				
■ Places with a corrosive or aggressive environment				
■ Spaces with a large amount of dust				
■ Areas where there is danger of explosion				

Table G3: TopVent® SHC application limits

3.3 Electrical connection

Unit type		SHC-6	SHC-9
Supply voltage	V AC	3 x 400	3 x 400
Permitted voltage tolerance	%	± 5	± 5
Frequency	Hz	50	50
Connected load	kW	2.43	3.53
Current consumption max.	A	4.17	5.87
Series fuse	A	13	13
Protection rating	-	IP54	IP54

Table G4: TopVent® SHC electrical connections

3.4 Air flow rate

Unit type		SHC-6	SHC-9
Nominal air flow rate	m³/h	6000	9000
Floor area covered	m²	537	946

Table G5: TopVent® SHC air flow rate

3.5 Air filtration

Filter	Fresh air / Extract air
Class acc. to ISO 16890	ISO ePM ₁ 55 %
Class acc. to EN 779	F7
Factory setting of differential pressure switches	300 Pa

Table G6: TopVent® SHC air filtration

3.6 Sound level

Unit type			SHC-6CC		SHC-9CC	
			Indoors	Outdoors ¹⁾	Indoors	Outdoors ¹⁾
Sound pressure level (at a distance of 5 m) ²⁾		dB(A)	55	48	59	50
Total sound power level		dB(A)	77	70	81	72
Octave sound power level	63 Hz	dB	45	45	47	46
	125 Hz	dB	58	55	60	55
	250 Hz	dB	67	64	70	65
	500 Hz	dB	71	66	73	67
	1000 Hz	dB	73	60	77	66
	2000 Hz	dB	69	59	75	66
	4000 Hz	dB	64	56	70	62
		8000 Hz	dB	63	65	58

¹⁾ with fresh air ratio 10 %

²⁾ with a hemispherical radiation pattern in a low-reflection room

Table G7: TopVent® SHC sound level

3.7 Heat output

Heating medium temperature			80/60 °C					60/40 °C				
Size	Type	t _F °C	Q kW	H _{max} m	t _S °C	Δp _W kPa	m _W l/h	Q kW	H _{max} m	t _S °C	Δp _W kPa	m _W l/h
SHC-6	A	-5	33.1	14.4	33.9	7	1424	19.1	18.8	27.0	2	820
		-15	33.8	14.7	33.2	8	1451	19.7	19.5	26.3	3	848
	B	-5	47.5	12.1	41.0	13	2040	27.4	15.7	31.1	4	1177
		-15	48.4	12.2	40.5	14	2079	28.3	16.1	30.5	5	1216
	C	-5	76.8	9.7	55.5	18	3297	45.7	12.3	40.1	7	1965
		-15	78.2	9.7	55.2	19	3358	47.2	12.4	39.9	7	2026
SHC-9	A	-5	56.1	14.4	36.0	8	2409	32.3	18.8	28.2	3	1387
		-15	57.1	14.6	35.4	8	2455	33.4	19.4	27.5	3	1433
	B	-5	71.9	12.8	41.2	12	3090	41.3	16.7	31.1	4	1775
		-15	73.3	12.9	40.7	13	3149	42.7	17.0	30.6	4	1834
	C	-5	119.0	10.1	56.8	18	5113	71.0	12.9	40.9	7	3050
		-15	121.2	10.1	56.5	19	5208	73.2	12.9	40.7	7	3145
Legend:	Type = Type of coil t _F = Fresh air temperature Q = Heat output H _{max} = Maximum mounting height t _S = Supply air temperature Δp _W = Water pressure drop m _W = Water quantity											
Reference:	■ Room air 18 °C, extract air 20 °C / 20 % rel. humidity ■ Fresh air ratio 10 %											


Table G8: TopVent® SHC heat output

3.8 Cooling capacity

Cooling medium temperature				6/12 °C						8/14 °C					
Size	Type	t _F °C	RH _F %	Q _{sen} kW	Q _{tot} kW	t _s °C	Δp _W kPa	m _W l/h	m _C kg/h	Q _{sen} kW	Q _{tot} kW	t _s °C	Δp _W kPa	m _W l/h	m _C kg/h
SHC-6	C	28	40	21.0	21.0	14.0	16	3000	0.0	18.5	18.5	15.2	13	2649	0.0
			60	20.7	20.7	14.2	16	2961	0.0	18.2	18.2	15.4	12	2609	0.0
		32	40	25.7	32.3	15.7	39	4630	9.7	23.3	26.1	16.9	25	3734	4.1
			60	25.4	34.1	15.8	43	4884	12.7	23.0	27.8	17.0	29	3988	7.1
SHC-9	C	28	40	32.2	32.2	13.8	16	4614	0.0	28.4	28.4	15.0	12	4064	0.0
			60	31.8	31.8	13.9	16	4554	0.0	28.0	28.0	15.2	12	4004	0.0
		32	40	39.7	51.9	15.3	41	7432	18.0	35.8	35.8	16.6	20	5131	0.0
			60	39.3	54.7	15.4	46	7829	22.7	35.4	38.1	16.7	22	5459	4.0
	D	28	40	38.1	38.1	11.8	13	5451	0.0	33.2	33.2	13.4	10	4756	0.0
			60	37.7	37.8	12.0	13	5409	0.1	32.9	32.9	13.6	10	4706	0.0
		32	40	47.4	64.8	12.7	39	9285	25.6	42.6	53.3	14.3	26	7626	15.7
			60	47.1	68.3	12.9	43	9785	31.2	42.2	56.7	14.5	30	8126	21.3
Legend:	Type = Type of coil t _F = Fresh air temperature RH _F = Relative humidity of the fresh air Q _{sen} = Sensible cooling capacity Q _{tot} = Total cooling capacity t _s = Supply air temperature Δp _W = Water pressure drop m _W = Water quantity m _C = Condensate quantity														
Reference:	■ At fresh air temperature 28 °C: room air 22 °C / 50 % RH, extract air 24 °C ■ At fresh air temperature 32 °C: room air 26 °C / 50 % RH, extract air 28 °C Fresh air ratio 10 %														

Table G9: TopVent® SHC cooling capacity

3.9 Dimensions and weights

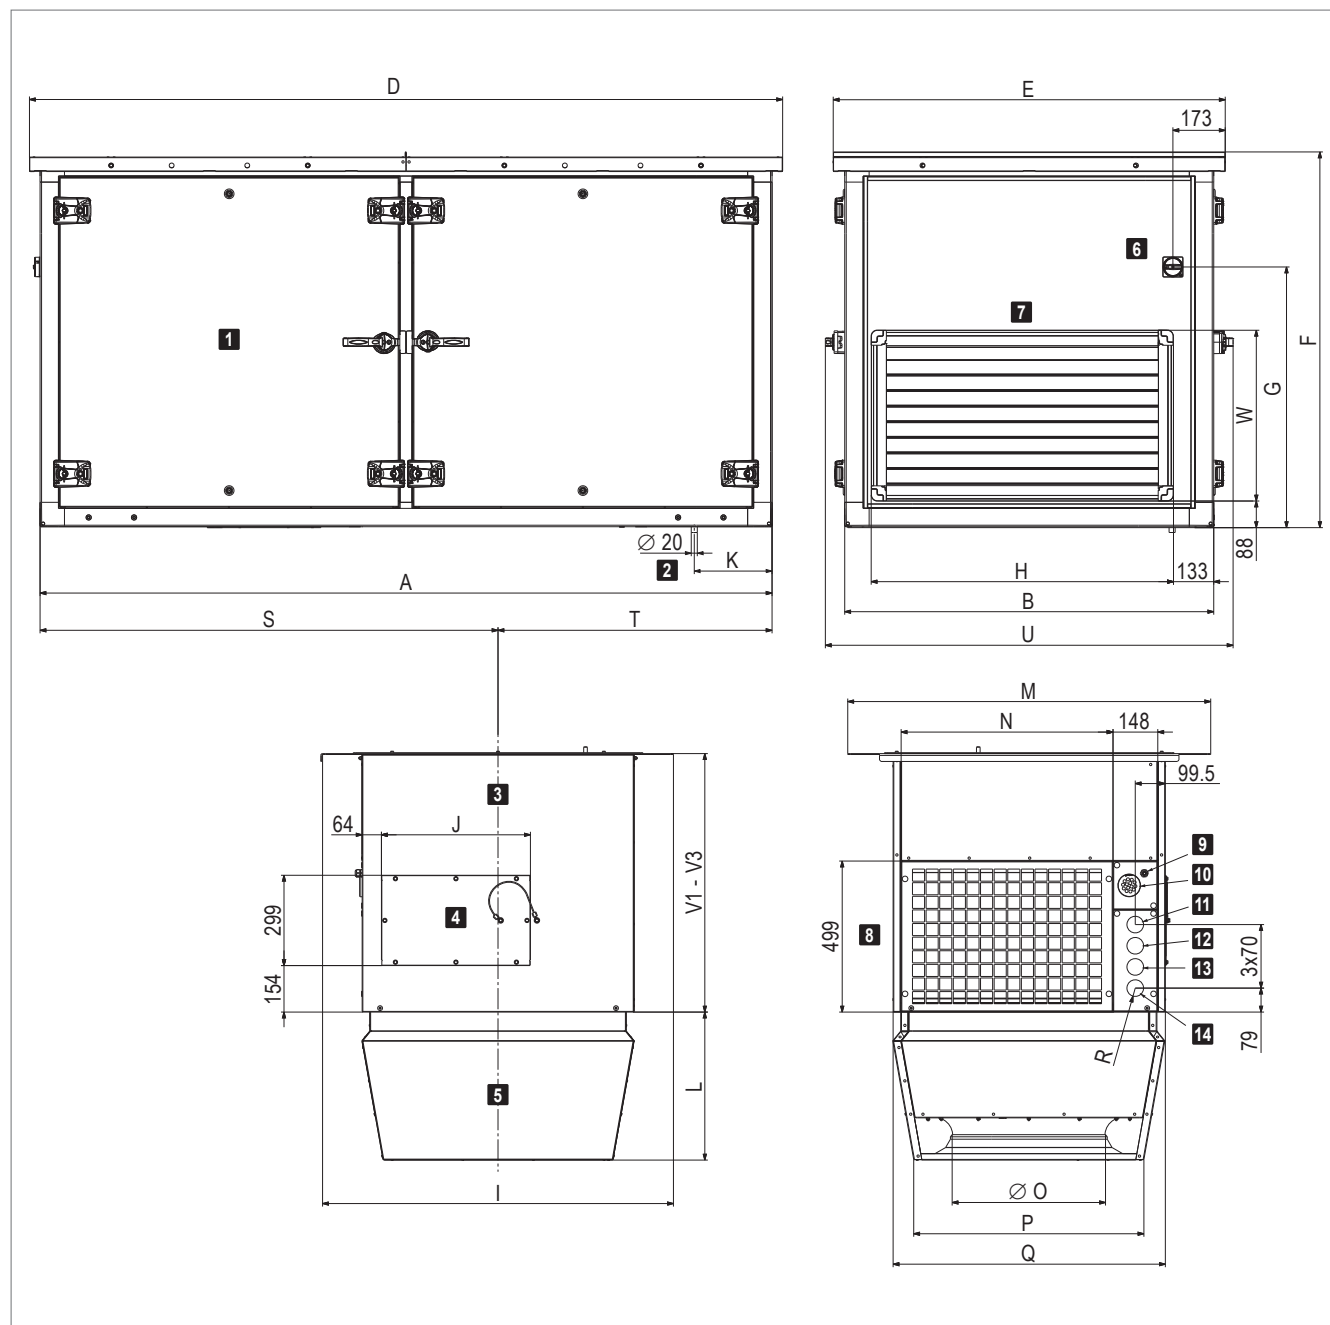

1 Roof unit

2 Condensate drain

3 Connection module

4 Installation lid

5 Air-Injector

6 Isolation switch

7 Weather protection

8 Extract air grille

9 Cable gland for power supply

10 Cable feedthrough for signal cables

11 Heating circuit return

12 Cooling circuit return

13 Heating circuit flow

14 Cooling circuit flow

Table G10: Dimensional drawing for TopVent® SHC with hydraulic assembly throttling circuit (dimensions in mm)

Unit type		SHC-6	SHC-9
A	mm	2420	2725
B	mm	1220	1420
D	mm	2490	2795
E	mm	1290	1490
F	mm	1239	1439
G	mm	862	962
H	mm	999	1199
I	mm	1160	1360
J	mm	492	492
K	mm	257	292
L	mm	490	570
M	mm	1200	1400
N	mm	701	901
Ø O	mm	500	630
P	mm	767	937
Q	mm	900	1100
R (internal thread) ¹⁾	"	G 1½	G 1½
S	mm	1514	1684
T	mm	906	1041
U	mm	1348	1548
V1	mm	850	850
V2	mm	1300	1300
V3	mm	1750	1750
W	mm	565	664

¹⁾ TopVent® units without hydraulic assembly: pipe outlets Ø 55 mm

Table G11: TopVent® SHC dimensions


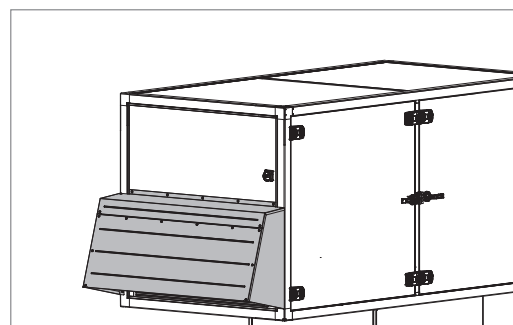


Fig. G4: Fresh air inlet with protection hood

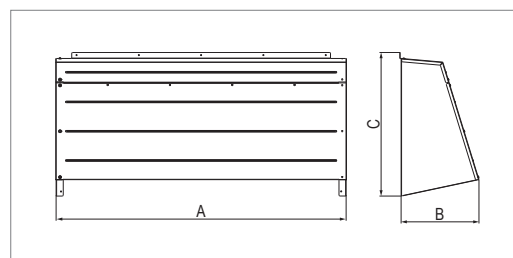

Size		6	9
A	mm	1220	1420
B	mm	377	381
C	mm	603	703
Weight	kg	11.2	13.6

Table G15: Protection hood dimensions and weights

Unit type	SHC-	6AC	6BC	6CC	9AC	9BC	9CC	9AD	9BD	9CD
Total	kg	723	722	729	922	921	934	941	940	953
Roof unit	kg	581	580	587	740	739	752	759	758	771
Below-roof unit	kg	142	142	142	182	182	182	182	182	182
Air-Injector	kg	40	40	40	57	57	57	57	57	57
Connection module V1	kg	102			125					
Additional weight V2	kg	+ 42			+ 50					
Additional weight V3	kg	+ 85			+ 101					

Table G12: TopVent® SHC weights

Heating section		6 A	6B	6C	9 A	9B	9C
Connection (internal thread)	"	Rp 1¼	Rp 1¼	Rp 1¼	Rp 1½	Rp 1½	Rp 1½
Water content of the coil	l	4.6	4.6	7.9	7.4	7.4	12.4

Table G13: Hydraulic connection of the heating section in the roof unit (without hydraulic assembly)

Cooling section		6-C	9-C	9-D
Connection (internal thread)	"	Rp 1¼	Rp 1½	Rp 2
Water content of the coil	l	7.9	12.4	19.2

Table G14: Hydraulic connection of the cooling section in the roof unit (without hydraulic assembly)

3.10 Product information according to ErP

Trademark / Model		Hoval TopVent® SHC									Unit
		6AC	6BC	6CC	9AC	9BC	9CC	9AD	9BD	9CD	
Type		NRVU, UVU									–
Drive		Variable speed drive									–
Heat recovery system		none									–
Thermal efficiency of heat recovery (η_{t_nrvu})		–									%
Nominal flow rate (q_{nom})		1.67	1.67	1.67	2.50	2.50	2.50	2.50	2.50	2.50	m³/s
Effective electric power input (P)		1.16	1.20	1.29	2.05	2.12	2.27	2.20	2.27	2.42	kW
Internal specific fan power (SFP_{int})		162	162	162	65	65	65	65	65	65	W/(m³/s)
Face velocity		3.106	3.106	3.106	3.273	3.273	3.273	3.273	3.273	3.273	m/s
Nominal external pressure ($\Delta p_{s, ext}$)	Supply air	0			0					Pa	
	Extract air	–			–						
Internal pressure drop of ventilation components ($\Delta p_{s, int}$)	Fresh air/supply air	–			–					Pa	
	Extract air/exhaust air	–			–						
Static efficiency of the fans (η_{fan}) in accordance with Regulation (EU) No 327/2011		69.0			63.6					%	
Maximum leakage rate	External	≤ 1			≤ 1					%	
	Internal	–			–						
Energy classification of the filters	Supply air ePM ₁ 55 %	D			D					–	
	Extract air	–			–						
Visual filter warning		Displayed on the operating unit									–
Casing sound power level (L_{WA})		70			72					dB(A)	
Disassembly instructions		Devices that are no longer functional must be dismantled by a specialist company and disposed of at suitable collection points.									–
Contact details		Hoval Aktiengesellschaft Austrasse 70, 9490 Vaduz, Liechtenstein www.hoval.com									

Table G16: Product information according to Commission Regulation (EU) 1253/2014, Article 4(2)

4 Specification texts

4.1 TopVent® SHC

Supply air unit for ventilating, heating and cooling rooms up to 25 m in height with central heat and cold supply (4-pipe system); configured as roof unit; equipped with highly efficient air distributor.

The unit consists of the following components:

- Roof unit (with access to all components relevant for maintenance)
- Below-roof unit, consisting of:
 - Connection module
 - Air-Injector
- Optional components

The TopVent® SHC unit complies with all the requirements of the Ecodesign Directive 2009/125/EC relating to environmentally friendly design of ventilation systems. It is a system of the “non-residential ventilation unit” (NRVU) and “unidirectional ventilation unit” (UVU) type, provided for in Commission Regulation (EU) 1253/2014.

Roof unit

Self-supporting casing, construction made of thermally decoupled aluminium profile frame system with nylon connecting elements and panels made of coated zinc sheet (anthracite grey, similar to RAL 7016), additional rain canopy made of aluminium:

- Weatherproof, corrosion resistant, impact resistant, air-tight
- Low flammability, double-shelled, without heat bridges, with highly efficient insulation made of expanded polystyrene
- Hygienic and easy to maintain because of smooth interior surfaces and large access doors with ageing-resistant, silicone-free sealing materials

The roof unit includes:

Fan

Configured as maintenance-free, directly driven radial fan with high-efficiency EC motor, backwards-curved, 3D contoured blades and free-running rotor made of a high-performance composite material, aerodynamically optimised inflow nozzle, low-noise, with integrated overload protection.

Heating section

The heating section contains:

- The highly efficient heating coil consisting of seamless copper pipes with pressed-on, optimised and profiled aluminium fins and manifolds made of copper; for connection to the hot water supply
- Frost controller

Cooling section

The cooling section contains:

- The highly efficient cooling coil consisting of seamless copper pipes with pressed-on, optimised and profiled aluminium fins and manifolds made of copper; for connection to the cold water supply
- The pull-out condensate separator with collecting channel, made of high-quality corrosion-resistant material, with a downslope in all directions for rapid draining
- the condensate drain on the roof via siphon

Fresh air filter

Pleated cell filter of filter class ePM₁ 55% according to ISO 16890, consisting of micro glass with synthetic lamination as handle protection, pleat pack completely encapsulated to prevent leakage, frame made of recycled plastic, fully incinerable, including differential pressure switch for filter monitoring.

Extract air filter

Pleated cell filter of filter class ePM₁ 55% according to ISO 16890, consisting of micro glass with synthetic lamination as handle protection, pleat pack completely encapsulated to prevent leakage, frame made of recycled plastic, fully incinerable, including differential pressure switch for filter monitoring.

Fresh air damper

Damper consisting of sheet steel blades with sealing lip and plastic gearwheels; tightness class 4 according to EN 1751; including actuator with shut-off function by spring return.

Recirculation damper

Damper consisting of sheet steel blades with plastic gearwheels; tightness class 2 according to EN 1751; including actuator.

Unit control box

Control box for connection of the power supply and housing the control components that facilitate energy-optimised operation, controlled by the control system TopTronic® C. Plastic casing, protection rating IP56. The following components are installed:

- Circuit board with all required electrical components, unit controller (clipped on) as well as connection terminals for all internal and the following external connections:
 - Heating and cooling valve
 - Heating and cooling pump
 - Forced off

The circuit board is fitted with push-in terminals facilitating easy installation of the connection cables. All components in the unit control box as well as sensors, actuators in the unit and the isolation switch attached to the outside of the unit are fully factory-wired.

Power supply, bus connection, connection to Air-Injector actuator to be installed on site

Access openings

Defined side walls of the roof unit configured as inspection doors for easy access to all components relevant for maintenance. The hinges allow opening with an opening angle of 90° or complete removal of the inspection doors.

Below-roof unit

Connection module V1

Housing made of magnesium zinc sheet, air-tight, flame retardant, with highly efficient insulation made of expanded polystyrene, hygienic and easy to maintain because of smooth interior surfaces and ageing-resistant, silicone-free sealing materials; configured with:

- Extract air grille
 - Cable feedthroughs for the electric supply
 - Pipe feedthroughs for the hydraulic supply
- Installation and insulation of the pipelines on site

Connection module V2 / V3 (variant)

The connection module is extended for adapting to the local installation situation.

Design with Air-Injector

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, internally insulated with closed-cell polyethylene foam, with:

- Vortex air distributor with concentric outlet nozzle, adjustable vanes and integrated absorber hood
- Actuator for infinitely variable adjustment of the air distribution from vertical to horizontal
 - for draught-free air distribution in the hall under changing operating conditions
 - for the rapid and large-area reduction of temperature stratification in the room through induction of secondary air and strong mixing of the room air with supply air

Actuator installed in the connection module for easy access from the roof.

Design without Air-Injector (variant)

Unit configured without vortex air distributor for connection to an on-site supply air duct and air distribution within the building.

Air distribution box (variant)

Housing made of magnesium zinc sheet, air-tight, hygienic and easy to maintain because of ageing-resistant, silicone-free sealing materials, insulated on the inside with closed-cell polyethylene foam; configured with 2 collars as connecting piece to the on-site air distribution system.

Options for the unit

Paint finish of below-roof unit

Exterior painting of the below-roof unit in choice of RAL colour.

Supply air silencer

Designed as a sound-absorbing mat made of melamine foam; hygienically perfect with carbon fibre coating; mounted in the roof unit; insertion loss 3 dB.

Hydraulic assembly throttling circuit

Assembly for hydraulic throttling circuit, sized for the coil in the unit and the Hoval TopTronic® C, consisting of:

- Control valve with volume flow presetting, ball valve and automatic air vent, installed and wired in the roof unit
- Pre-insulated corrugated pipelines installed in the below-roof unit for connection to the distribution network

Pipelines in the roof unit and in the below-roof unit to be connected on site, pipelines in the roof unit to be insulated on site

Pump control

Electrical components for controlling a mixing or injection circuit in the load circuit, factory-installed in the unit control box.

Roof frame

Consisting of 4 load-bearing side walls made of galvanised sheet steel with fastening rails for the roof foil, supplied loose with the matching connecting screws.

Assembly, insulation, integration in the roof structure on site.

4.2 TopTronic® C – System control

Zone-based control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size per system bus: 64 control zones with up to 10 supply and extract air handling units or supply air units and 10 recirculation units each.

Zone allocation

Configured in advance for the customer at the factory:

	Room designation	Unit type
Zone 1:	_____	_____
Zone 2:	_____	_____
...		

System structure

- Zone control panel made of coated sheet steel (light grey RAL 7035), ... x ... x ... mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - 1 zone controller and 1 room temperature sensor per zone (expandable to up to 4 room temperature sensors per zone)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in one control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Heating/cooling demand per zone with feedback monitoring

Functions, standard

- Zone-based autonomous room control. Temperature and ventilation control separately adjustable for each zone
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time
- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution

- Main operating modes of supply and extract air handling units:

VE Ventilation, infinitely variably adjustment

AQ.... Air quality, automatic control with Hoval combination sensor (option), optional reference variable:

- CO₂ or VOC
- Air humidity (optimised dehumidification mode)

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

EA Exhaust air, infinitely variably adjustment

SA Supply air, infinitely variably adjustment

ST Standby

- Main operating modes of supply air units:

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

SA Supply air, infinitely variably adjustment

With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC

ST Standby

- Main operating modes of recirculation units:

REC . Recirculation, infinitely variably adjustment

DES.. Destratification

ST Standby

- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)

- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- TopTronic® C-ZT as zone operator terminal: for simple on-site operation of a control zone
- Manual operating selector switches
- Manual operating selector buttons
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP
 - Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Alarm lamp
- Socket

Per zone:

- The change-over between heating and cooling can be either automatic or manual
 - Cooling lock switch for automatic changeover
 - Heating/cooling switch for manual changeover
- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Combination sensor fresh air temperature and humidity
- Transfer of actual values and setpoints from external systems (0-10 V; 4-20 mA)
- Load shedding input
- Signal for external extract air fan
- Operating selector switches on terminal
- Operating selector button on terminal
- Control of distributor pump, incl. power supply
- Control box TW Pro

Power distribution:

- Circuit breakers and output terminals for Hoval indoor climate units
- Safety relay (4-pin)

4.3 TopTronic® C – Single zone control panel

Control system for the energy-optimised operation of decentralised Hoval indoor climate systems. Maximum system size: 1 control zone with up to 10 supply and extract air handling units or supply air units and 10 recirculation units.

System structure

- Zone control panel, designed as compact cabinet for wall installation, made of coated sheet steel (light grey RAL 7035), 380 × 300 × 210 mm, with:
 - System operator terminal
 - Fresh air temperature sensor
 - Zone controller
 - 1 Room temperature sensor (expandable to up to 4 room temperature sensors)
 - Safety relay
 - Electrical cabinet internally pre-wired, all components routed to terminals
- Zone bus: as serial bus for communication with all controllers in the control zone, with robust bus protocol via shielded, twisted bus cable (provided by the client)
- Unit controller: installed in the particular indoor climate unit, works autonomously according to the specifications of the zone controller
- Circuit board with external connections for:
 - Power supply
 - Zone bus
 - Room temperature sensors (max. 4)
 - Fresh air temperature sensor
 - Combination sensor room air quality, temperature and humidity
 - Collective alarm
 - Forced off
 - Heating demand
 - Setpoint heating demand
 - Fault heat supply
 - Cooling demand
 - Fault cold supply
 - External enabling heating/cooling (for automatic changeover)
 - External setting heating/cooling (for manual changeover)
 - Changeover valves heating/cooling
 - External setpoint fresh air ratio
 - Operating selector switch on terminal (digital)
 - Operating selector button on terminal

Functions, standard

- Room temperature control via sequential control of the coils
- Room temperature control via room-supply air cascade by means of energy-optimised double sequence control with priority circuit for energy recovery (supply and extract air handling units)
- Intelligent automatic heating to reach the desired room temperature at the switching time

- 5 adjustable room temperature set values per zone:
 - Cooling protection (lower setpoint in standby)
 - Overheating protection (upper setpoint in standby)
 - Room set value winter
 - Room set value summer
 - Night cooling set value (free cooling) (supply and extract air handling units, supply air units)
- Destratification mode for even temperature distribution
- Main operating modes of supply and extract air handling units:
 - VE Ventilation, infinitely variably adjustment
 - AQ.... Air quality, automatic control with Hoval combination sensor (option), optional reference variable CO₂ or VOC
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - EA Exhaust air, infinitely variably adjustment
 - SA Supply air, infinitely variably adjustment
 - ST Standby
- Main operating modes of supply air units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - SA Supply air, infinitely variably adjustment
 - With Hoval combination sensor (option) also demand-driven control of the fresh air ratio, optional reference variable CO₂ or VOC
 - ST Standby
- Main operating modes of recirculation units:
 - REC . Recirculation, infinitely variably adjustment
 - DES.. Destratification
 - ST Standby
- Forced heating (construction site heating) can be activated on each device before completion of the overall system (activation by Hoval service technician)
- Control of draught-free air distribution with the Hoval Air-Injector: the discharge direction is adjusted infinitely variably and automatically according to the respective operating condition and the existing temperatures (heating/cooling).

Operation

- TopTronic® C-ST system operator terminal: touch panel for visualisation and control of all Hoval indoor climate units registered on the bus

Options for operation

- Activation of the system operator terminal for VNC access, for visualisation on customer's PC
- Operating of the units via building management system via standardised interfaces:
 - BACnet
 - Modbus IP
 - Modbus RTU

Alarms, protection

- Central alarm management with registration of all alarms (timestamp, priority, status) in an alarm list and alarm memory of the last 50 alarms; forwarding via e-mail can be set in the parameters.
- If there is a failure of communication, bus stations, sensor systems or supply media, each part of the system transitions to a protection mode which safeguards operation.
- A maintenance mode implemented in the control algorithm for testing all physical data points and alarms guarantees high reliability.
- Pre-programmed data points retrievable via logger function for 1 year

Options for the zone control panel

- Additional room temperature sensors (max. 3)
- Combination sensor room air quality, temperature and humidity
- Signal for external extract air fan
- Control box TW Pro

4.4 HovalSupervisor cloud TopTronic® C

(Terms of use according to www.hoval.com/hsc are accepted when ordered.)

HovalSupervisor cloud TopTronic® C

Remote access, visualisation, historization, trends, evaluations and alarming for Hoval indoor climate systems with TopTronic® C control

- Project-specific system engineering
- Visualisation of the system statuses, error messages, actual and nominal values of the entire plant system
- Graphical display of the entire plant control system, in order to complete an analysis of sequences and subsequently to be able to perform an optimisation
- Integrated continuous line recorder for a period of 3 years
- Integrated alarm management
- Multi-user system: simultaneous access, 2 users included per plant
- Max. 300 data points historicized
- Max. 10 control zones

Consisting of:

- Project-specific engineering of the visualisation as described above
- Industrial router for connecting the TopTronic® C control system
 - Metal casing installed in the zone control panel
 - Without SIM card, free choice of phone network
 - Router configuration possible via web server
 - Network connections:
 - 2 x 10/100 Mbit Ethernet
 - 2 x SIM card slot
 - SMA connections:
 - 1 x WLAN
 - 2 x mobile data via integrated antenna
 - Power supply for industrial router installed in zone control panel

HovalSupervisor cloud TopTronic® C subscription

Subscription for use of the HovalSupervisor cloud for visualisation of a TopTronic® C system

- 1 year term (subscription billed once a year)
- Use of the HovalSupervisor cloud and storage of the data in the cloud
- Paid support during business hours (only for the software, not for the system)
- The respective valid conditions of use and the service level agreement (SLA) apply, which can be retrieved online.

Options for HovalSupervisor cloud

- Antenna to improve mobile data reception in conjunction with the HovalSupervisor cloud TopTronic® C
 - Antenna with mounting bracket for on-site installation outside the TopTronic® C zone control panel
 - 2G/3G/4G-LTE/5G-ready
 - SMA port available on the antenna
- Antenna extension cable for connecting the antenna in conjunction with the HovalSupervisor cloud
 - SMA port
 - Double shielded
 - Length: 5 m

1 Type code	114
2 Connection module.	118
3 Design without Air-Injector	118
4 Air distribution box	118
5 Outlet nozzle	119
6 Paint finish of below-roof unit	119
7 Supply air silencer	119
8 Adiabatic cooling	120
9 Hydraulic assembly throttling circuit	123
10 Pump control	124
11 Roof frame	128



Options

1 Type code

1.1 Type code for recirculation units

Availability			CHC - 9 B C / ST . V1 . D1 / -- . CL . Z / V . -- / TC . PP . --									
↓												
Unit type												
CH			CH	Recirculation unit with heating section								
	CC		CC	Recirculation unit with heating/cooling section								
		CHC	CHC	Recirculation unit with heating and cooling section								
Unit size												
•	•	•	6	Size 6								
•	•	•	9	Size 9								
Heating section												
	•		-	without heating section								
•		•	A	with coil type A								
•		•	B	with coil type B								
•		•	C	with coil type C								
Heating/cooling section												
•			-	without heating/cooling section								
	•	•	C	with coil type C								
	•	•	D	with coil type D								
Design												
•	•	•	ST	Standard								
Connection module												
•	•	•	V1	Standard								
•	•	•	V2	Length + 450 mm								
•	•	•	V3	Length + 900 mm								
Air outlet												
•	•	•	D1	Design with Air-Injector								
•	•	•	D0	Design without Air-Injector								
•	•	•	DB	Air distribution box								
•			DN	Outlet nozzle								
Reserve												
Surface												
•	•	•	--	Standard								
•	•	•	CL	Paint finish of below-roof unit (as desired)								
Silencer												
•	•	•	-	without								
•	•	•	Z	Supply air silencer								

Availability			CHC - 9 B C / ST . V1 . D1 / -- . CL . Z / V . -- / TC . PP . --		
CH	CC	CHC			
Hydraulics					
•	•	•	-	without	
•	•	•	V	Hydraulic assembly throttling circuit	
Reserve					
Control system					
•	•	•	TC	TopTronic® C	
•	•		KK	Terminal box design	
Pump control					
•	•	•	--	without	
•	•	•	PH	Heating pump	
	•	•	PK	Heating or cooling pump	
	•	•	PP	Heating pump and cooling pump	
Reserve					

Table H1: Type code and availability of recirculation units

1.2 Type code for supply air units

Availability			SHC - 9 B C / ST . V1 . D1 / -- . CL . Z / V . -- / TC . PP . --									
↓												
			Unit type									
SH			SH Supply air unit with heating section									
SC			SC Supply air unit with heating/cooling section									
SHC			SHC Supply air unit with heating and cooling section									
SH SC SHC												
			Unit size									
• • •			6 Size 6									
• • •			9 Size 9									
			Heating section									
•			- without heating section									
• •			A with coil type A									
• •			B with coil type B									
• •			C with coil type C									
			Heating/cooling section									
•			- without heating/cooling section									
• •			C with coil type C									
• •			D with coil type D									
			Design									
• • •			ST Standard									
			Connection module									
• • •			V1 Standard									
• • •			V2 Length + 450 mm									
• • •			V3 Length + 900 mm									
			Air outlet									
• • •			D1 Design with Air-Injector									
• • •			D0 Design without Air-Injector									
• • •			DB Air distribution box									
			Adiabatic cooling									
• • •			-- without									
•			AC Adiabatic cooling (only for unit size 9)									
•			AV Adiabatic cooling incl. control valve (only for unit size 9)									
			Surface									
• • •			-- Standard									
• • •			CL Paint finish of below-roof unit (as desired)									
			Silencer									
• • •			- without									
• • •			Z Supply air silencer									

Availability

SHC - 9 B C / ST . V1 . D1 / -- . CL . Z / V . -- / TC . PP . --

SH SC SHC

Hydraulics

- • • - without
- • • V Hydraulic assembly throttling circuit

Reserve

Control system

- • • TC TopTronic® C

Pump control

- • • -- without
- • • PH Heating pump
- • • PK Heating or cooling pump
- • • PP Heating pump and cooling pump

Reserve

Table H2: Type code and availability of supply air units

2 Connection module

The connection module is available in 3 lengths for adapting the unit to local conditions.

The connection module V3 is equipped with 2 installation lids.


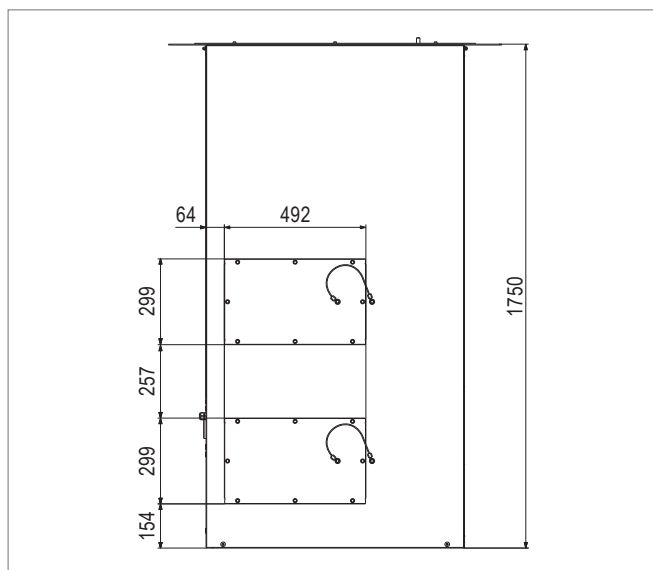


Fig. H1: Installation lids in connection module V3

3 Design without Air-Injector

TopVent® units in the design without Air-Injector are suitable for connecting to an air distribution system supplied by the client.

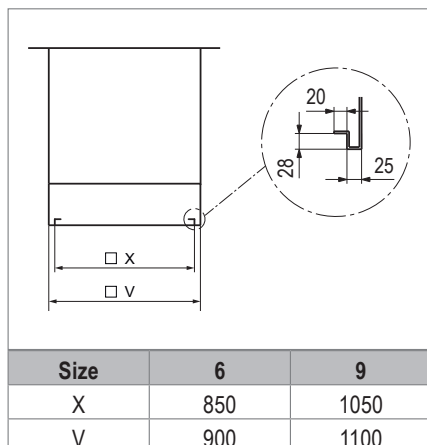

Size	6	9
X	850	1050
V	900	1100

Table H3: Supply air duct connection dimensions (in mm)

4 Air distribution box

For easy connection to ventilation ducts or fabric sleeves, TopVent® units are available with an air distribution box. This has a collar on 2 opposite sides as a connection piece to the on-site air distribution system. The air distribution box replaces the Air-Injector.


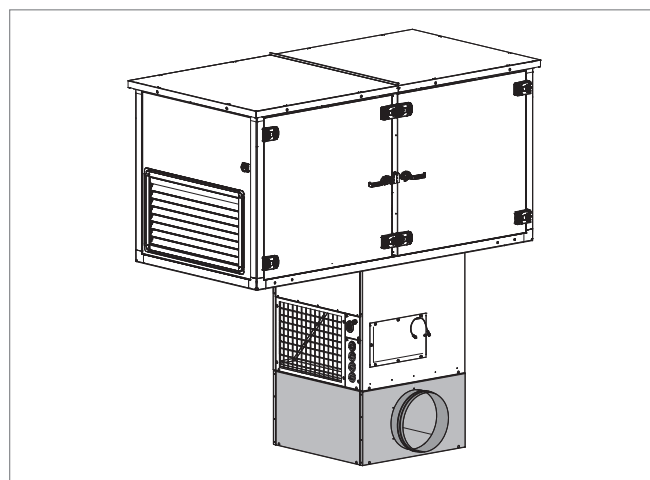


Fig. H2: TopVent® unit with air distribution box

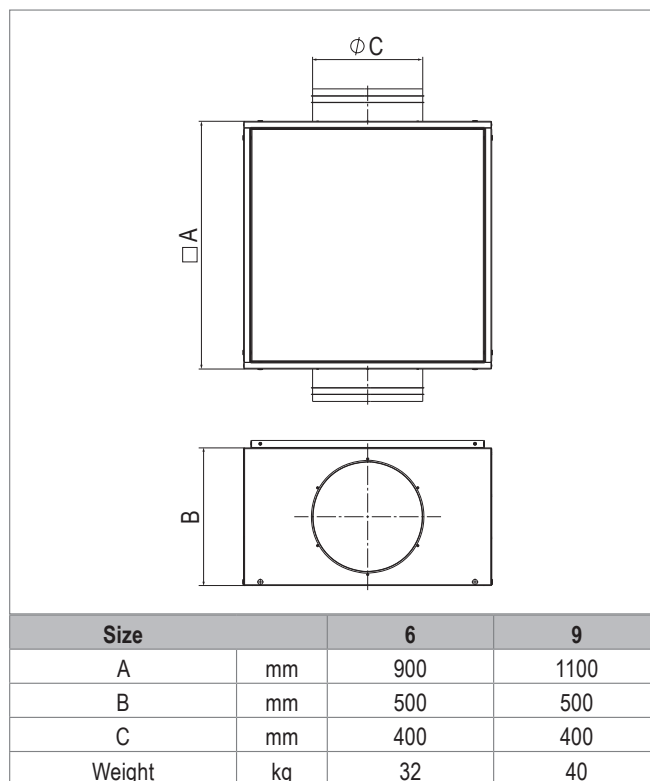

Size		6	9
A	mm	900	1100
B	mm	500	500
C	mm	400	400
Weight	kg	32	40

Fig. H3: Air distribution box dimensions and weights

5 Outlet nozzle

For low-cost recirculation heating the TopVent® CH unit is available with a simple outlet nozzle. The air discharge angle cannot be adjusted. Units with outlet nozzle are well-suited for applications with lower comfort requirements and for large mounting heights (e.g. in high-bay warehouses).

The outlet nozzle replaces the Air-Injector. The external dimensions of the unit remain the same.

Size		6	9
Weight	kg	31	37

Fig. H4: Outlet nozzle weights

6 Paint finish of below-roof unit

On request, the below-roof unit can be provided with an exterior painting in choice of RAL colour.

7 Supply air silencer

The supply air silencer reduces noise emissions from TopVent® units. It consists of a sound-absorbing mat made of melamine foam and is mounted above the fan on the casing ceiling. Insertion attenuation is 3 dB compared with the total sound power level of each TopVent® unit. Weight: 20 kg.

8 Adiabatic cooling

To increase comfort in the hall at high fresh air temperatures, TopVent® SH supply air units are available with adiabatic cooling. The units are equipped with an evaporative cooler for direct adiabatic cooling of the supply air flow. This significantly improves the indoor climate on hot days.



Notice


Only use adiabatic cooling to improve comfort at high room temperatures ($> 25\text{ °C}$). Direct adiabatic cooling is not suitable for continuous operation. It can lead to moisture build-up in the room air and cause corrosion.

Construction and operation

The following components are installed in the unit:


- Evaporative cooler consisting of contact humidifier, water distribution system and collection tray
- Adiabatic supply valve
- Adiabatic drain valve
- Water drain
- Pipe inlet for the water supply line in the below-roof unit

A pressure-reducing valve for on-site installation into the roof unit is optionally available.

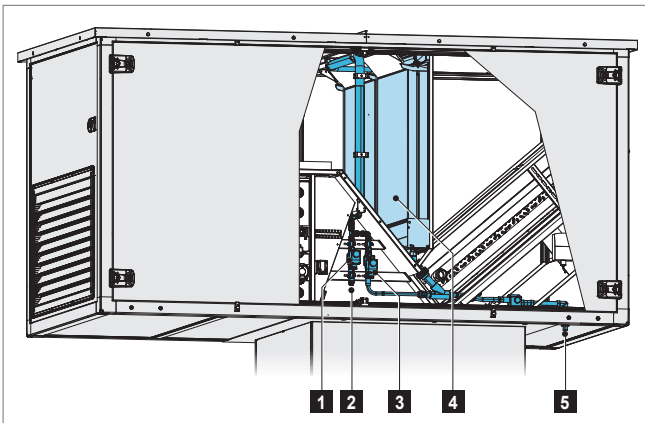

- 1 Adiabatic supply valve
- 2 Water supply connection
- 3 Adiabatic drain valve
- 4 Evaporative cooler
- 5 Water drain

Fig. H5: TopVent® SH with adiabatic cooling

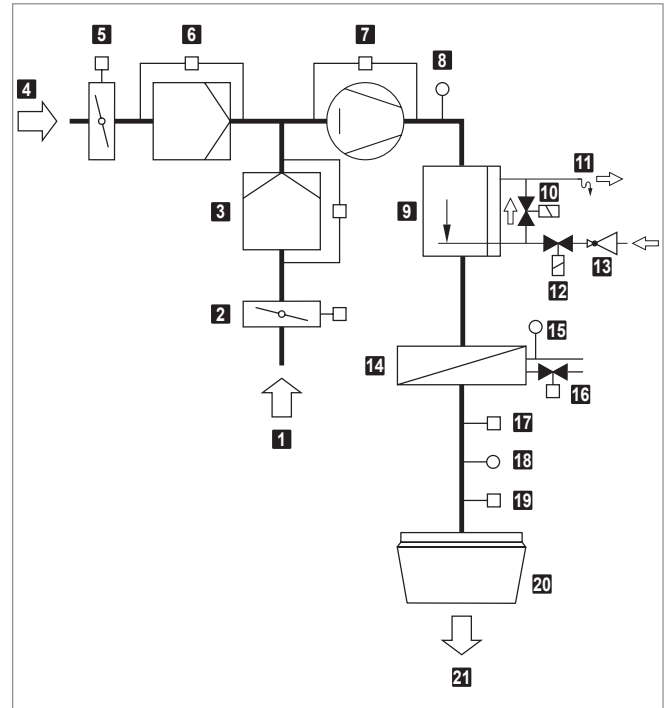

- 1 Extract air
- 2 Recirculation damper with actuator
- 3 Extract air filter with differential pressure switch
- 4 Fresh air
- 5 Fresh air damper with actuator
- 6 Fresh air filter with differential pressure switch
- 7 Fan with flow rate monitoring
- 8 Mixed air combination sensor (temperature and humidity)
- 9 Contact humidifier
- 10 Adiabatic drain valve
- 11 Siphon
- 12 Adiabatic supply valve
- 13 Pressure reducing valve (option "AV")
- 14 Heating coil
- 15 Return temperature sensor
- 16 Control valve with actuator (option)
- 17 Frost controller
- 18 Supply air temperature sensor
- 19 Actuator Air-Injector
- 20 Air-Injector
- 21 Supply air

Fig. H6: Function diagram



Notice

For units with adiabatic cooling the option "hydraulic assembly throttling circuit" is not available.

Technical data

Cooling capacity					
t_M °C	RH_M %	Q_{sen} kW	t_S °C	RH_S %	V_W l/h
28	60	12.3	22.7	93.9	17.7
	50	15.8	21.3	91.6	22.8
	40	19.5	19.7	88.9	28.1
30	60	12.9	24.5	94.1	18.6
	50	16.6	22.9	91.9	23.9
	40	20.5	21.3	89.1	29.6
32	60	13.5	26.2	94.2	19.5
	50	17.4	24.6	92.1	25.1
	40	21.6	22.8	89.4	31.1
34	60	14.1	28.0	94.3	20.3
	50	18.2	26.2	92.3	26.2
	40	22.6	24.4	89.6	32.6
36	60	14.6	29.8	94.2	21.0
	50	19.0	27.9	92.3	27.3
	40	23.6	25.9	89.8	34.0

Legend:

- t_M = Temperature of the mixed air
- RH_M = Relative humidity of the mixed air
- Q_{sen} = Sensible cooling capacity
- t_S = Temperature of the supply air
- RH_S = Relative humidity of the supply air
- V_W = Water consumption

Table H4: Cooling capacity TopVent® SH-9 with adiabatic cooling

Application limits			
Mixed air temperature	min.	°C	10
	max.	°C	60
Relative humidity of the mixed air	min.	%	5
	max.	%	85

Table H5: Application limits TopVent® SH-9 with adiabatic cooling

Water supply		
Flow rate	l/h	250 ± 20 %

Table H6: Water supply for TopVent® SH-9 with adiabatic cooling


Air flow rate		Heating mode	Cooling mode
Nominal air flow rate	m³/h	9000	7000
Floor area covered	m²	946	661

Table H7: Air flow rate TopVent® SH-9 with adiabatic cooling

Sound level		SH-9C	
		indoors	outdoors ¹⁾
Sound pressure level (at a dist. of 5 m) ²⁾	dB(A)	59	50
Total sound power level	dB(A)	81	72

¹⁾ with fresh air ratio 10 %
²⁾ with a hemispherical radiation pattern in a low-reflection room

Table H8: Sound level TopVent® SH-9 with adiabatic cooling

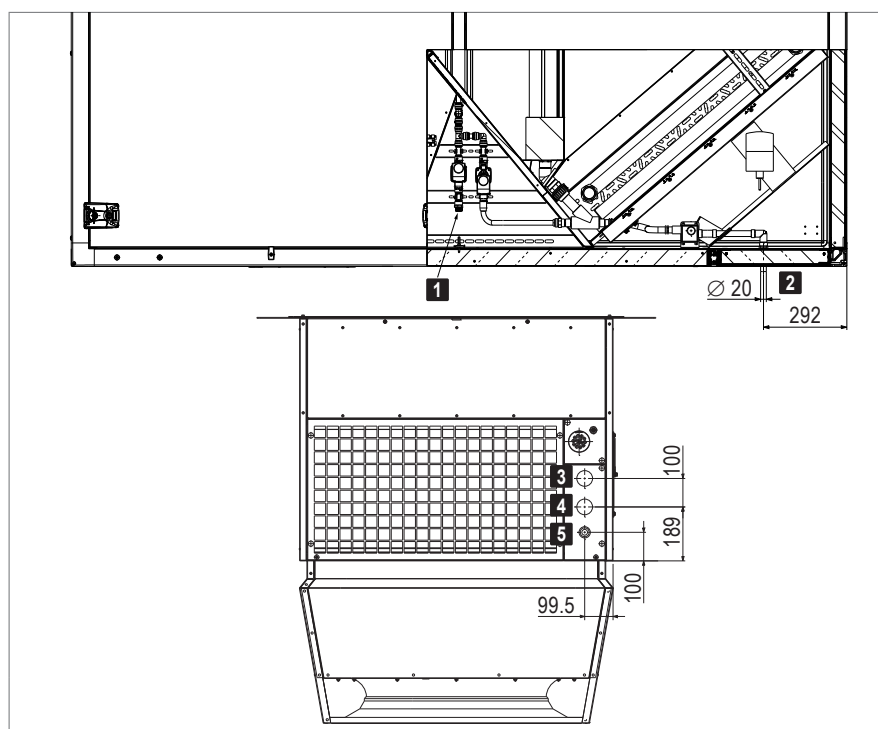

- 1 Water supply connection 1/2" (external thread)
- 2 Water drain
- 3 Heating circuit return
- 4 Heating circuit flow
- 5 Pipe inlet for the water supply line Ø 12-24 mm

Assembly weight: 40 kg

Fig. H7: Dimensions and weights (in mm)

Please note the following:

- Use tap water that meets the following specification:

Water quality		
pH value	–	6.5-8.2
Electrical conductivity	µS/cm	< 500
Chloride concentration	ppm Cl ⁻	< 50
Sulfate concentration	ppm SO ₄ ²⁻	< 90
Ryznar Stability Index (RSI)	–	> 6
Colony-forming units (CFU)	CFU/ml	< 10 ²

Table H9: Water quality requirements



Attention

The use of demineralised or deionised water can cause damage to the ventilation unit.

- Ensure a constant water supply of 250 litres per hour (tolerance ± 20 %). Compensate for pressure fluctuations in the supply network with a pressure reducing valve or a control valve.
 - If the water flow rate is too high, droplets may be carried along with the air flow.
 - If the water flow rate is insufficient, operation will be adversely affected and the lifetime of the contact humidifier will be shortened.
- The constant water inflow inhibits the formation of scale and carries out pollutants. The water is not recirculated in the unit; water that has not evaporated flows off continuously via the drain line.
- The adiabatic cooling is automatically controlled by the TopTronic® C. It can be enabled for each individual unit via a selector switch and is then switched on as required in the following operating modes:
 - Supply air speed 2 (SA2)
 - Supply air speed 1 (SA1)
 - Recirculation (REC)
 - Recirculation speed 1 (REC1)
- To prevent bacterial growth, the contact humidifier is dried out every 24 hours.
- After 24 hours of standstill, the water distribution system and the collection tray are automatically emptied.
- The evaporative cooler must be inspected and serviced annually:
 - Cleaning the contact humidifier with a high-pressure cleaner
 - Removing scale with a soft brush
 - Cleaning of holes in the water distribution pipe
- For easy cleaning and to reduce pressure drop during the heating season, the contact humidifier is easily removable.

Installation

- The connection point for the water supply line is located in the roof unit.
 - Install the piping through the unit, a ball valve and, if necessary, the pressure reducing valve.
 - Carry out a leak-tightness test and insulate the water supply line.
- Connect the water drain line to a waste water system.

Pressure reducing valve

Optional pressure reducing valves are available for on-site installation into the roof unit (option “AV”). They comply with the following specification:

- Pre-adjustable pressure reducing valve with replaceable cartridge
- Dezincification-resistant alloy body
- With pressure gauge connection 1/4" (internal thread)
- Max. upstream pressure: 25 bar
- Downstream setting pressure range: 1-6 bar
- Max. working temperature: 40 °C

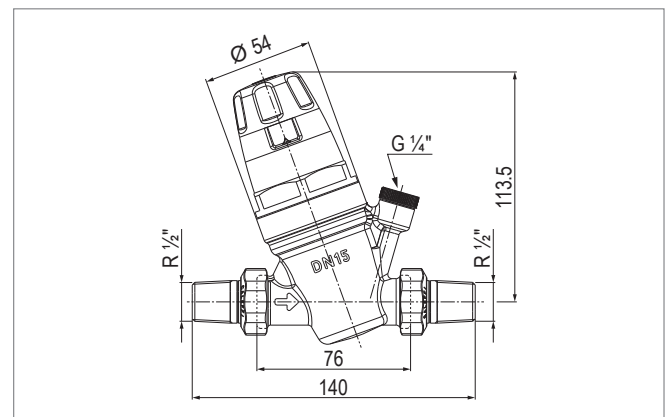


Fig. H8: Pressure reducing valve dimensions

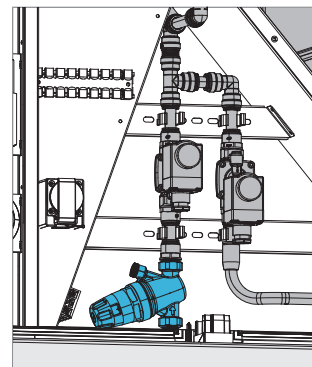


Fig. H9: Pressure reducing valve installed in the roof unit

9 Hydraulic assembly throttling circuit

For easy installation, TopVent® units are available with a pre-installed assembly for the hydraulic throttling circuit. The assembly consists of the following components:

- Installed and wired in the roof unit, each for the heating and cooling circuit:
 - Pressure independent control valve for precise temperature control with digitally configurable, proportional actuator
 - Ball valve
 - Automatic air vent
- Installed in the below-roof unit for connection to the distribution network:
 - Pre-insulated corrugated pipelines through the connection module

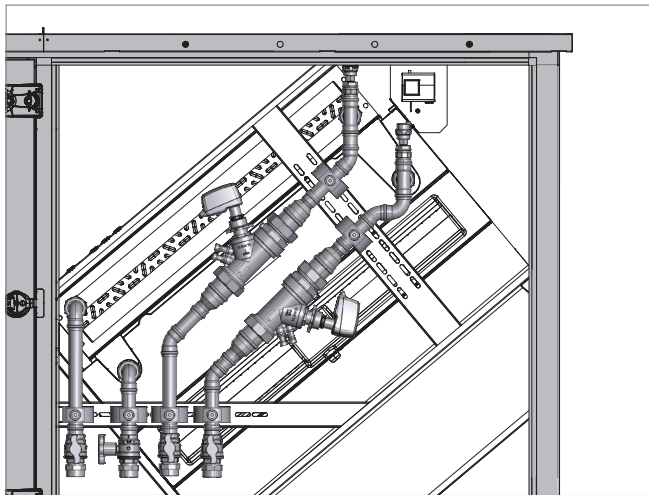


Fig. H10: Hydraulic assembly installed in the roof unit (here for heating and cooling in a 4-pipe system)

Please note the following:

- Connect the piping in the roof unit and in the below-roof unit.
- Insulate the pipelines in the roof unit.



Notice

When used in cooling circuits, ensure correct insulation in accordance with national regulations and standards. Complete external corrosion protection must be applied.

- Connect the on-site pipe network to the below-roof unit in the hall.
- Mount the pipelines so that their weight does not need to be absorbed by the unit.

Technical data

Size			6	9
			DN 40	DN 50
Differential pressure ¹⁾	$\Delta p V_{\max}$ ²⁾	kPa	400	400
	$\Delta p V_{\min}$ ³⁾	kPa	30	30
Flow range ⁴⁾	$q_{\max}$	l/h	1000-6500	2150-11200
Media			Water, neutral fluids, water-glycol mixtures 0-50 %	

¹⁾ Valid for maximum setting, fully open
²⁾ The maximum allowed pressure drop over the valve to fulfil all stated performances
³⁾ The minimum recommended pressure drop over the valve, for proper differential pressure control
⁴⁾ Flow continuously adjustable within the range
 $q_{\max}$ = l/h at each setting and fully open valve plug

Table H10: Control valves technical data

Actuators technical data	
Power supply	24 VAC/VDC
Frequency	50/60 Hz
Power consumption for wire sizing	4.0 VA (VAC)
	1.9 W (VDC)
Control voltage	0(2)-10 VDC ¹⁾
Position response	0(2)-10 VDC ¹⁾
Running time	60 s
1 digital input	max. 100 Ω , cable max. 10 m long or shielded
1 relay	max. 5 A, 30 VDC/250 VAC on resistive load

¹⁾ Factory setting 2-10 VDC

Table H11: Actuators technical data

Unit type	CH, CC, SH, SC				CHC, SHC	
Size	6	9	6	9	6	9
Assembly in the roof unit	kg	8.9	10.7		18.0	21.6
Corrugated pipelines in the below-roof unit						
Connection module V1	kg	2.8			5.3	
Connection module V2	kg	3.7			7.1	
Connection module V3	kg	4.6			8.9	

Table H12: Hydraulic assembly weights

Unit type	Connection module	Water flow rate in l/h													
		1000	1250	1500	1750	2000	2500	3000	3500	4000	5000	6000	8000	10000	15000
CH, CC SH, SC	V1	0.21	0.33	0.51	0.66	0.83	1.31	1.89	2.51	3.27	5.28	7.53	13.31	20.84	46.94
	V2	0.28	0.45	0.69	0.89	1.13	1.78	2.56	3.41	4.44	7.17	10.23	18.08	28.31	63.77
	V3	0.57	0.57	0.87	1.13	1.43	2.25	3.24	4.31	5.61	9.06	12.93	22.85	35.78	80.60
CHC, SHC Heating circuit	V1	0.18	0.29	0.44	0.57	0.72	1.13	1.62	2.16	2.81	4.53	6.47	11.43	17.89	40.30
	V2	0.25	0.40	0.62	0.80	1.01	1.59	2.30	3.06	3.98	6.42	9.17	16.20	25.36	57.13
	V3	0.52	0.52	0.80	1.03	1.31	2.06	2.97	3.96	5.15	8.31	11.87	20.97	32.83	73.96
CHC, SHC Cooling circuit	V1	0.21	0.33	0.51	0.66	0.83	1.31	1.89	2.51	3.27	5.28	7.53	13.31	20.84	46.94
	V2	0.28	0.45	0.69	0.89	1.13	1.78	2.56	3.41	4.44	7.17	10.23	18.08	28.31	63.77
	V3	0.57	0.57	0.87	1.13	1.43	2.25	3.24	4.31	5.61	9.06	12.93	22.85	35.78	80.60

Table H13: Pressure drop of the corrugated pipelines in the below-roof unit (values in kPa)

10 Pump control

Instead of the throttling circuit, a mixing or injection circuit can also be installed in the load circuit.

Please note the following:

- Not only the mixing valves but also the pumps in the load circuit are controlled directly by the unit control box.
- Terminals for wiring the mixing valves and the pumps in the load circuit are located in the unit control box.
- Install an automatic air vent in the roof unit at the highest point of the pipework.
- The return temperature sensor is pre-installed at the factory.
- Make sure that valves and pumps which meet the following requirements are provided on site.

Requirements for mixing valves

- Use 3-way mixing valves with the following flow characteristics:
 - Equal percentage control path
 - Linear bypass
- The valve authority must be ≥ 0.5 .
- The maximum run time of the valve actuator is 45 s.
- The valve actuator must be continuous, i.e. the stroke changes in proportion to the control voltage (0-10 VDC or 2-10 VDC).
- The valve actuator must be designed with a position response (0-10 VDC or 2-10 VDC).
- The maximum power consumption is 20 VA.
- Install the valve in or close to the unit (max. distance 2 m).

Requirements for pumps

- Voltage 230 V AC
- Total current max. 4.0 A for all pumps (heating pump, cooling pump)

Requirements on changeover valves

Use changeover valves conforming to the following specification for heating and cooling in the 2-pipe system:

- 3-way changeover valves
- Position response via limit switches (0°/90°)
- TopTronic® C System control
 - Supply voltage 24 V AC
 - 1-wire control (0/24 V AC)
 - Power consumption max. 44 VA
- TopTronic® C Single zone control panel
 - Supply voltage 24 V DC
 - 1-wire control (0/24 V DC)
 - Power consumption max. 13 VA

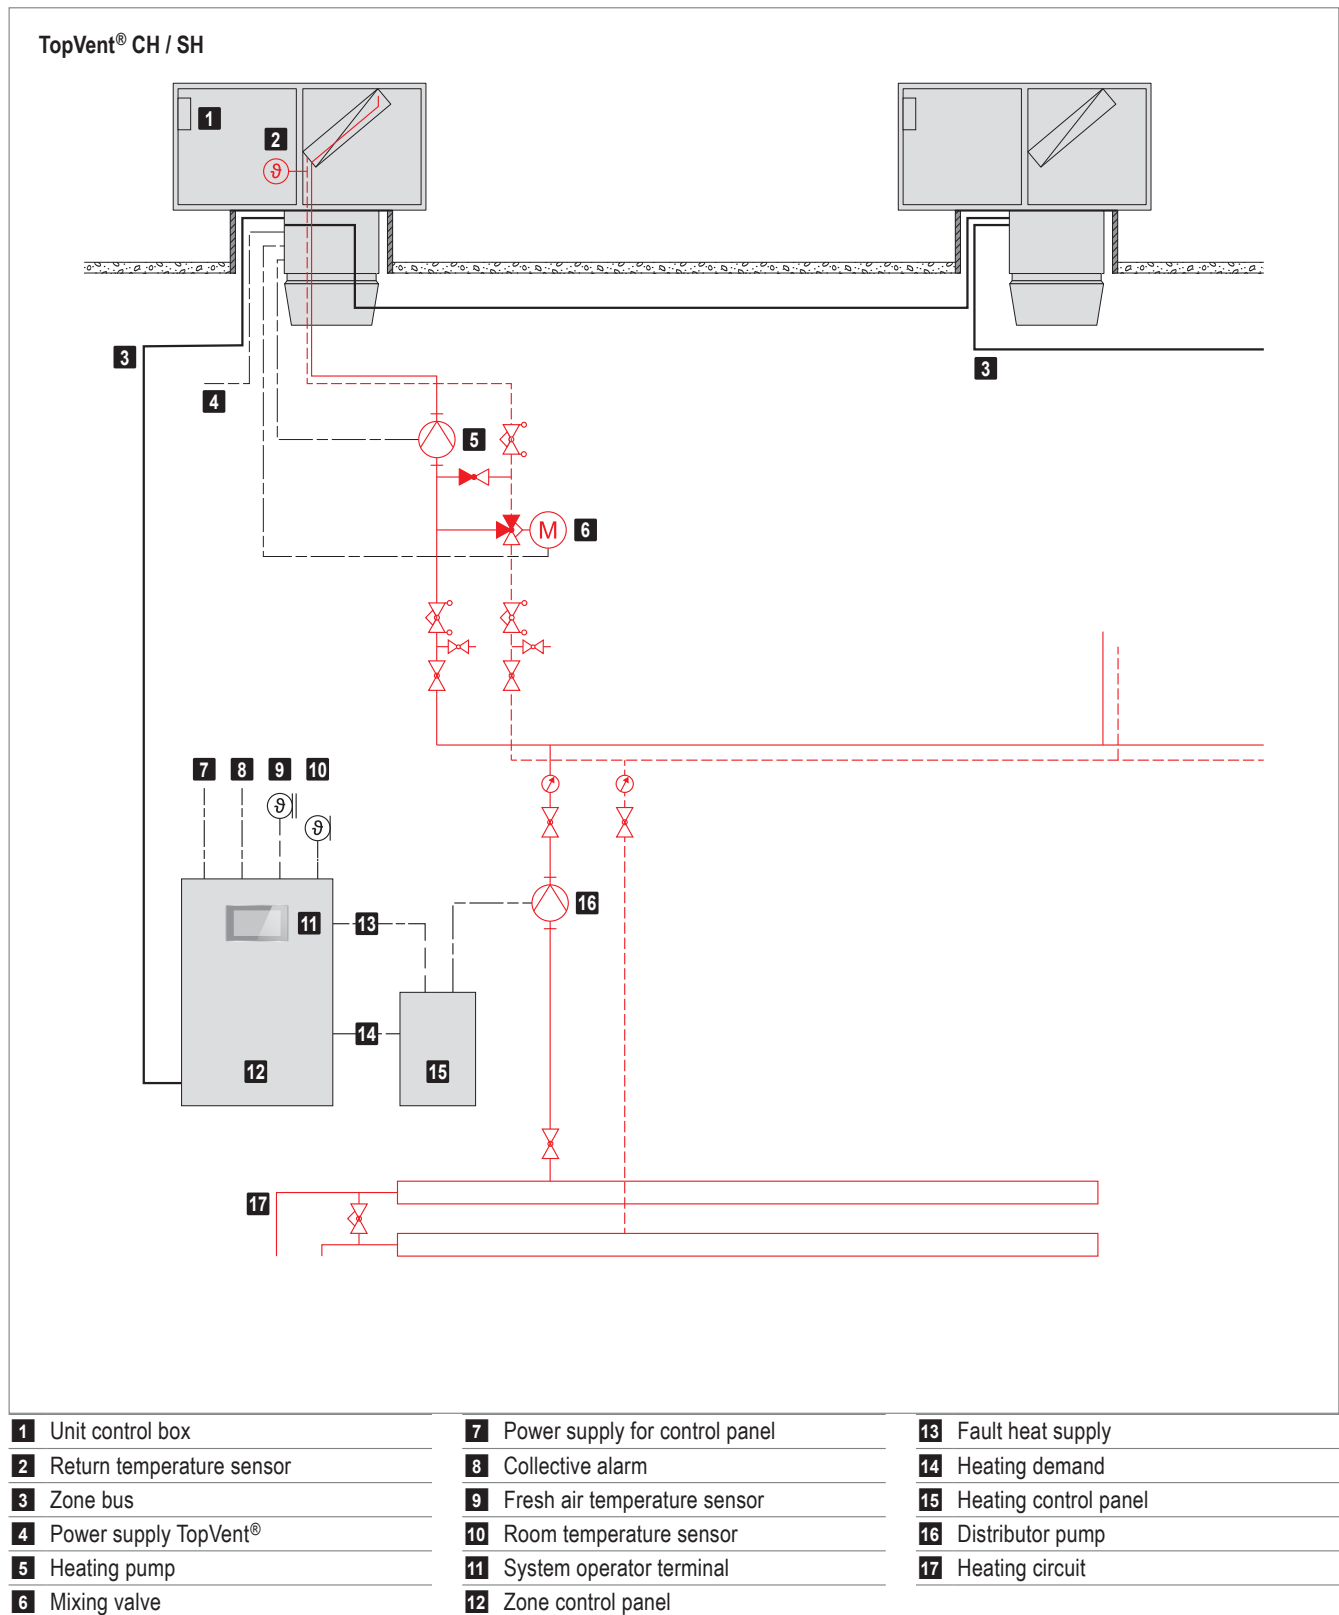


Fig. H11: Schematic diagram for injection circuit TopVent® CH / SH

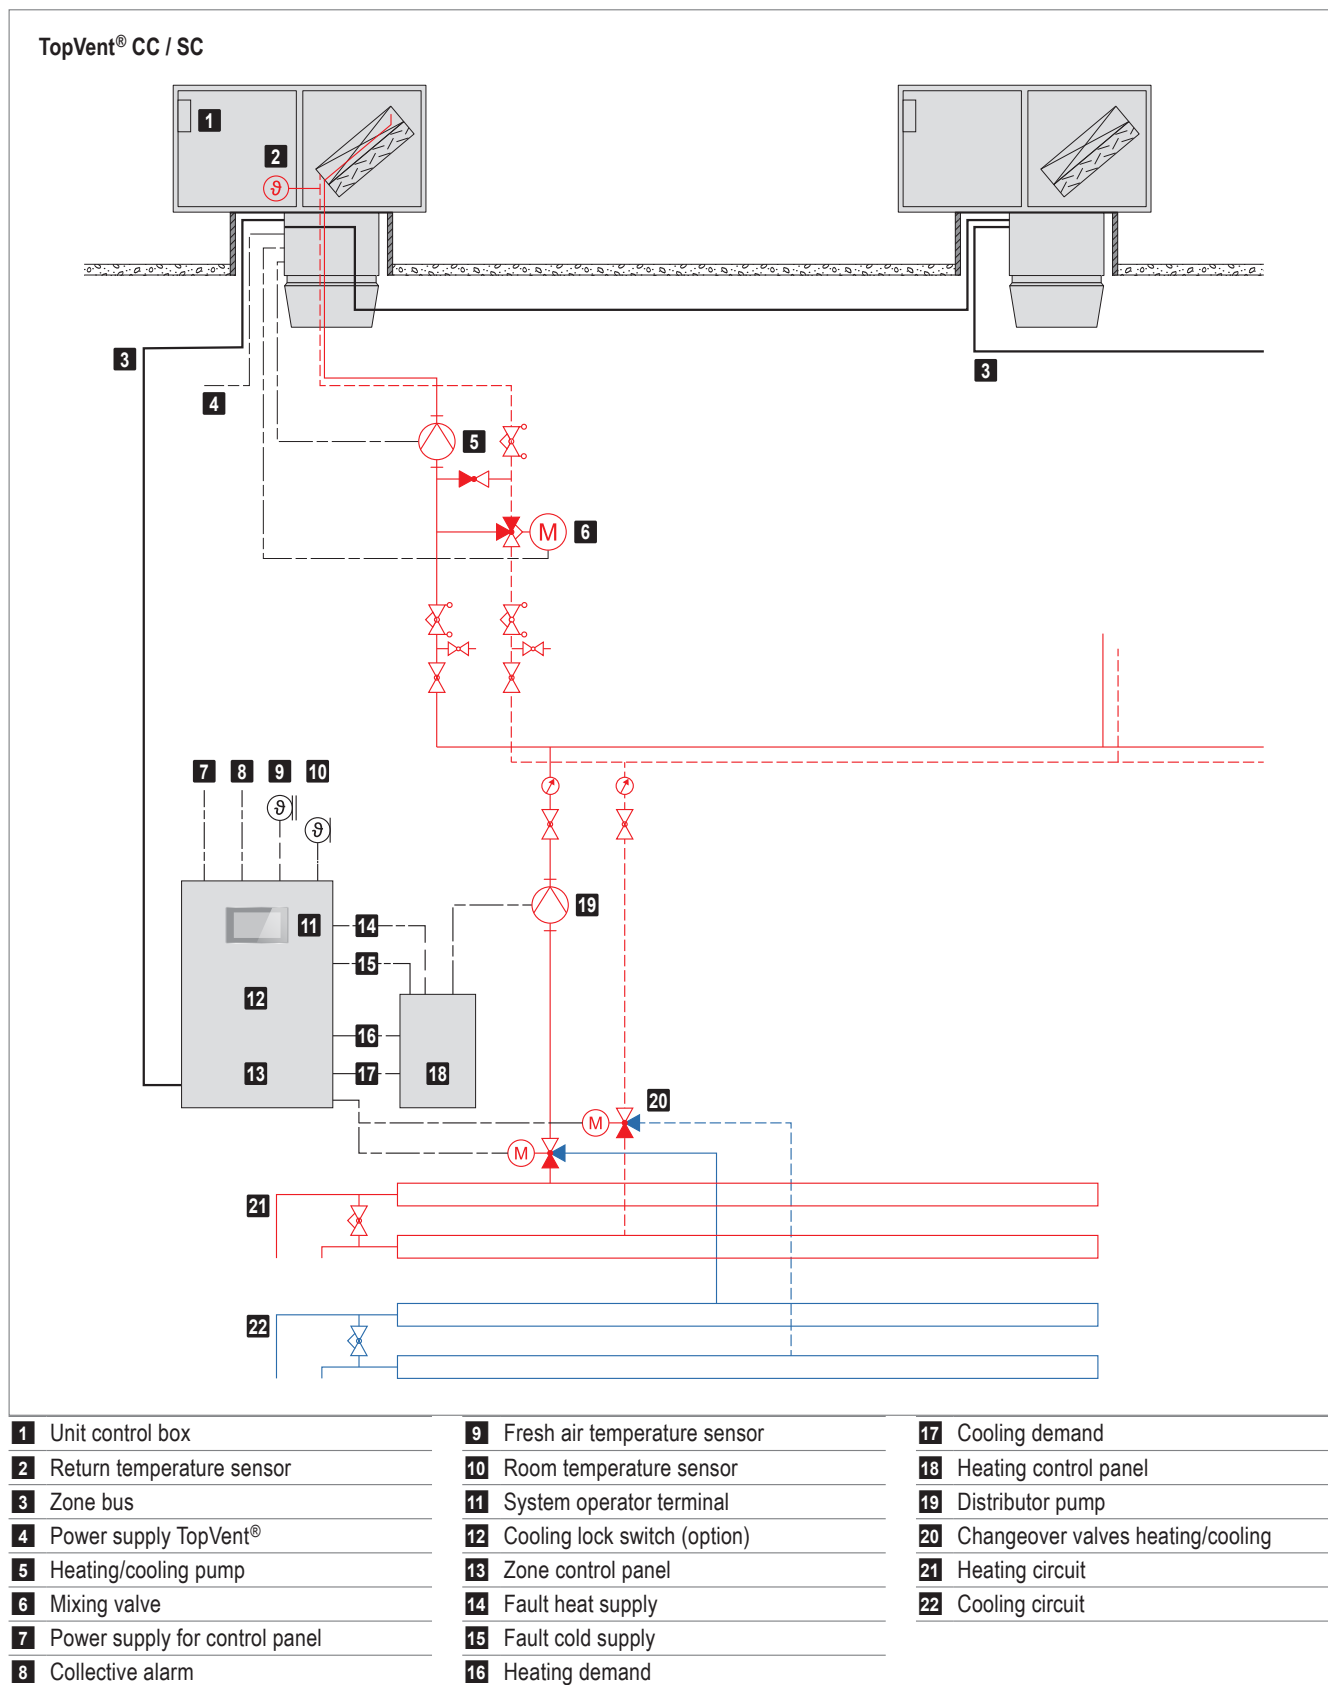


Fig. H12: Schematic diagram for injection circuit TopVent® CC / SC

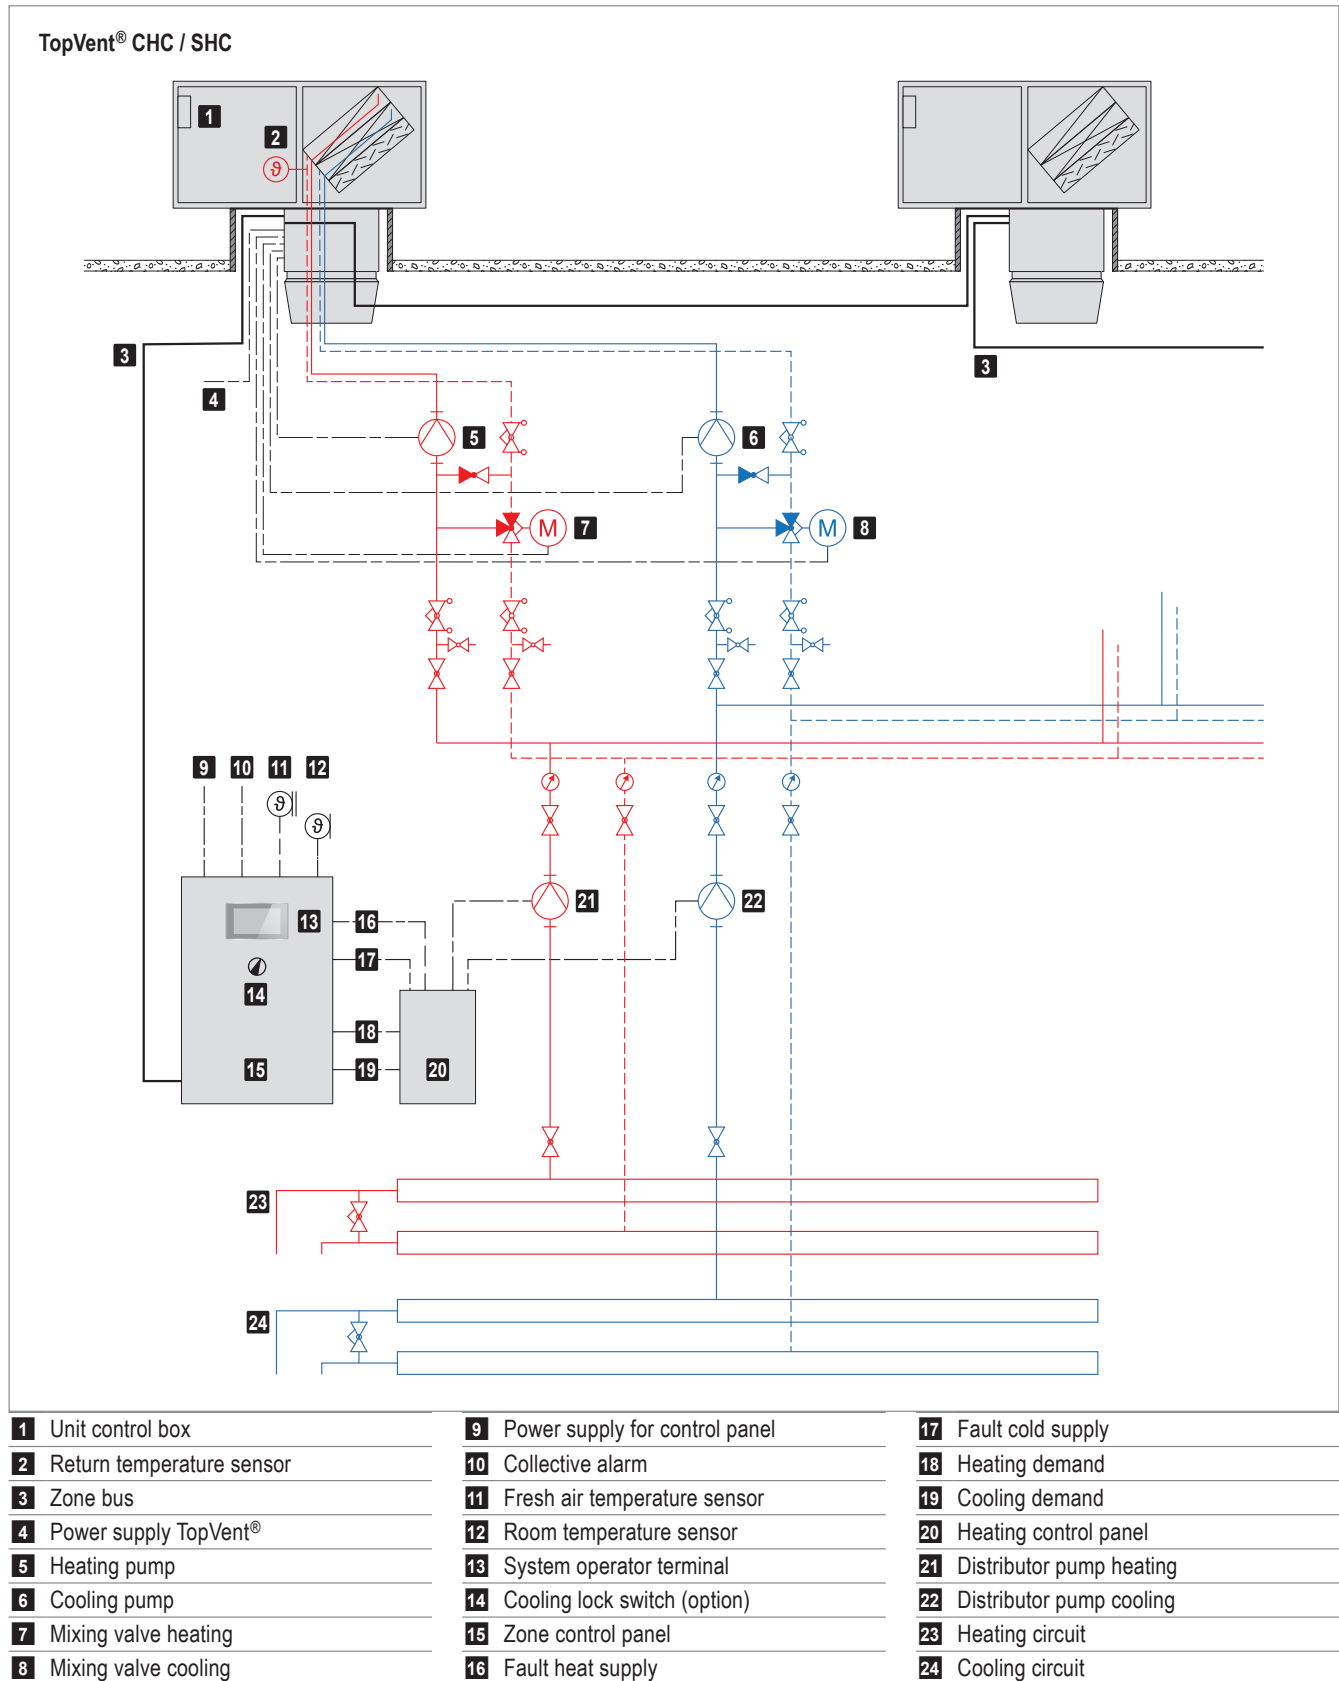


Fig. H13: Schematic diagram for injection circuit TopVent® CHC / SHC

11 Roof frame

For easy installation of the TopVent® units in the roof, suitable roof frames are available as accessories. The roof frames consist of 4 load-bearing side walls made of galvanised sheet steel with fastening rails for the roof foil. They are supplied loose with the appropriate connecting screws for assembly on site.

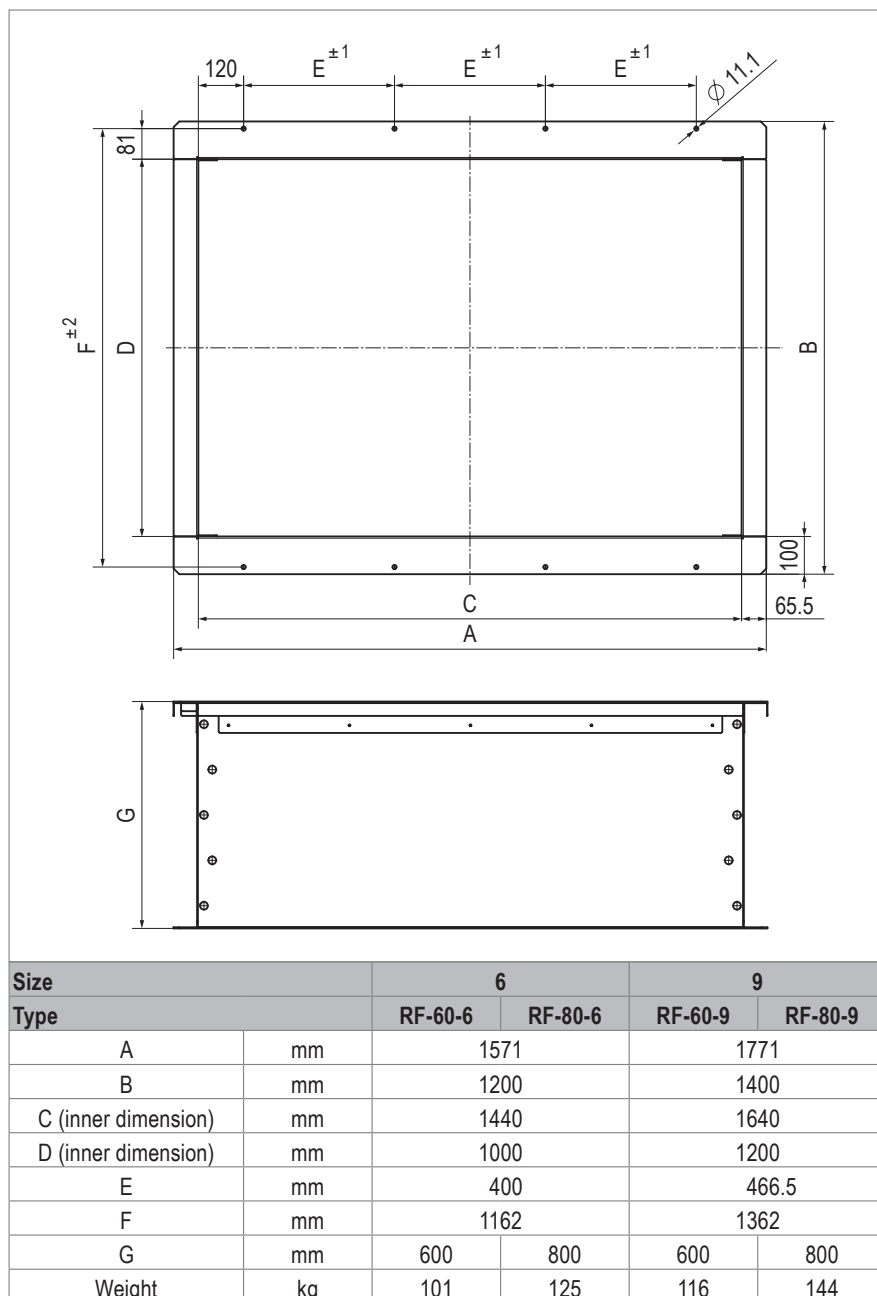


Fig. H14: Roof frame dimensions and weights

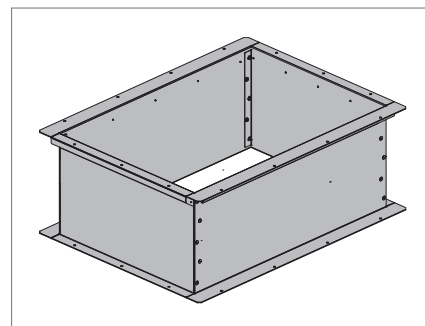


Fig. H15: Roof frame

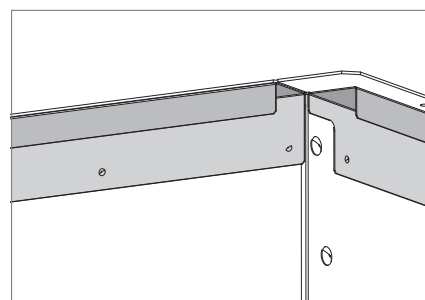


Fig. H16: Fastening rails for the roof foil



Transport and installation

1 Installation	130
2 Hydraulic installation	132
3 Electrical installation	136

1 Installation

1.1 Preparation

The following guidelines are important when preparing for installation:

- The scope of delivery includes:
 - TopVent® unit, delivered in 2 parts on pallets (roof unit, below-roof unit)
 - Accessories (lifting kit, transport eyes, installation material)
 - Optional components
- The units are installed in or on the roof. A crane or helicopter is required.
- Transport eyes are supplied for lifting the below-roof unit.
 - Use lifting ropes at least 2 m in length to lift the below-roof unit.
- A lifting kit is supplied for lifting the roof unit.
 - Use lifting straps at least 3 m in length to lift the roof unit.
- Use the roof frames available as accessories for quick and easy installation of the TopVent® units in the roof.
- A sealing compound is required for sealing (e.g. Sikaflex® -221).
- Follow the installation instructions included.




Notice

Provide suitable protective devices and make sure the units can be accessed easily. The roof of the TopVent® units cannot be walked on.

1.2 Positioning

- Comply with the minimum and maximum distances.
- All air inlet and air outlet openings must be freely accessible. The supply air jet must be free to spread out unhindered.
- The access doors in the roof unit must be freely accessible and there must be sufficient space for maintenance work.

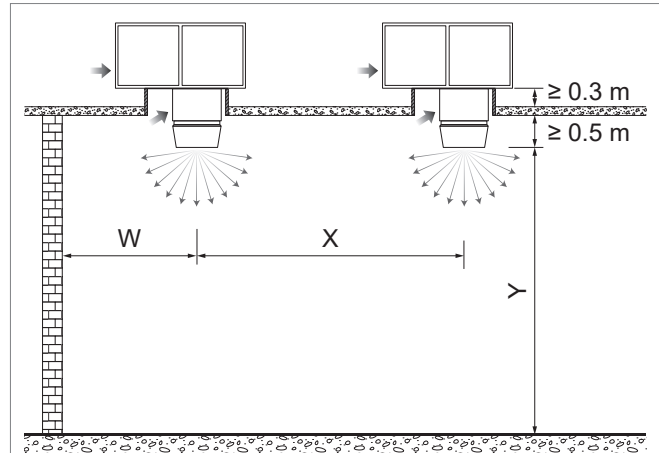

Unit type		CH, CC, CHC		SH, SC, SHC	
Unit size		6	9	6	9
Mounting height Y	max. ¹⁾	m			
	min.	m	4	5	4
Applications with higher comfort requirements					
■ Distance from wall W	max.	m	12	15	12
	min.	m	6	7	6
■ Unit clearance X	max.	m	23	31	23
	min.	m	12	14	12
Applications with low comfort requirements					
■ Distance from wall W	max.	m	15	20	–
	min.	m	6	7	–
■ Unit clearance X	max.	m	30	41	–
	min.	m	12	14	–

¹⁾ The maximum mounting height varies depending on the boundary conditions (for values, see table of heat outputs or calculation with the "HK-Select" selection program)

Fig. I1: Minimum and maximum distances

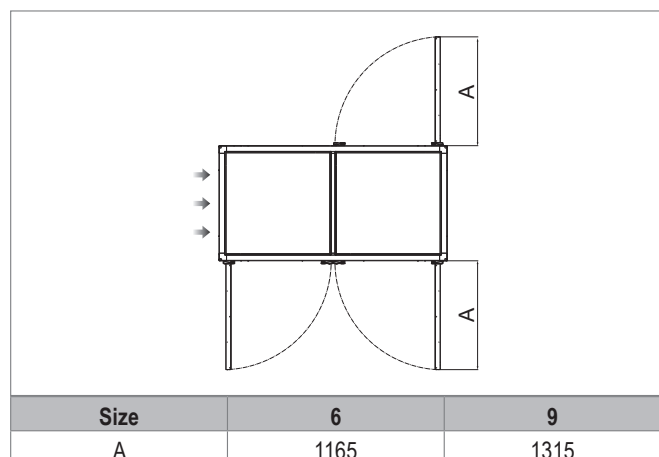


Fig. I2: Space requirements for opening the access doors (dimensions in mm)

1.3 Roof frame

Roof frames are required for installing TopVent® units in the roof. Suitable roof frames are available as accessories (see part H "Options", section 11).

Please consider the following in the design process:

- The extract air grille must be freely accessible under the roof.
- Observe the minimum distances according to Fig. I1.
- The roof frame must protrude at least 300 mm from the roof, so that no water can penetrate during a rainstorm or snowfall and to ensure that the fresh air weather protection is sufficiently high above the roof.



Notice

Roof frames are available in 2 heights and connection modules in 3 lengths for adapting to the local installation situation.

- The condensate must be able to drain off freely.
- Ensure that the supporting surface for the unit is flat and level.
- Insulate the roof frame before installing the unit (thermal insulation, 60 mm thick).
- Embed the roof frame tightly into the roof structure with roof foil.
- The following applies to any roof frames constructed on site:
 - The supporting surface must correspond to the specifications in Fig. H14 on page 128.

1.4 Unit installation

Proceed as follows to position the unit:

Below-roof unit

- Apply sealing compound to the roof frame.
- Fasten the adjustment screws in the roof frame.
- Screw in the transport eyes and attach the lifting gear.
- Transport the below-roof unit to the roof frame using a helicopter or crane.
- Turn the below-roof unit to the desired position.
- Hang the below-roof unit into the roof frame from above.

Roof unit

- Attach the lifting kit to the roof unit.
- Attach the lifting straps.
- Transport the roof unit to the roof, correctly position the roof unit over the below-roof unit and set it down.
- Screw the roof unit to the below-roof unit.
- Remove the lifting kit.

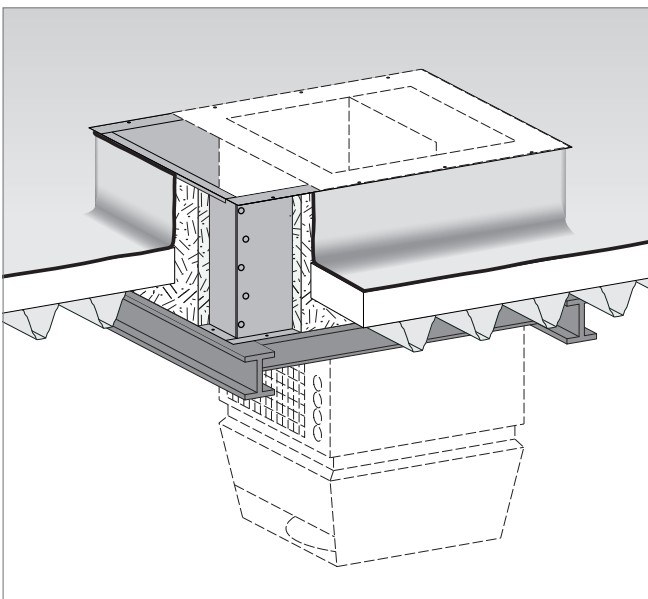


Fig. I3: Conceptual drawing of the roof frame

2 Hydraulic installation

The TopTronic® C control system is designed for a distributor circuit with separate hydraulic connection of the units; i.e. a control valve is installed in front of each unit. The throttling circuit is used as standard.



Notice

Use the “Hydraulic assembly throttling circuit” option for quick and easy hydraulic installation.

Requirements on the boiler system and the distributor circuit

- Hydraulically balance the pipework for the individual units within a control zone to ensure even distribution.
- The heating medium must be available at the control valve in the required amount and temperature.
- The condensate separator in cooling units only functions while the fan is running. No coolant must be allowed to circulate in the coil when the unit is switched off.
- Depending on local conditions, check whether compensators for linear expansion are required for the supply and return lines and/or articulated connections are required for the units.
- Do not fasten any loads to the coil, e.g. by means of the flow or return lines.
- Insulate the hydraulic lines.
- Install an automatic air vent in the roof unit at the highest point of the pipework.
- The return temperature sensor is pre-installed at the factory.

The TopTronic® C control system switches on the heating/cooling pumps and the heating/cooling demand every day. This prevents the pumps from blocking in case of a long shutdown.

Requirements for control valves

- Use 2-way control valves with the following flow characteristics:
 - Equal percentage control path
- The valve authority must be ≥ 0.5 .
- The maximum run time of the valve actuator is 60 s.
- The valve actuator must be continuous, i.e. the stroke changes in proportion to the control voltage (0-10 VDC or 2-10 VDC).
- The valve actuator must be designed with a position response (0-10 VDC or 2-10 VDC).
- The maximum power consumption is 20 VA.
- Install the valve in or close to the unit (max. distance 2 m).

Requirements on changeover valves

Use changeover valves conforming to the following specification for heating and cooling in the 2-pipe system:

- 3-way changeover valves
- Position response via limit switches (0°/90°)
- TopTronic® C System control
 - Supply voltage 24 V AC
 - 1-wire control (0/24 V AC)
 - Power consumption max. 44 VA
- TopTronic® C Single zone control panel
 - Supply voltage 24 V DC
 - 1-wire control (0/24 V DC)
 - Power consumption max. 13 VA

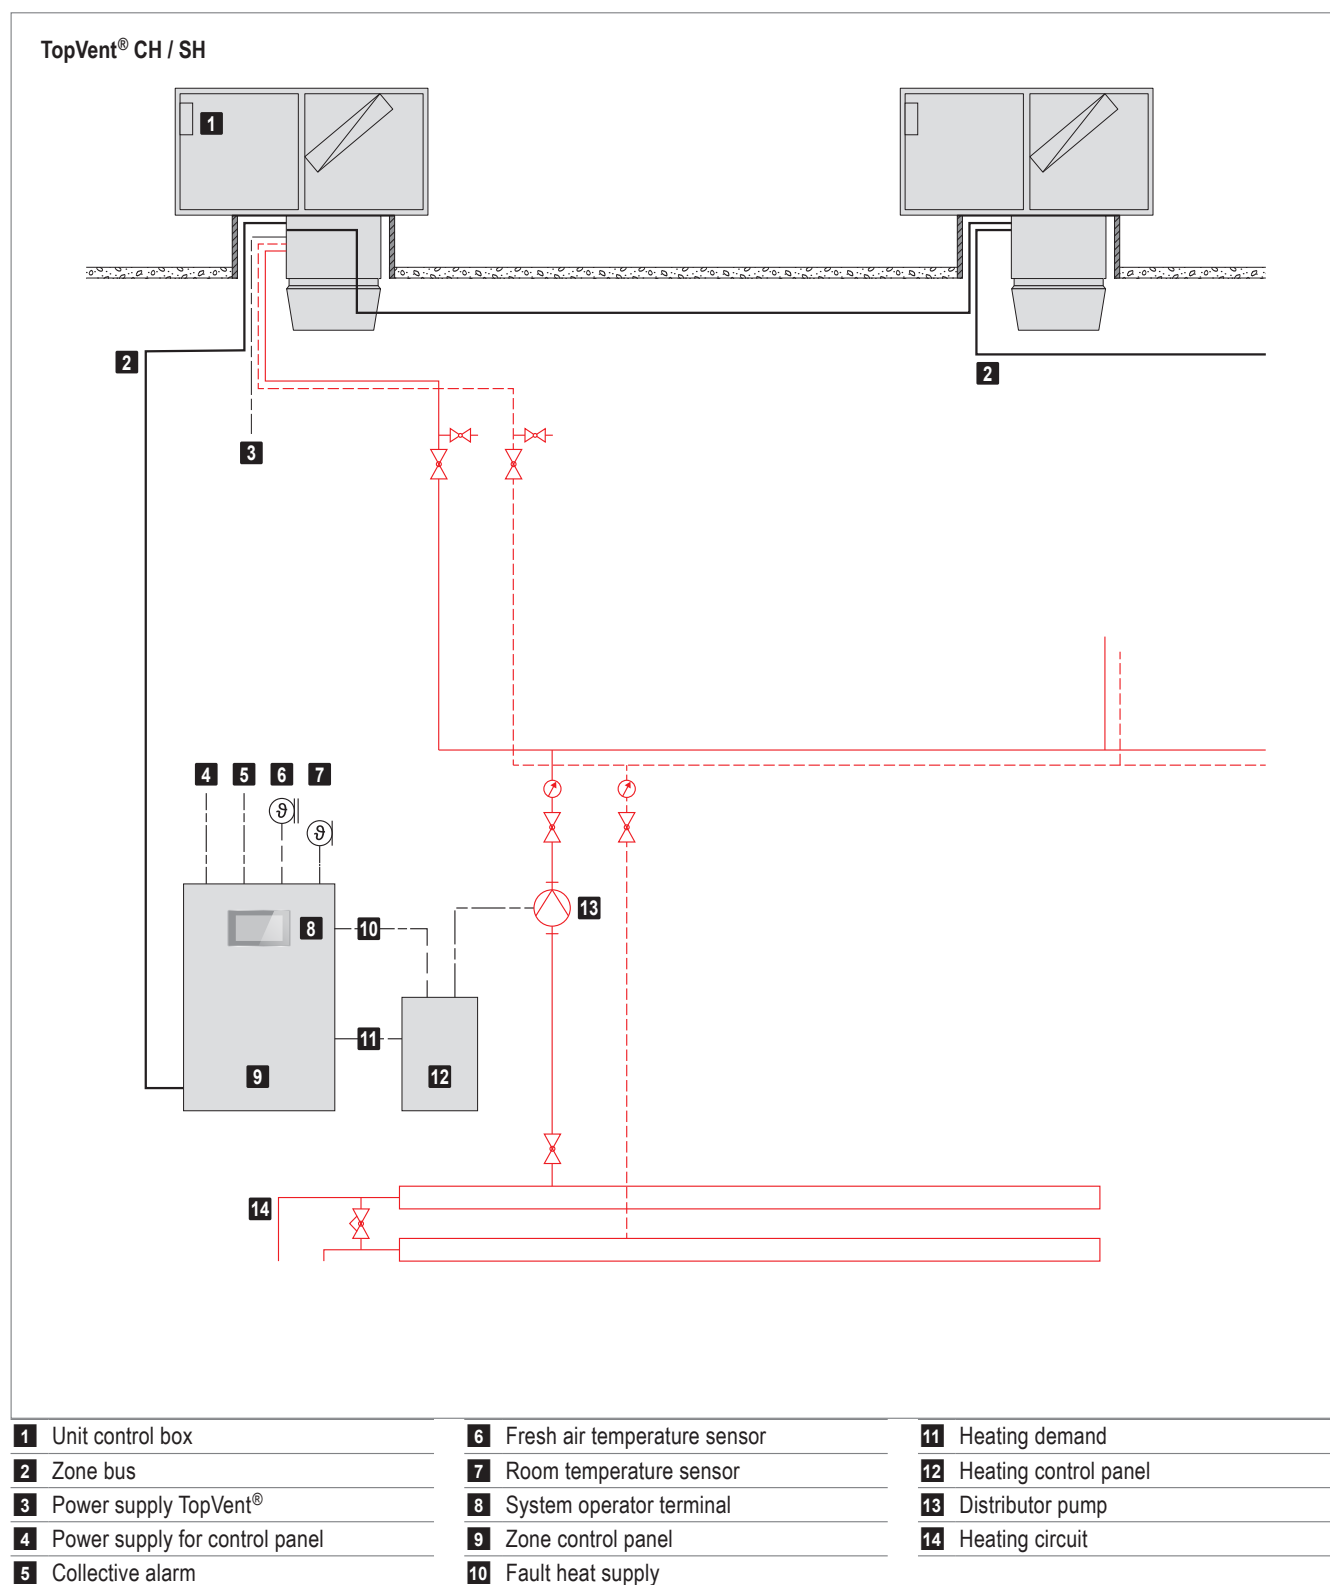


Fig. I4: Schematic diagram for throttling circuit TopVent® CH / SH (with hydraulic assembly in the unit – see part H “Options”, section 9)

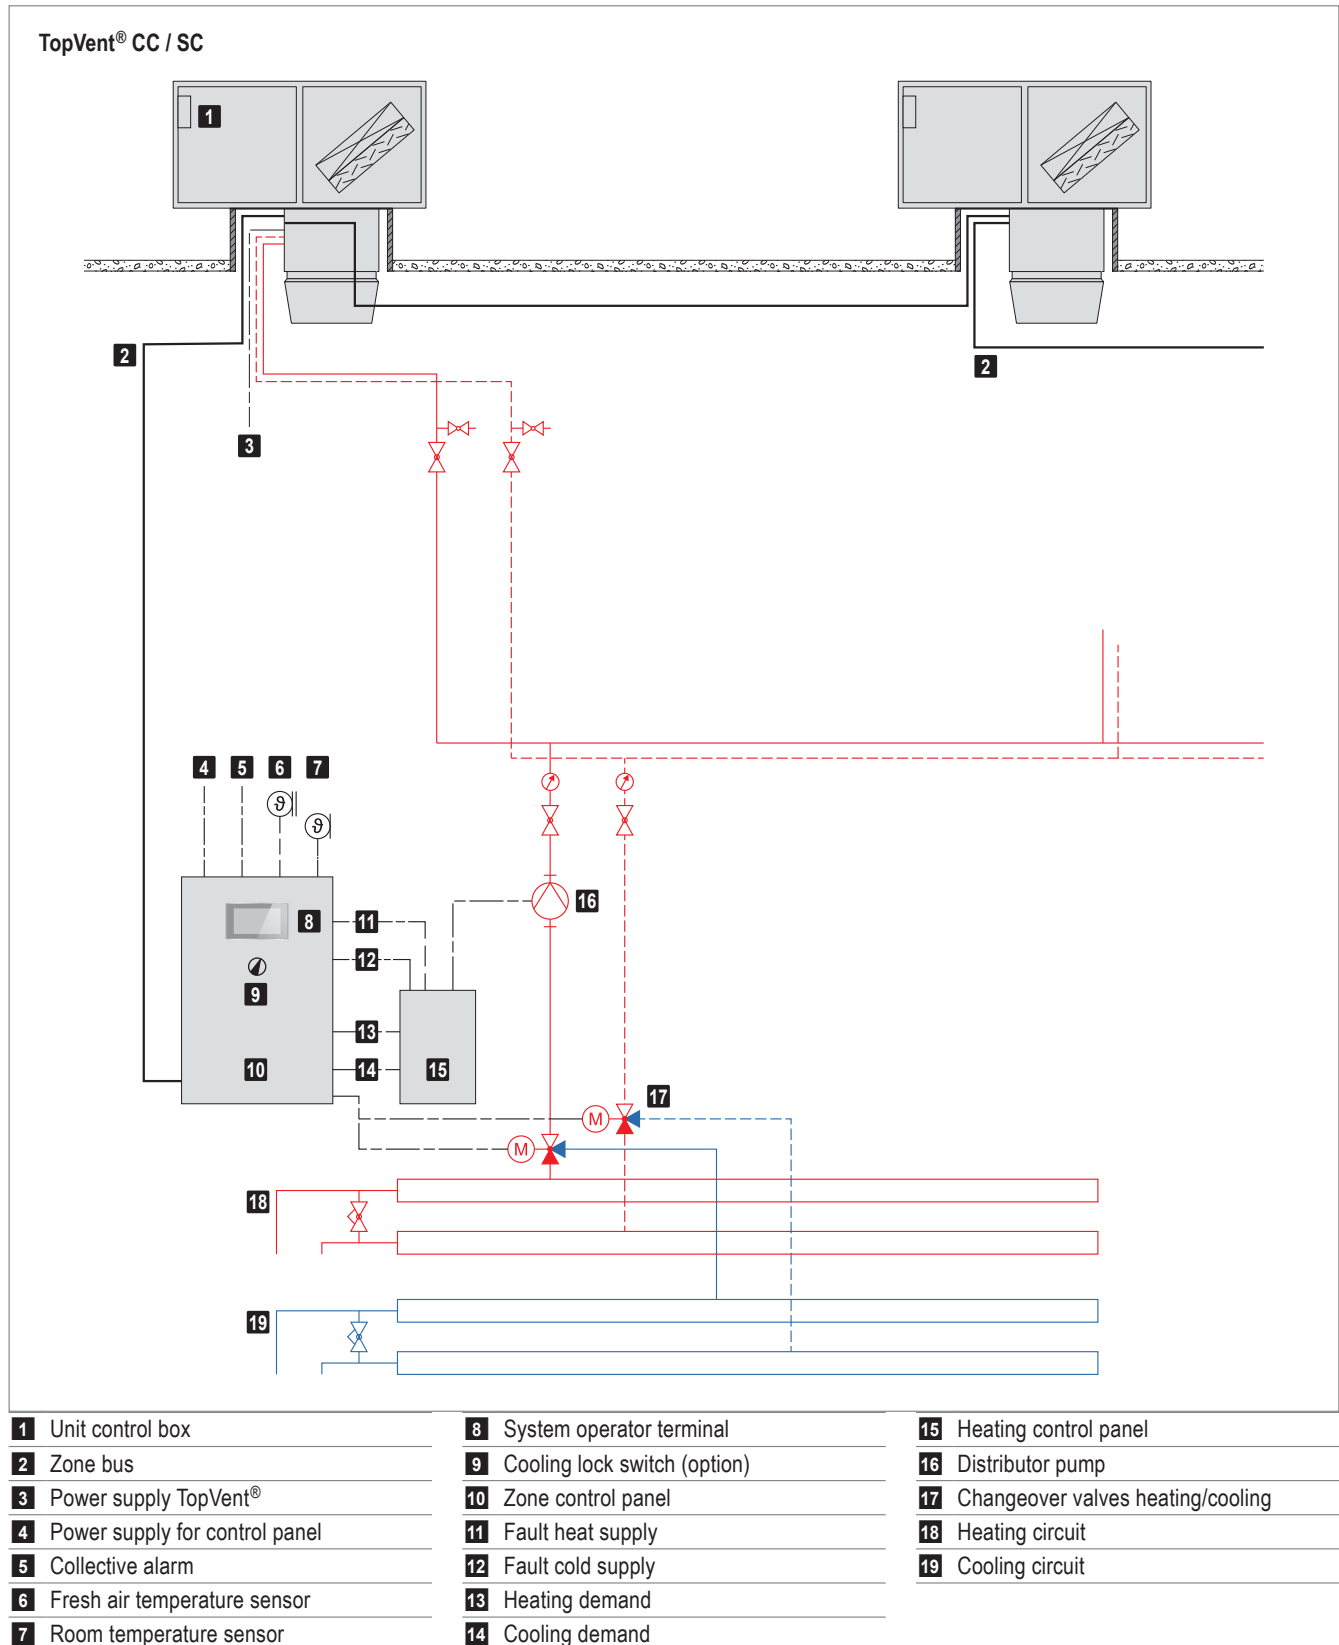


Fig. I5: Schematic diagram for throttling circuit TopVent® CC / SC (with hydraulic assembly in the unit – see part H “Options”, section 9)

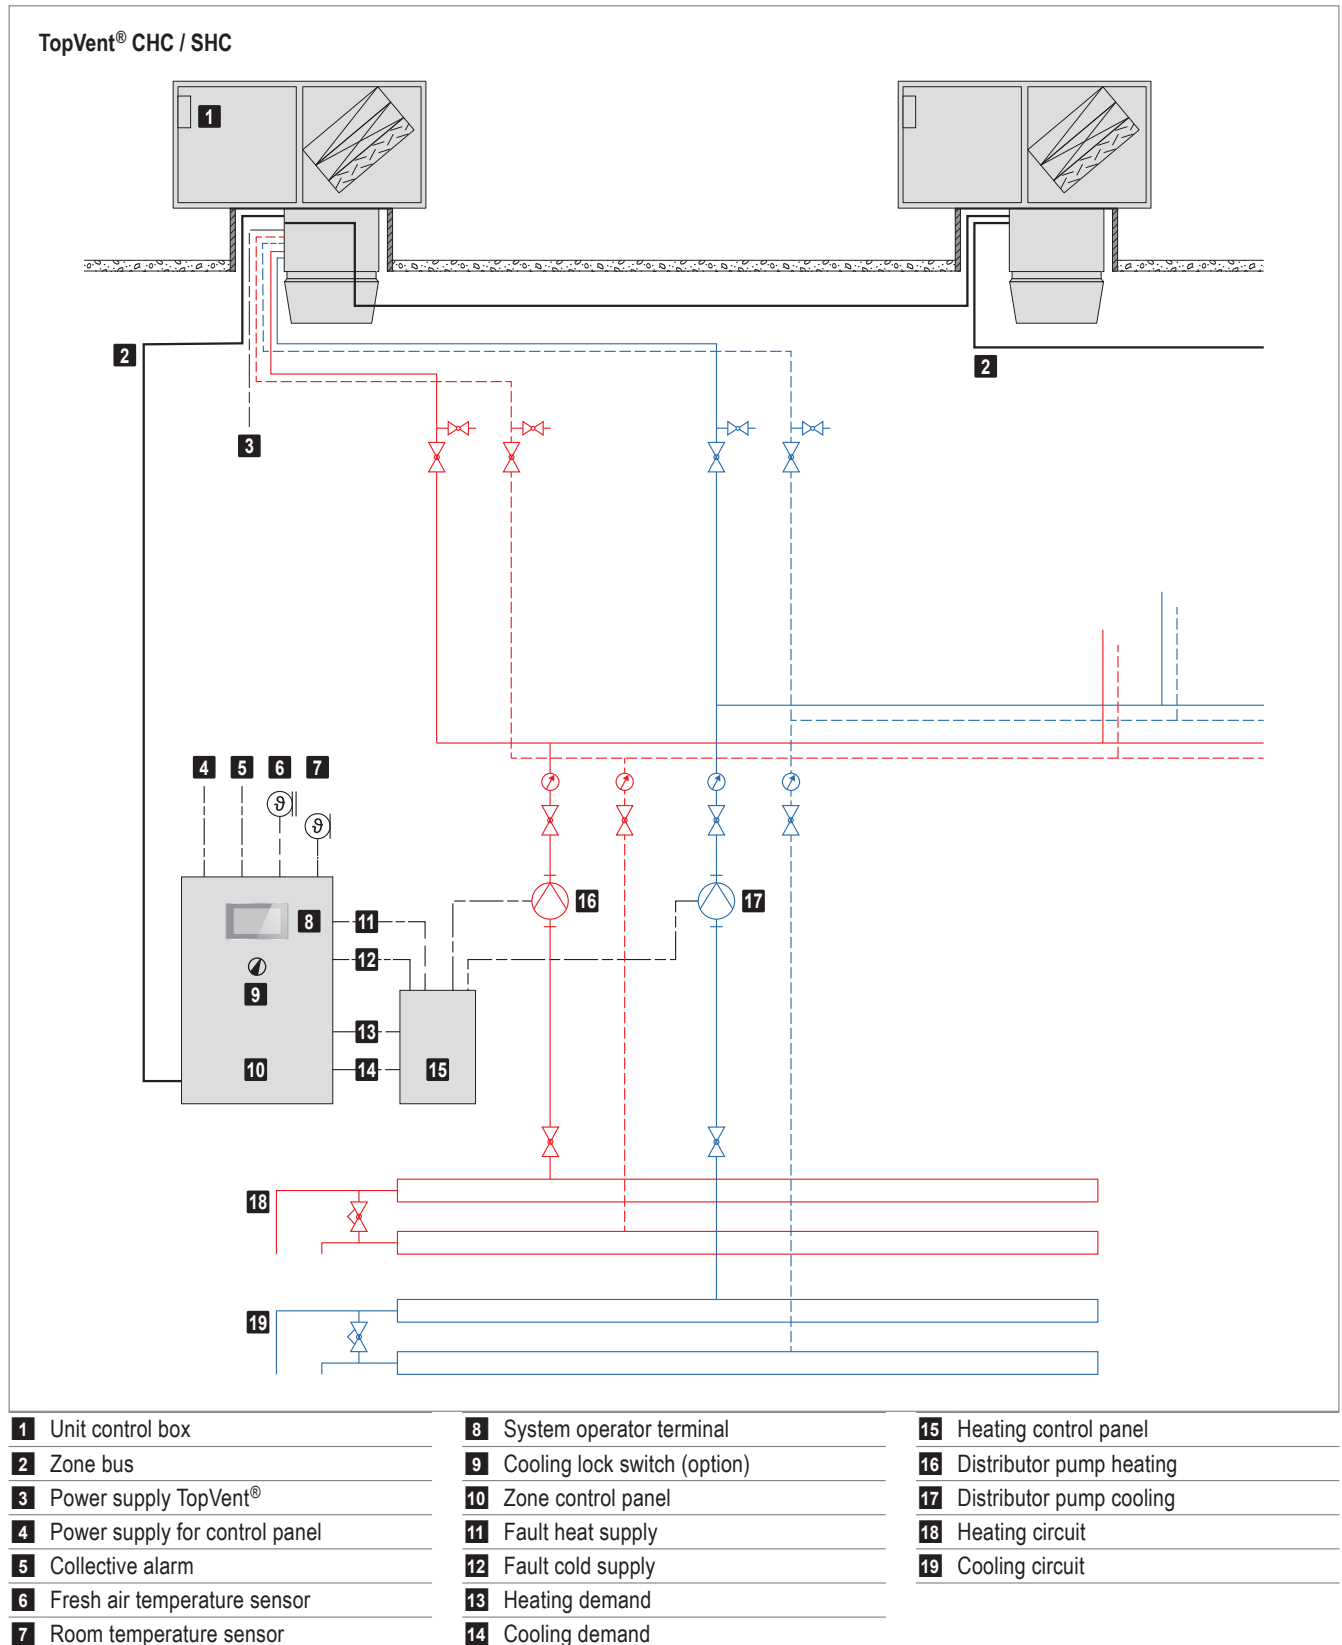


Fig. I6: Schematic diagram for throttling circuit TopVent® CHC / SHC (with hydraulic assembly in the unit – see part H “Options”, section 9)

3 Electrical installation

The electrical installation must only be carried out by a qualified electrician.

- Observe the relevant regulations (e.g. EN 60204-1).
- Choose the dimensions of the cable cross sections in line with the applicable regulations.
- Route signal and bus lines separately from mains cables.
- Make sure the lightning protection system for the units or for the entire building is planned and carried out by professionals.
- Provide overload protection equipment on site in the mains connection line of the zone control panel.
- Carry out the electrical installation according to the wiring diagram:
 - Power supply TopVent®
 - Zone bus based on system layout
 - Signal lines
- Connect optional components to the unit control box (mixing valve, pump).

3.1 Cable list for on-site connections – TopTronic® C System control

Component	Designation	Voltage	Cable	Comments	Start	Target
TopTronic® C System control	Power supply	3 × 400 VAC	NYM-J 5 × ... mm ²		On-site	Zone control panel
		1 × 230 VAC	NYM-J 3 × ... mm ²		On-site	Zone control panel
	Zone bus		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 500 m	Zone control panel	Hoval units
Zone control panel	System bus		Ethernet ≥ CAT 5	For connecting several zone control panels max. 100 m	Zone control panel	Further zone control panel
	Integration into the building management system		Ethernet ≥ CAT 5	BACnet, Modbus IP max. 100 m	Zone control panel	On-site (BMS)
			J-Y(ST)Y 2 × 2 × 0.8 mm	Modbus RTU max. 1200 m	Zone control panel	On-site (BMS)
	HovalSupervisor cloud (wired)		Ethernet ≥ CAT 5	max. 100 m	Zone control panel	On-site
	Room temperature sensor		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	Zone control panel	Sensors
	Additional room temperature sensors		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	Zone control panel	Sensors
	Combination sensor room air quality, temperature and humidity		J-Y(ST)Y 4 × 2 × 0.8 mm	max. 250 m	Zone control panel	Sensors
	Fresh air temperature sensor		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	Zone control panel	Sensors
	Combination sensor fresh air temperature and humidity		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 250 m	Zone control panel	Sensors
	Heating demand	Volt-free max. 250 VAC max. 24 VDC	NYM-O 2 × 1.5 mm ²	max. 8 A	Zone control panel	On-site
	Setpoint heating demand	2-10 VDC	J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	Zone control panel	On-site
	Cooling demand	Volt-free max. 250 VAC max. 24 VDC	NYM-O 2 × 1.5 mm ²	max. 8 A	Zone control panel	On-site
	Fault heat supply ¹⁾	24 VAC	J-Y(ST)Y 2 × 2 × 0.8 mm	max. 1 A max. 100 m	On-site	Zone control panel
	Fault cold supply ¹⁾	24 VAC	J-Y(ST)Y 2 × 2 × 0.8 mm	max. 1 A max. 100 m	On-site	Zone control panel
	Collective alarm	Volt-free max. 230 VAC max. 24 VDC	NYM-O 2 × 1.5 mm ²	max. 3 A max. 2 A	Zone control panel	On-site
	Distributor pump heat supply	3 × 400 VAC	NYM-J 4 × 1.5 mm ² (min.)	Power supply 3-phase, max. 6 A max. cable cross section 4 × 4 mm ²	Zone control panel	Pump
		1 × 230 VAC	NYM-J 3 × 1.5 mm ² (min.)	Power supply 1-phase, max. 6 A max. cable cross section 3 × 4 mm ²	Zone control panel	Pump
			NYM-O 4 × 1.5 mm ²	Control line max. 100 m	Zone control panel	Pump
	Distributor pump cold supply	3 × 400 VAC	NYM-J 4 × 1.5 mm ² (min.)	Power supply 3-phase, max. 6 A max. cable cross section 4 × 4 mm ²	Zone control panel	Pump
		1 × 230 VAC	NYM-J 3 × 1.5 mm ² (min.)	Power supply 1-phase, max. 6 A max. cable cross section 3 × 4 mm ²	Zone control panel	Pump
			NYM-O 4 × 1.5 mm ²	Control line max. 100 m	Zone control panel	Pump
	Power supply for units	3 × 400 VAC	NYM-J 5 × 1.5 mm ² (min.)	RoofVent® size 6 max. cable cross section 5 × 6 mm ²	Zone control panel or on-site	Hoval units
		3 × 400 VAC	NYM-J 5 × 4.0 mm ² (min.)	RoofVent® size 9 max. cable cross section 5 × 10 mm ²		
		3 × 400 VAC	NYM-J 5 × 1.5 mm ² (min.)	TopVent® max. cable cross section 5 × 6 mm ²		

Component	Designation	Voltage	Cable	Comments	Start	Target
	System operator terminal (if external)	24 VDC	NYM-J 3 × 1.5 mm ²	Power supply 0.42 A max. 50 m max. cable cross section 3 × 4 mm ²	Zone control panel	System operator terminal
			Ethernet ≥ CAT 5	Communication max. 100 m	Zone control panel	System operator terminal
	Zone operator terminal (if external)	24 VAC	J-Y(ST)Y 4 × 2 × 0.8 mm	Power supply, 1 A fusing max. 500 m	Zone control panel	Zone operator terminal
	External sensor values	0-10 VDC	J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	On-site	Zone control panel
	External set values	0-10 VDC	J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	On-site	Zone control panel
	Load shedding input ¹⁾	24 VAC	J-Y(ST)Y 2 × 2 × 0.8 mm	max. 1 A max. 100 m	On-site	Zone control panel
	Operating selector switch on terminal (analogue)	0-10 VDC	J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	On-site (switch)	Zone control panel
	Operating selector switch on terminal (digital)	0-10 VDC	J-Y(ST)Y 6 × 2 × 0.8 mm	max. 100 m	On-site (switch)	Zone control panel
	Operating selector button on terminal	24 VAC	J-Y(ST)Y 6 × 2 × 0.8 mm	max. 100 m	On-site (button)	Zone control panel
	Forced off ¹⁾	24 VAC	J-Y(ST)Y 2 × 2 × 0.8 mm	max. 1 A max. 100 m	On-site	Zone control panel
	Heating/cooling changeover ¹⁾	24 VAC	J-Y(ST)Y 2 × 2 × 0.8 mm	Signal external enabling/setting max. 1 A max. 100 m	On-site	Zone control panel
	Changeover valve flow	24 VAC	NYM-J 3 × 1.5 mm ²	Power supply max. cable cross section 3 × 4 mm ²	Zone control panel	Valve
		24 VAC	J-Y(ST)Y 2 × 2 × 0.8 mm	Control line max. 100 m	Zone control panel	Valve
	Changeover valve return	24 VAC	NYM-J 3 × 1.5 mm ²	Power supply max. cable cross section 3 × 4 mm ²	Zone control panel	Valve
		24 VAC	J-Y(ST)Y 2 × 2 × 0.8 mm	Control line max. 100 m	Zone control panel	Valve
	Signal for external extract air fan	2-10 VDC	J-Y(ST)Y 2 × 2 × 0.8 mm	for TopVent® SH, SC, SHC max. 100 m	Zone control panel	On-site
TopVent® unit	Power supply	3 × 400 VAC	NYM-J 5 × 1.5 mm ² (min.)	max. cable cross section 5 × 6 mm ²	Zone control panel or on-site	TopVent® unit
	Zone bus		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 500 m	Zone control panel	TopVent® unit
	Control valve heating	24 VDC	NYM-O 4 × 0.75 mm ²	max. cable cross section 4 × 1.5 mm ² with Hydraulic assembly option: control valves installed and wired at the factory	TopVent® unit	Valve
	Control valve cooling	24 VDC	NYM-O 4 × 0.75 mm ²		TopVent® unit	Valve
	Heating pump	230 VAC	NYM-J 3 × 1.5 mm ²	Power supply max. cable cross section 3 × 1.5 mm ²	TopVent® unit	Pump
		24 VDC	NYM-O 4 × 1.0 mm ²	Control line max. 100 m	TopVent® unit	Pump
	Cooling pump	230 VAC	NYM-J 3 × 1.5 mm ²	Power supply max. cable cross section 3 × 1.5 mm ²	TopVent® unit	Pump
		24 VDC	NYM-O 4 × 1.0 mm ²	Control line max. 100 m	TopVent® unit	Pump
	Forced off	24 VDC	NYM-O 2 × 1.5 mm ²	for TopVent® SH, SC, SHC max. 100 m max. 1 A	On-site	TopVent® unit
	Door contact	Volt-free	J-Y(ST)Y 1 × 2 × 0.8 mm	for TopVent® CH, CC, CHC max. 100 m	On-site	TopVent® unit

1) Use a relay to connect the signal to several zone controllers in parallel.

Table I1: Cable list for on-site connections – TopTronic® C System control

3.2 Cable list for on-site connections – TopTronic® C Single zone control panel

Component	Designation	Voltage	Cable	Comments	Start	Target
TopTronic® C Single zone control panel	Power supply	1 × 230 VAC	NYM-J 3 × 1.5 mm²	max. cable cross section 3 × 6 mm²	On-site	Zone control panel
	Zone bus		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 500 m	Zone control panel	Hoval units
	Integration into the building management system		Ethernet ≥ CAT 5	BACnet, Modbus IP max. 100 m	Zone control panel	On-site (BMS)
			J-Y(ST)Y 2 × 2 × 0.8 mm	Modbus RTU max. 1200 m	Zone control panel	On-site (BMS)
	HovalSupervisor cloud (wired)		Ethernet ≥ CAT 5	max. 100 m	Zone control panel	On-site
	Room temperature sensor		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	Zone control panel	Sensors
	Additional room temperature sensors		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	Zone control panel	Sensors
	Combination sensor room air quality, temperature and humidity		J-Y(ST)Y 4 × 2 × 0.8 mm	max. 250 m	Zone control panel	Sensors
	Fresh air temperature sensor		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	Zone control panel	Sensors
	Heating demand	Volt-free max. 230 VAC	NYM-O 2 × 1.5 mm²	max. 13 A	Zone control panel	On-site
	Setpoint heating demand	2-10 VDC	J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	Zone control panel	On-site
	Cooling demand	Volt-free max. 230 VAC	NYM-O 2 × 1.5 mm²	max. 13 A	Zone control panel	On-site
	Fault heat supply	24 VDC	NYM-O 2 × 1.5 mm²	max. 0.5 A max. 100 m	On-site	Zone control panel
	Fault cold supply	24 VDC	NYM-O 2 × 1.5 mm²	max. 0.5 A max. 100 m	On-site	Zone control panel
	Collective alarm	Volt-free max. 230 VAC	NYM-O 2 × 1.5 mm²	max. 13 A	Zone control panel	On-site
	Operating selector switch on terminal (digital)	0-10 VDC	J-Y(ST)Y 6 × 2 × 0.8 mm	max. 100 m	On-site (switch)	Zone control panel
	Operating selector button on terminal	24 VDC	J-Y(ST)Y 6 × 2 × 0.8 mm	max. 0.5 A max. 100 m	On-site (button)	Zone control panel
	Forced off	24 VDC	NYM-O 2 × 1.5 mm²	max. 0.5 A max. 100 m	On-site	Zone control panel
	Heating/cooling changeover	24 VDC	NYM-O 2 × 1.5 mm²	Signal external enabling/setting max. 0.5 A max. 100 m	On-site	Zone control panel
	Changeover valve flow	24 VDC	NYM-O 7 × 1.5 mm²	see valve specification max. 100 m	Zone control panel	Valve
	Changeover valve return	24 VDC	NYM-O 7 × 1.5 mm²	see valve specification max. 100 m	Zone control panel	Valve
	External setpoint fresh air ratio	2-10 VDC	J-Y(ST)Y 2 × 2 × 0.8 mm	max. 100 m	On-site	Zone control panel
	Signal for external extract air fan	2-10 VDC	J-Y(ST)Y 2 × 2 × 0.8 mm	for TopVent® SH, SC, SHC max. 100 m	Zone control panel	On-site
TopVent® unit	Power supply	3 × 400 VAC	NYM-J 5 × 1.5 mm² (min.)	max. cable cross section 5 × 6 mm²	On-site	TopVent® unit
	Zone bus		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 500 m	Zone control panel	TopVent® unit
	Control valve heating	24 VDC	NYM-O 4 × 0.75 mm²	max. cable cross section 4 × 1.5 mm² with Hydraulic assembly option: control valves installed and wired at the factory	TopVent® unit	Valve
	Control valve cooling	24 VDC	NYM-O 4 × 0.75 mm²		TopVent® unit	Valve
	Heating pump	230 VAC	NYM-J 3 × 1.5 mm²	Power supply max. cable cross section 3 × 1.5 mm²	TopVent® unit	Pump
		24 VDC	NYM-O 4 × 1.0 mm²	Control line max. 100 m	TopVent® unit	Pump
	Cooling pump	230 VAC	NYM-J 3 × 1.5 mm²	Power supply max. cable cross section 3 × 1.5 mm²	TopVent® unit	Pump
		24 VDC	NYM-O 4 × 1.0 mm²	Control line max. 100 m	TopVent® unit	Pump
	Forced off	24 VDC	NYM-O 2 × 1.5 mm²	for TopVent® SH, SC, SHC max. 100 m max. 1 A	On-site	TopVent® unit
	Door contact	Volt-free	J-Y(ST)Y 1 × 2 × 0.8 mm	for TopVent® CH, CC, CHC max. 100 m	On-site	TopVent® unit

Table I2: Cable list for on-site connections – TopTronic® C Single zone control panel

3.3 EasyTronic EC

Component	Designation	Voltage	Cable	Comments	Start	Target
EasyTronic EC Controller	Power supply	1 × 230 VAC	NYM 2 × 1.5 mm ² (min.)	max. cable cross section 2 × 1.5 mm ²	On-site	HoVal controller
	Heating/cooling changeover	24 VAC	NYM-O 2 × 1.5 mm ²	max. 1 A	On-site	HoVal controller
	Door contact	24 VDC	NYM 2 × 1.0 mm ²		On-site	HoVal controller
	Modbus RTU		J-Y(ST)Y 2 × 2 × 0.8 mm	max. 300 m	On-site (BMS)	HoVal controller
	External room temperature sensor		J-Y(ST)Y 2 × 2 × 0.8 mm	shielded, max. 30 m	Sensors	HoVal controller
	System bus		J-Y(ST)Y 4 × 2 × 0.8 mm	Fan, air distribution	HoVal controller	HoVal units
	Pump/Valve control	230 VAC 24 VDC	depending on the number of contacts	via on-site relay, max 3 A	Pump/valve	Relay (on-site)
TopVent® Unit	Power supply	3 × 400 VAC	NYM-J 5 × 1.5 mm ² (min.)	max. 1 A max. cable cross section 5 × 6 mm ²	On-site	TopVent® unit
	System bus		J-Y(ST)Y 4 × 2 × 0.8 mm	Fan, air distribution	HoVal controller	TopVent® unit
	Differential pressure switch air filter		NYM 2 × 1.0 mm ²	Signal to on-site lamp or controller	TopVent® unit	On-site

Table I3: Cable list for on-site connections – EasyTronic EC

3.4 Terminal box design

Actuator Air-Injector	
Control voltage	2-10 VDC
Setting range	2-6.44 V / 0°-50°
Position response	2-10 VDC
Max. cable cross section	4 × 1.5 mm ²
Fan	
Enable signal	digital
Control voltage	0-10 VDC
Max. cable cross section	5 × 1.5 mm ²
Air filter	
Signal differential pressure switch	digital
Control valve actuator ("Hydraulic assembly throttling circuit" option)	
Control voltage	0(2)-10 VDC
Position response	0(2)-10 VDC

Table I4: Control signals for TopVent® units in terminal box design

1 Design example.	142
2 Maintenance schedule	145
3 Checklist for project discussions	146



System design

1 Design example



Notice

Use the “HK-Select” program to design Hoval Indoor Climate Systems. You can download it free of charge on the Internet.

1.1 Applications with higher comfort requirements (e.g. production halls, assembly halls, sports halls)

Design data	Example
■ Geometry of the room ■ Internal heat gains ■ People in the room ■ Heating and cooling with central energy supply (boiler and water chiller) ■ Improvement of air quality, fresh air supply for the people in the room (fresh air volume per person = 30 m³/h)	50 × 60 × 12 m 28 kW 20 people
Design conditions heating: ■ Fabric heat losses ■ Fresh air temperature ■ Room temperature ■ Extract air temperature ■ Temperature of the heating medium	350 kW -15 °C 18 °C 20 °C 60 °C / 40 °C
Design conditions cooling: ■ Transmission sensible gains ■ Fresh air conditions ■ Room air conditions ■ Extract air temperature ■ Temperature of the cooling medium	140 kW 32 °C / 40 %rh 26 °C / 40 %rh 28 °C 6 °C / 12 °C
Fresh air supply ■ Required fresh air volume in total: ■ Fresh air ratio of supply air units: max. 10 % of the nominal air flow rate <i>The fresh air ratio can be adjusted from 0-100 %. Where EU Regulation 1253/2014 applies, it must be restricted to max. 10 % in the design conditions.</i> ■ Calculate the required number of supply air units from the nominal air flow rate.	20 × 30 = 600 m³/h Size 6: max. 600 m³/h fresh air Size 9: max. 900 m³/h fresh air → 1 TopVent® SC unit
Mounting height ■ Calculate the actual mounting height (= distance between the floor and the bottom edge of the units). $Y = \text{Hall height} - \text{distance from ceiling} - \text{unit height}$ ■ Compare the actual mounting height with the minimum and maximum mounting height (see Fig. I1 on page 130 and HK-Select).	<u>Supply air units:</u> Size 6 → OK Size 9 → OK <u>Recirculation units:</u> Size 6 → OK Size 9 → OK

Required performance for covering fabric heat losses																																																																								
■ Required heat output for coverage of fabric heat losses in total: $Q_{H_req} = \text{Fabric heat losses} - \text{internal heat loads}$		350 – 28 = 322 kW																																																																						
■ Required cooling capacity for coverage of transmission sensible gains in total: $Q_{C_req} = \text{Transmission sensible gains} + \text{internal heat loads}$		140 + 28 = 168 kW																																																																						
Required heat output of recirculation units ■ Determine the required heat output of the recirculation units based on the output of the supply air unit. $Q_{H_Recirculation} = Q_{H_req} - Q_{H_Supply\ air}$ For the supply air unit, take into account only the share of capacity that is used for coverage of fabric heat losses (separately shown in HK-Select).		<table><tr><th>Type</th><th>$Q_{H_Supply\ air}$</th><th>$Q_{H_Recirculation}$</th></tr><tr><td>SC-6/C</td><td>40.5</td><td>322 – 40.5 = 281.5</td></tr><tr><td>SC-9/C</td><td>63.2</td><td>322 – 63.2 = 258.8</td></tr><tr><td>SC-9/D</td><td>79.3</td><td>322 – 79.3 = 242.7</td></tr></table> (values in kW)	Type	$Q_{H_Supply\ air}$	$Q_{H_Recirculation}$	SC-6/C	40.5	322 – 40.5 = 281.5	SC-9/C	63.2	322 – 63.2 = 258.8	SC-9/D	79.3	322 – 79.3 = 242.7																																																										
Type	$Q_{H_Supply\ air}$	$Q_{H_Recirculation}$																																																																						
SC-6/C	40.5	322 – 40.5 = 281.5																																																																						
SC-9/C	63.2	322 – 63.2 = 258.8																																																																						
SC-9/D	79.3	322 – 79.3 = 242.7																																																																						
Required cooling capacity of recirculation units ■ Determine the required cooling capacity of the recirculation units based on the capacity of the supply air unit. $Q_{C_Recirculation} = Q_{C_req} - Q_{C_Supply\ air}$ For the supply air unit, take into account only the share of capacity that is used for coverage of transmission sensible gains (separately shown in HK-Select).		<table><tr><th>Type</th><th>$Q_{C_Supply\ air}$</th><th>$Q_{C_Recirculation}$</th></tr><tr><td>SC-6/C</td><td>25.4</td><td>168 – 25.4 = 142.6</td></tr><tr><td>SC-9/C</td><td>39.2</td><td>168 – 39.2 = 128.8</td></tr><tr><td>SC-9/D</td><td>46.7</td><td>168 – 46.7 = 121.3</td></tr></table> (values in kW)	Type	$Q_{C_Supply\ air}$	$Q_{C_Recirculation}$	SC-6/C	25.4	168 – 25.4 = 142.6	SC-9/C	39.2	168 – 39.2 = 128.8	SC-9/D	46.7	168 – 46.7 = 121.3																																																										
Type	$Q_{C_Supply\ air}$	$Q_{C_Recirculation}$																																																																						
SC-6/C	25.4	168 – 25.4 = 142.6																																																																						
SC-9/C	39.2	168 – 39.2 = 128.8																																																																						
SC-9/D	46.7	168 – 46.7 = 121.3																																																																						
Minimum number of recirculation units ■ Determine the minimum number of recirculation units depending on the available supply air units. Take into account the following criteria: - Floor area covered - Heat output - Cooling capacity - Unit clearances																																																																								
<table><tr><th>Supply air unit</th><th>Recirculation units</th><th colspan="4">Required number of recirculation units</th><th rowspan="2">Minimum number of recirculation units</th></tr><tr><th>Type</th><th>Type</th><th>Floor area covered</th><th>Heat output</th><th>Cooling capacity</th><th>Unit clearances</th></tr><tr><td rowspan="3">1 unit SC-6/C</td><td>CC-6/C</td><td>5</td><td>7</td><td>6</td><td>5</td><td>7</td></tr><tr><td>CC-9/C</td><td>3</td><td>5</td><td>4</td><td>5</td><td>5</td></tr><tr><td>CC-9/D</td><td>3</td><td>4</td><td>3</td><td>5</td><td>5</td></tr><tr><td rowspan="3">1 unit SC-9/C</td><td>CC-6/C</td><td>4</td><td>7</td><td>5</td><td>5</td><td>7</td></tr><tr><td>CC-9/C</td><td>3</td><td>4</td><td>4</td><td>3</td><td>4</td></tr><tr><td>CC-9/D</td><td>3</td><td>4</td><td>3</td><td>3</td><td>4</td></tr><tr><td rowspan="3">1 unit SC-9/D</td><td>CC-6/C</td><td>4</td><td>6</td><td>5</td><td>5</td><td>6</td></tr><tr><td>CC-9/C</td><td>3</td><td>4</td><td>≈ 3 (–1 kW)</td><td>3</td><td>4</td></tr><tr><td>CC-9/D</td><td>3</td><td>≈ 3 (–2 kW)</td><td>3</td><td>3</td><td>3</td></tr></table>	Supply air unit	Recirculation units	Required number of recirculation units				Minimum number of recirculation units	Type	Type	Floor area covered	Heat output	Cooling capacity	Unit clearances	1 unit SC-6/C	CC-6/C	5	7	6	5	7	CC-9/C	3	5	4	5	5	CC-9/D	3	4	3	5	5	1 unit SC-9/C	CC-6/C	4	7	5	5	7	CC-9/C	3	4	4	3	4	CC-9/D	3	4	3	3	4	1 unit SC-9/D	CC-6/C	4	6	5	5	6	CC-9/C	3	4	≈ 3 (–1 kW)	3	4	CC-9/D	3	≈ 3 (–2 kW)	3	3	3		
Supply air unit	Recirculation units	Required number of recirculation units				Minimum number of recirculation units																																																																		
Type	Type	Floor area covered	Heat output	Cooling capacity	Unit clearances																																																																			
1 unit SC-6/C	CC-6/C	5	7	6	5	7																																																																		
	CC-9/C	3	5	4	5	5																																																																		
	CC-9/D	3	4	3	5	5																																																																		
1 unit SC-9/C	CC-6/C	4	7	5	5	7																																																																		
	CC-9/C	3	4	4	3	4																																																																		
	CC-9/D	3	4	3	3	4																																																																		
1 unit SC-9/D	CC-6/C	4	6	5	5	6																																																																		
	CC-9/C	3	4	≈ 3 (–1 kW)	3	4																																																																		
	CC-9/D	3	≈ 3 (–2 kW)	3	3	3																																																																		
■ Choose the final solution from the remaining possibilities, depending on the geometry of the hall and the costs.																																																																								

1.2 Applications with low comfort requirements (e.g. warehouses, logistics centres)

Design data	Example																					
■ Geometry of the room ■ Heating with central energy supply (boiler)	181 × 105 × 12 m																					
Design conditions heating: ■ Fabric heat losses ■ Fresh air temperature ■ Room temperature ■ Extract air temperature ■ Temperature of the heating medium	892 kW -15 °C 15 °C 18 °C 60 °C / 40 °C																					
Mounting height ■ Calculate the actual mounting height (= distance between the floor and the bottom edge of the units). Y = Hall height – distance from ceiling – unit height ■ Compare the actual mounting height with the minimum and maximum mounting height (see Fig. I1 on page 130).	<u>Recirculation units:</u> Size 6 → OK Size 9 → OK																					
Required number of recirculation units ■ Determine the required number of recirculation units based on the heat output. n = Fabric heat losses : heat output per unit ■ Choose the final solution from the remaining possibilities, depending on the geometry of the hall and the costs.	<table><tr><th>Type</th><th>kW</th><th>Quantity</th></tr><tr><td>CH-6/A</td><td>892 : 18.8</td><td>48</td></tr><tr><td>CH-6/B</td><td>892 : 26.9</td><td>34</td></tr><tr><td>CH-6/C</td><td>892 : 45.0</td><td>20</td></tr><tr><td>CH-9/A</td><td>892 : 31.7</td><td>29</td></tr><tr><td>CH-9/B</td><td>892 : 40.6</td><td>22</td></tr><tr><td>CH-9/C</td><td>892 : 69.9</td><td>13</td></tr></table>	Type	kW	Quantity	CH-6/A	892 : 18.8	48	CH-6/B	892 : 26.9	34	CH-6/C	892 : 45.0	20	CH-9/A	892 : 31.7	29	CH-9/B	892 : 40.6	22	CH-9/C	892 : 69.9	13
Type	kW	Quantity																				
CH-6/A	892 : 18.8	48																				
CH-6/B	892 : 26.9	34																				
CH-6/C	892 : 45.0	20																				
CH-9/A	892 : 31.7	29																				
CH-9/B	892 : 40.6	22																				
CH-9/C	892 : 69.9	13																				

2 Maintenance schedule

Activity	Interval
Renew air filter	When the filter alarm is displayed, at least annually
Comprehensively checking function; cleaning and possibly repairing the TopVent® units	Annually by Hoval customer service

Table J1: Maintenance schedule

Project

Project No.

Name

Function

Address

Tel.

E-mail

Date

Information about the hall

Application

Length

Type

Width

Insulation

Height

Is the roof strong enough?

☐ yes ☐ no

Are there window areas?

☐ yes ☐ no

Percentage?

Is there a crane?

☐ yes ☐ no

Height?

Is there enough space for installation and servicing?

☐ yes ☐ no

Are there any voluminous installations or machines?

☐ yes ☐ no

Are pollutants present?

☐ yes ☐ no

Which?

– If yes, are they heavier than air?

☐ yes ☐ no

Is oil contained in the extract air?

☐ yes ☐ no

Is dust present?

☐ yes ☐ no

Dust level?

Is there high humidity?

☐ yes ☐ no

How much?

Are local machine extractions required?

☐ yes ☐ no

Are any conditions imposed by public authorities?

☐ yes ☐ no

Which?

Are sound level requirements to be fulfilled?

☐ yes ☐ no

Which?

Design data

Internal heat gains (machines, ...)		kW
Heating and cooling		
Unit size		
Control zones		


Design conditions heating

■ Standard outside temperature		°C
■ Room temperature		°C
■ Extract air temperature		°C
■ Fabric heat losses		kW

Design conditions cooling

■ Standard outside temperature		°C		
■ Room temperature and humidity		°C		%
■ Extract air temperature		°C		
■ Transmission sensible gains		kW		

Further information

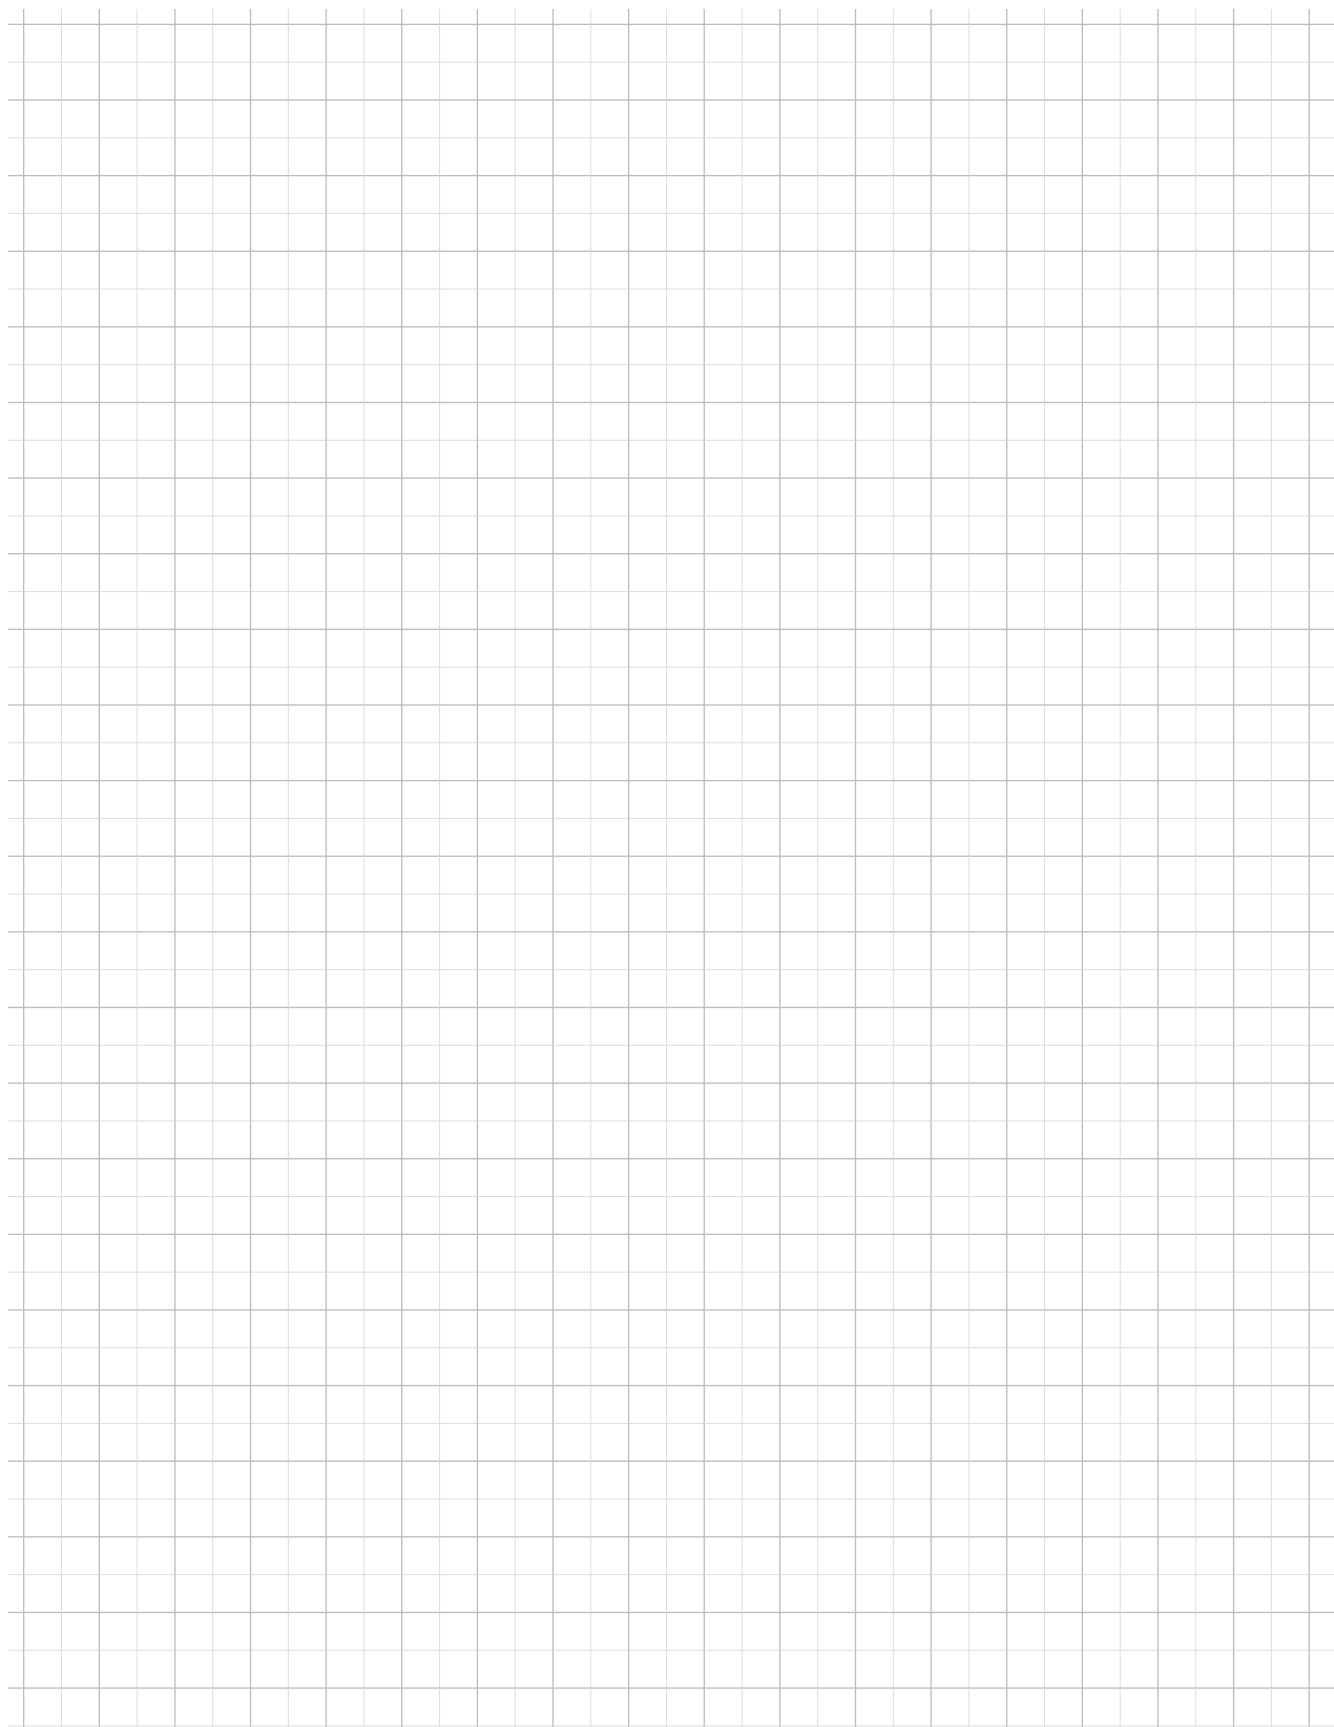

Hoval quality.
You can count on us.

Hoval

Hoval is one of the leading international companies for heating and indoor climate solutions. Drawing on more than 80 years of experience and benefiting from a close-knit team culture, the Hoval Group delivers exciting solutions and develops technically superior products. This leadership role requires a sense of responsibility for energy and the environment, which is expressed in an intelligent combination of different heating technologies and customised indoor climate solutions.

Hoval also provides personal consultations and comprehensive customer service. With around 2500 employees in 15 companies around the world, Hoval sees itself not as a conglomerate, but as a large family that thinks and acts globally.

Hoval heating and indoor climate solutions are currently exported to more than 50 countries.

Liechtenstein

Hoval Aktiengesellschaft
9490 Vaduz
+423 399 24 00
hoval.com

Responsibility for energy and environment

Your Hoval partner



Thermotrade Kft.

H-2112 Veresegyház, Szadai u. 13.
+36 28 588 810
thermotrade@hoval.hu
www.thermotrade.hu